



We answer to you.

PLANNING MODULE
APPLICATION

FOR

TOWER 6
CITY OF ALLENTOWN, LEHIGH COUNTY, PENNSYLVANIA

August 2016

Prepared for:

Serfass Construction Company
3764 Mauch Chunk Road
Allentown, PA 18104
610-769-1100

Prepared by:

RETTEW ASSOCIATES, INC.
515 W. Hamilton Street,
Allentown, PA 18101
800-738-8395

RETTEW Project No. 106092000

TABLE OF CONTENTS

<u>SECTION</u>	<u>TITLE</u>
1.0	AGENCY COORDINATION CHECKLIST
2.0	TRANSMITTAL LETTER & RESOLUTION
3.0	SEWAGE FACILITIES PLANNING MODULE COMPONENT 3
3.1	LEHIGH COUNTY AUTHORITY – WATER CAPACITY LETTER
3.2	LEHIGH COUNTY AUTHORITY – SEWER CAPACITY LETTER
3.3	PROJECT NARRATIVE
3.4	USGS LOCATION MAP
3.5	PLOT PLAN
3.6	PHMC COMMENTS
3.7	PNDI RECEIPT
3.8	ALTERNATIVES ANALYSIS
3.9	PATH OF SEWAGE TO TREATMENT FACILITY
3.10	ALLENTOWN SEWER ORDINANCE
4.0	SEWAGE FACILITIES PLANNING MODULE COMPONENT 4
4.1	4A – MUNICIPAL PLANNING AGENCY REVIEW
4.2	4B – COUNTY PLANNING AGENCY REVIEW

SECTION 1.0

AGENCY COORDINATION CHECKLIST

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

Pocono District Office
Clean Water Program

Date 6/6/2016

Name RETTEW
Address 515 W. HAMILTON ST.
STE. 508
ALLENTOWN, PA 18101

RE: Planning Module for New Land Development
Subdivision TOWER 6
COMMERCIAL 6440 GPD
City of Allentown, Lehigh County
DEP Code No: 2-39001189-3

JUN 09 2016

ALLENTOWN

Dear:

In response to your postcard application, enclosed are the applicable planning modules required for the proposed development. Please submit the completed planning module and supporting information to the municipality(ies) in which the project is located. The Department must receive 3 copies. Please answer all questions. Do Not answer "N/A" or "Not Applicable". If you find a question does not apply, explain all reasons to support that answer.

A copy of the letter **MUST** be attached to the planning module when resubmitted through the municipality to the Department. This letter is to be used as a completion checklist and guide to completing the planning modules and does not supersede the rules and regulations found in Chapter 71. The municipality must submit the complete module package to the Department, (see end of letter for certification statement).

Effective December 15, 1995 Act 149 required the Department to assess planning module review fees. This fee is based on the type of development and total equivalent dwelling units proposed. The applicant will be billed upon Department approval or denial of the project.

If you are applying for a planning module exemption for this project, the exemption was not granted for the following reason(s):

<u>Materials required</u>	<u>Municipal Checklist</u>	<u>DEP Completeness Review</u>
X		Department cover/Checklist letter
X		Transmittal letter, completed and signed by the Municipal Secretary.
X		Resolution of Adoption completed and signed by the Municipal Secretary and containing the municipal seal.
		Component 2-Follow attached guidance.
X		Component 3-Follow attached guidance.
		Component 3s-Follow attached guidance.
X		Component 4a-Municipal Planning Agency Review
X		Component 4b-County Planning Agency Review
		Potential Impact(s) has occurred based on your search of the PA Natural Diversity Inventory. These issues must be resolved with each agency before the Department's review of Planning Modules can occur.
		Sewage management program as per 25 Pa. Code Subsection 71.72
		Hydrogeologic Study – Analysis of interbasin transfer of water between a Special Protection watershed into a Non-Special Protection watershed.
		Delaware River Basin Commission Notice of Applications Received (NAR) for projects with sewage flows exceeding 10,000 GPD.
		Preliminary hydrogeology
		Permeability testing, to be determined at site testing
		Detailed hydrogeologic study

Materials required **Municipal Checklist**


**DEP
Completeness
Review**

_____	_____	Socio-economic justification	_____
_____	_____	If the project is located in a Special Protection Watershed, please submit an Antidegradation Analysis meeting the Requirement of Chapter 93.4(b), 93.4(a) and 93.4c(b)(2)	_____

In all cases, address the immediate and long range sewage disposal needs of the proposal and comply with 25 Pa. Code, Chapter 71, Subchapter C relating to New Land Development Plan Revisions.

Please note that the Department will return the planning module package if an incomplete revision is submitted.

Sincerely,



Robert T. Corby, Jr.
Sewage Planning Specialist
Clean Water Program

CERTIFICATION STATEMENT

I certify that this submittal is complete and includes all requested items. Failure to submit a complete module package will result in return of package.

Municipal Address _____

Municipal Telephone Number _____

Signed: _____, Municipal Secretary



List below any individuals and address that should be copied if the planning module is returned to the municipality (if address is not provided, no copy will be sent):



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF POINT AND NON-POINT SOURCE MANAGEMENT

Completeness Checklist

The individual completing the component should use the checklist below to assure that all items are included in the module package. The municipality should confirm that the required items have been included within 10 days of receipt, and if complete, sign and date the checklist.

Sewage Collection and Treatment Facilities

- Name and Address of land development project.
- U.S.G.S. 7.5 minute topographic map with development area plotted.
- Project Narrative.
- Letter from water company (if applicable).
- Alternative Analysis Narrative.
- Details of chosen financial assurance method.
- Proof of Public Notification (if applicable).
- Name of existing collection and conveyance facilities.
- Name and NPDES number of existing treatment facility to serve proposed development.
- Plot plan of project with required information.
- Total sewage flows to facilities table.
- Signature of existing collection and/or conveyance Chapter 94 report preparer.
- Signature of existing treatment facility Chapter 94 report preparer.
- Letter granting allocation to project (if applicable).
- Signature acknowledging False Swearing Statement.
- Completed Component 4 (Planning Agency Review) for each existing planning agency and health department.
- Information on selected treatment and disposal option.
- Permeability information (if applicable).
- Preliminary hydrogeology (if applicable).
- Detailed hydrogeology (if applicable).

Municipal Action

- Component 3 (Sewage Collection and Treatment Facilities).
- Component 4 (Planning Agency Comments and Responses).
- Proof of Public Notification.
- Long-term operation and maintenance option selection.
- Comments, and responses to comments generated by public notification.
- Transmittal Letter

Signature of Municipal Official

Date submittal determined complete

SECTION 2.0

TRANSMITTAL LETTER & RESOLUTION

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF POINT AND NON-POINT SOURCE MANAGEMENT

**TRANSMITTAL LETTER
FOR SEWAGE FACILITIES PLANNING MODULE**

DEP USE ONLY				
DEP CODE #	APS ID #	CLIENT ID #	SITE ID #	AUTH. ID #

TO: Approving Agency (DEP or delegated local agency)
 PA DEP Bethlehem District Office
 4530 Bath Pike
 Bethlehem, PA 18017

Date 8/5/2016

Dear Sir:

Attached please find a completed Sewage Facilities Planning Module prepared by Elizabeth Helsel
 (Name)

RETTEW Associates, Inc. - Engineer for Tower 6
 (Title) (Name)

a subdivision, commercial, or industrial facility located in City of Allentown, Lehigh County.
 (City, Borough, Township)

Check one

- (i) The Planning Module, as prepared and submitted by the applicant, is approved by the municipality as a proposed revision supplement for new land development to its "Official Sewage Facilities Plan", and is adopted for submission to the Department of Environmental Protection transmitted to the delegated local agency for approval in accordance with the requirements of Chapter 71 and the Sewage Facilities Act, OR
- (ii) The Planning Module will not be approved by the municipality as a proposed revision or supplement for new land development to its "Official Sewage Facilities Plan" because the project described therein is unacceptable for the reason(s) checked below.

Check Boxes

- Additional studies are being performed by or on behalf of this municipality which may have an effect on the Planning Module as prepared and submitted by the applicant. Attached hereto is the scope of services to be performed and the time schedule for completion of said studies.
- The Planning Module as submitted by the applicant fails to meet limitations imposed by other laws or ordinances, officially adopted comprehensive plans and/or environmental plans (e.g., zoning, land use, Chapter 71). Specific reference or applicable segments of such laws or plans are attached hereto.
- Other (attach additional sheet giving specifics)

Municipal Secretary: Indicate below by checking appropriate boxes which components are being transmitted to the Approving Agency.

- Resolution of Adoption
- 2. Individual and Community Onlot Disposal of Sewage
- 2m. Sewage Management Program
- 3. Sewage Collection/Treatment Facilities
- 3s Small Flow Treatment Facilities
- 4.A. Municipal Planning Agency Review
- 4.B. County Planning Agency Review
- 4.C. County or Joint Health Department Review

Michael P. Hanton
 Municipal Secretary (print)

Michael P. Hanton
 Signature

Date

Note: Please remove and recycle the Instructions portion of the Sewage Facilities Planning Module prior to mailing the appropriate completed components and supporting documents to the approving agency.



DEP Code No.
2-39001189-3

RESOLUTION FOR PLAN REVISION FOR NEW LAND DEVELOPMENT

RESOLUTION OF THE (SUPERVISORS) (COMMISSIONERS) (**COUNCILMEN**) of Allentown
(TOWNSHIP) (BOROUGH) (**CITY**), Lehigh COUNTY, PENNSYLVANIA (hereinafter "the municipality").

WHEREAS Section 5 of the Act of January 24, 1966, P.L. 1535, No. 537, known as the "Pennsylvania Sewage Facilities Act", as Amended, and the rules and Regulations of the Pennsylvania Department of Environmental Protection (Department) adopted thereunder, Chapter 71 of Title 25 of the Pennsylvania Code, require the municipality to adopt an Official Sewage Facilities Plan providing for sewage services adequate to prevent contamination of waters of the Commonwealth and/or environmental health hazards from sewage wastes, and to revise said plan whenever it is necessary to determine whether a proposed method of sewage disposal for a new land development conforms to a comprehensive program of pollution control and water quality management, and

WHEREAS Serfass Construction Company has proposed the development of a parcel of land identified as
land developer

Tower 6, and described in the attached Sewage Facilities Planning Module, and
name of subdivision

proposes that such subdivision be served by: (check all that apply), sewer tap-ins, sewer extension, new treatment facility, individual onlot systems, community onlot systems, spray irrigation, retaining tanks, other, (please specify).

WHEREAS, City of Allentown finds that the subdivision described in the attached
municipality

Sewage Facilities Planning Module conforms to applicable sewage related zoning and other sewage related municipal ordinances and plans, and to a comprehensive program of pollution control and water quality management.

NOW, THEREFORE, BE IT RESOLVED that the (Supervisors) (Commissioners) (Councilmen) of the (Township) (Borough) (**City**) of Allentown hereby adopt and submit to the Department of Environmental Protection for its approval as a revision to the "Official Sewage Facilities Plan" of the municipality the above referenced Sewage Facilities Planning Module which is attached hereto.

I _____, Secretary,
(Signature)

Township Board of Supervisors (Borough Council) (City Councilmen), hereby certify that the foregoing is a true copy of the Township (Borough) (City) Resolution # _____, adopted, _____, 20_____.

Municipal Address:

Seal of
Governing Body

Telephone _____

SECTION 3.0

SEWAGE FACILITIES PLANNING MODULE COMPONENT 3

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF POINT AND NON-POINT SOURCE MANAGEMENT

Code No.
2-39001189-3

SEWAGE FACILITIES PLANNING MODULE

Component 3. Sewage Collection and Treatment Facilities

(Return completed module package to appropriate municipality)

DEP USE ONLY				
DEP CODE #	CLIENT ID #	SITE ID #	APS ID #	AUTH ID #

This planning module component is used to fulfill the planning requirements of Act 537 for the following types of projects: (1) a subdivision to be served by sewage collection, conveyance or treatment facilities, (2) a tap-in to an existing collection system with flows on a lot of 2 EDU's or more, or (3) the construction of, or modification to, wastewater collection, conveyance or treatment facilities that will require DEP to issue or modify a Clean Streams Law permit. Planning for any project that will require DEP to issue or modify a permit cannot be processed by a delegated agency. Delegated agencies must send their projects to DEP for final planning approval.

This component, along with any other documents specified in the cover letter, must be completed and submitted to the municipality with jurisdiction over the project site for review and approval. All required documentation must be attached for the Sewage Facilities Planning Module to be complete. Refer to the instructions for help in completing this component.

REVIEW FEES: Amendments to the Sewage Facilities Act established fees to be paid by the developer for review of planning modules for land development. These fees may vary depending on the approving agency for the project (DEP or delegated local agency). Please see section R and the instructions for more information on these fees.

NOTE: All projects must complete Sections A through I, and Sections O through R. Complete Sections J, K, L, M and/or N if applicable or marked .

A. PROJECT INFORMATION (See Section A of instructions)

- Project Name Tower 6
- Brief Project Description The project will consist of a multi-story office building with retail and office space.

B. CLIENT (MUNICIPALITY) INFORMATION (See Section B of instructions)

Municipality Name	County	City	Boro	Twp
Allentown	Lehigh	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Municipality Contact Individual - Last Name	First Name	MI	Suffix	Title
Messinger	Craig			Interim Director of Public Works
Additional Individual Last Name	First Name	MI	Suffix	Title
Municipality Mailing Address Line 1		Mailing Address Line 2		
641 South 10 th Street				
Address Last Line -- City		State	ZIP+4	
Allentown		PA	18103-3173	
Area Code + Phone + Ext.		FAX (optional)	Email (optional)	
(610) 437-7587			craig.messinger@allentownpa.gov	

C. SITE INFORMATION (See Section C of Instructions)

Site (Land Development or Project) Name

Tower 6

Site Location Line 1

SW corner of 6th Street and Hamilton Street intersection

Site Location Line 2

Site Location Last Line -- City

Allentown

State

PA

ZIP+4

18101

Latitude

40°36'9.40N

Longitude

75°28'12.03W

Detailed Written Directions to Site From US-22, take MacArthur Rd/ 145 S for approximately 1.8 miles. Take a left onto Hamilton Street. Destination is on the right in approximately 0.1 miles.

Description of Site Currently six contiguous buildings along Hamilton and 6th Streets.

Site Contact (Developer/Owner)

Last Name

Fenstermacher

First Name

Mattias

MI

Suffix

Phone

610-769-1100

Ext.

Site Contact Title

Owner

Site Contact Firm (if none, leave blank)

Serfass Construction Company

FAX

Email

mfenstermacher@serfassconstruction.com

Mailing Address Line 1

3764 Mauch Chunk Road

Mailing Address Line 2

Mailing Address Last Line -- City

Allentown

State

PA

ZIP+4

18104

D. PROJECT CONSULTANT INFORMATION (See Section D of instructions)

Last Name

Hesel

First Name

Elizabeth

MI

Suffix

Title

Engineer

Consulting Firm Name

RETTEW Associates, Inc.

Mailing Address Line 1

515 W. Hamilton

Mailing Address Line 2

Suite 508

Address Last Line -- City

Allentown

State

PA

ZIP+4

18101

Country

United States

Email

elizabeth.hesel@rettew.com

Area Code + Phone

484-778-4653

Ext.

Area Code + FAX

E. AVAILABILITY OF DRINKING WATER SUPPLY

The project will be provided with drinking water from the following source: (Check appropriate box)

- Individual wells or cisterns.
- A proposed public water supply.
- An existing public water supply.

If existing public water supply is to be used, provide the name of the water company and attach documentation from the water company stating that it will serve the project.

Name of water company: Lehigh County Authority

F. PROJECT NARRATIVE (See Section F of Instructions)

- A narrative has been prepared as described in Section F of the instructions and is attached.

The applicant may choose to include additional information beyond that required by Section F of the instructions.

G. PROPOSED WASTEWATER DISPOSAL FACILITIES (See Section G of instructions)

Check all boxes that apply, and provide information on collection, conveyance and treatment facilities and EDU's served. This information will be used to determine consistency with Chapter 93 (relating to wastewater treatment requirements).

1. COLLECTION SYSTEM

a. Check appropriate box concerning collection system

- New collection system Pump Station Force Main
 Grinder pump(s) Extension to existing collection system Expansion of existing facility

Clean Streams Law Permit Number _____

b. Answer questions below on collection system

Number of EDU's and proposed connections to be served by collection system. EDU's 16 DEP EDUs
(400 gpd/EDU); 36.70 City EDUs (175.5 gpd/EDU)

Connections 1

Name of:

existing collection or conveyance system City of Allentown
owner City of Allentown
existing interceptor Jordan Creek Interceptor
owner City of Allentown

2. WASTEWATER TREATMENT FACILITY

Check all boxes that apply, and provide information on collection, conveyance and treatment facilities and EDU's served. This information will be used to determine consistency with Chapter(s) 91 (relating to general provisions), 92 (relating to national Pollution Discharge Elimination System permitting, monitoring and compliance) and 93 (relating to water quality standards).

a. Check appropriate box and provide requested information concerning the treatment facility

- New facility Existing facility Upgrade of existing facility Expansion of existing facility

Name of existing facility City of Allentown Wastewater Treatment Plant

NPDES Permit Number for existing facility PA0026000

Clean Streams Law Permit Number _____

Location of discharge point for a new facility. Latitude 40°36'07" Longitude 75°27'09"

b. The following certification statement must be completed and signed by the wastewater treatment facility permittee or their representative.

As an authorized representative of the permittee, I confirm that the City of Allentown
(Name from above) sewage treatment facilities can accept sewage flows from this project without adversely affecting the facility's ability to achieve all applicable technology and water quality based effluent limits (see Section I) and conditions contained in the NPDES permit identified above.

Name of Permittee Agency, Authority, Municipality City of Allentown, Lehigh County Authority, Agent

Name of Responsible Agent Liesel M. Gross

Agent Signature Liesel M. Gross Date 7/21/2016

(Also see Section I. 4.)

G. PROPOSED WASTEWATER DISPOSAL FACILITIES (Continued)

3. PLOT PLAN

The following information is to be submitted on a plot plan of the proposed subdivision.

- a. Existing and proposed buildings.
- b. Lot lines and lot sizes.
- c. Adjacent lots.
- d. Remainder of tract.
- e. Existing and proposed sewerage facilities. Plot location of discharge point, land application field, spray field, COLDS, or LVCOLDS if a new facility is proposed.
- f. Show tap-in or extension to the point of connection to existing collection system (if applicable).
- g. Existing and proposed water supplies and surface water (wells, springs, ponds, streams, etc.)
- h. Existing and proposed rights-of-way.
- i. Existing and proposed buildings, streets, roadways, access roads, etc.
- j. Any designated recreational or open space area.
- k. Wetlands - from National Wetland Inventory Mapping and USGS Hydric Soils Mapping.
- l. Flood plains or Flood prone areas, floodways, (Federal Flood Insurance Mapping)
- m. Prime Agricultural Land.
- n. Any other facilities (pipelines, power lines, etc.)
- o. Orientation to north.
- p. Locations of all site testing activities (soil profile test pits, slope measurements, permeability test sites, background sampling, etc. (if applicable).
- q. Soils types and boundaries when a land based system is proposed.
- r. Topographic lines with elevations when a land based system is proposed

4. WETLAND PROTECTION

YES NO

- a. Are there wetlands in the project area? If yes, ensure these areas appear on the plot plan as shown in the mapping or through on-site delineation.
- b. Are there any construction activities (encroachments, or obstructions) proposed in, along, or through the wetlands? If yes, identify any proposed encroachments on wetlands and identify whether a General Permit or a full encroachment permit will be required. If a full permit is required, address time and cost impacts on the project. Note that wetland encroachments should be avoided where feasible. Also note that a feasible alternative **MUST BE SELECTED** to an identified encroachment on an exceptional value wetland as defined in Chapter 105. Identify any project impacts on streams classified as HQ or EV and address impacts of the permitting requirements of said encroachments on the project.

5. PRIME AGRICULTURAL LAND PROTECTION

YES NO

- Will the project involve the disturbance of prime agricultural lands?
If yes, coordinate with local officials to resolve any conflicts with the local prime agricultural land protection program. The project must be consistent with such municipal programs before the sewage facilities planning module package may be submitted to DEP.
If no, prime agricultural land protection is not a factor to this project.
- Have prime agricultural land protection issues been settled?

6. HISTORIC PRESERVATION ACT

YES NO

- Sufficient documentation is attached to confirm that this project is consistent with DEP Technical Guidance 012-0700-001 *Implementation of the PA State History Code* (available online at the DEP website at www.dep.state.pa.us, select "subject" then select "technical guidance"). As a minimum this includes copies of the completed Cultural Resources Notice (CRN), a return receipt for its submission to the PHMC and the PHMC review letter.

7. PROTECTION OF RARE, ENDANGERED OR THREATENED SPECIES

Check one:

- The "Pennsylvania Natural Diversity Inventory (PNDI) Project Environmental Review Receipt" resulting from my search of the PNDI database and all supporting documentation from jurisdictional agencies (when necessary) is/are attached.
- A completed "Pennsylvania Natural Diversity Inventory (PNDI) Project Planning & Environmental Review Form," (PNDI Form) available at www.naturalheritage.state.pa.us, and all required supporting documentation is attached. I request DEP staff to complete the required PNDI search for my project. I realize that my planning module will be considered incomplete upon submission to the Department and that the DEP review will not begin, and that processing of my planning module will be delayed, until a "PNDI Project Environmental Review Receipt" and all supporting documentation from jurisdictional agencies (when necessary) is/are received by DEP.

Applicant or Consultant Initials _____

H. ALTERNATIVE SEWAGE FACILITIES ANALYSIS (See Section H of instructions)

- An alternative sewage facilities analysis has been prepared as described in Section H of the attached instructions and is attached to this component.
The applicant may choose to include additional information beyond that required by Section H of the attached instructions.

I. COMPLIANCE WITH WATER QUALITY STANDARDS AND EFFLUENT LIMITATIONS (See Section I of instructions) (Check and complete all that apply.)

1. Waters designated for Special Protection

- The proposed project will result in a new or increased discharge into special protection waters as identified in Title 25, Pennsylvania Code, Chapter 93. The Social or Economic Justification (SEJ) required by Section 93.4c. is attached.

2. Pennsylvania Waters Designated As Impaired

- The proposed project will result in a new or increased discharge of a pollutant into waters that DEP has identified as being impaired by that pollutant. A pre-planning meeting was held with the appropriate DEP regional office staff to discuss water quality based discharge limitations.

3. Interstate and International Waters

- The proposed project will result in a new or increased discharge into interstate or international waters. A pre-planning meeting was held with the appropriate DEP regional office staff to discuss effluent limitations necessary to meet the requirements of the interstate or international compact.

4. Tributaries To The Chesapeake Bay

- The proposed project result in a new or increased discharge of sewage into a tributary to the Chesapeake Bay. This proposal for a new sewage treatment facility or new flows to an existing facility includes total nitrogen and total phosphorus in the following amounts: _____ pounds of TN per year, and _____ pounds of TP per year. Based on the process design and effluent limits, the total nitrogen treatment capacity of the wastewater treatment facility is _____ pounds per year and the total phosphorus capacity is _____ pounds per year as determined by the wastewater treatment facility permittee. The permittee has determined that the additional TN and TP to be contributed by this project (as modified by credits and/or offsets to be provided) will not cause the discharge to exceed the annual total mass limits for these parameters. Documentation of compliance with nutrient allocations is attached.

Name of Permittee Agency, Authority, Municipality _____

Initials of Responsible Agent (See Section G 2.b) _____

See *Special Instructions* (Form 3800-FM-BPNPSM0353-1) for additional information on Chesapeake Bay watershed requirements.

J. CHAPTER 94 CONSISTENCY DETERMINATION (See Section J of Instructions)

Projects that propose the use of existing municipal collection, conveyance or wastewater treatment facilities, or the construction of collection and conveyance facilities to be served by existing municipal wastewater treatment facilities must be consistent with the requirements of Title 25, Chapter 94 (relating to Municipal Wasteload Management). If not previously included in Section F, include a general map showing the path of the sewage to the treatment facility. If more than one municipality or authority will be affected by the project, please obtain the information required in this section for each. Additional sheets may be attached for this purpose.

1. Project Flows 6,440 gpd
2. Total Sewage Flows to Facilities (pathway from point of origin through treatment plant)

When providing "treatment facilities" sewage flows, use Annual Average Daily Flow for "average" and Maximum Monthly Average Daily Flow for "peak" in all cases. For "peak flows" in "collection" and "conveyance" facilities, indicate whether these flows are "peak hourly flow" or "peak instantaneous flow" and how this figure was derived (i.e., metered, measured, estimated, etc.).

- a. Enter average and peak sewage flows for each proposed or existing facility as designed or permitted.
- b. Enter the average and peak sewage flows for the most restrictive sections of the existing sewage facilities.
- c. Enter the average and peak sewage flows, projected for 5 years (2 years for pump stations) through the most restrictive sections of the existing sewage facilities. Include existing, proposed (this project) and future project (other approved projects) flows.

To complete the table, refer to the instructions, Section J.

	a. Design and/or Permitted Capacity (gpd) MGD		b. Present Flows (gpd) MGD		c. Projected Flows in 5 years (gpd) MGD (2 years for P.S.)	
	Average	Peak	Average	Peak	Average	Peak
Collection	0.44	1.77	0.11	0.41	0.11	0.43
Conveyance	58	81	30	78 ⁽¹⁾	31	80 ⁽¹⁾
Treatment	40	52	32.3	40	33.4	42

3. Collection and Conveyance Facilities (1) PEAK HOURLY FLOW - ESTIMATED

The questions below are to be answered by the sewer authority, municipality, or agency responsible for completing the Chapter 94 report for the collection and conveyance facilities. These questions should be answered in coordination with the latest Chapter 94 annual report and the above table. The individual(s) signing below must be legally authorized to make representation for the organization:

YES NO

- a. YES NO This project proposes sewer extensions or tap-ins. Will these actions create a hydraulic overload within five years on any existing collection or conveyance facilities that are part of the system?

If yes, this sewage facilities planning module will not be accepted for review by the municipality, delegated local agency and/or DEP until all inconsistencies with Chapter 94 are resolved or unless there is an approved Corrective Action Plan (CAP) granting an allocation for this project. A letter granting allocations to this project under the CAP must be attached to the module package.

If no, a representative of the sewer authority, municipality, or agency responsible for completing the Chapter 94 report for the collection and conveyance facilities must sign below to indicate that the collection and conveyance facilities have adequate capacity and are able to provide service to the proposed development in accordance with both §71.53(d)(3) and Chapter 94 requirements and that this proposal will not affect that status.

b. Collection System

Name of Agency, Authority, Municipality City of Allentown, Lehigh County Authority, Agent

Name of Responsible Agent Liesel M. Gross

Agent Signature *Liesel M. Gross* Date 7/21/2010

J. CHAPTER 94 CONSISTENCY DETERMINATION (See Section J of instructions)

c. Conveyance System

Name of Agency, Authority, Municipality City of Allentown, Lehigh County Authority, Agent

Name of Responsible Agent Liesel M. Gross

Agent Signature *Liesel M. Gross*

Date 7/21/2016

4. Treatment Facility

The questions below are to be answered by a representative of the facility permittee in coordination with the information in the table and the latest Chapter 94 report. The individual signing below must be legally authorized to make representation for the organization.

YES NO

- a. This project proposes the use of an existing wastewater treatment plant for the disposal of sewage. Will this action create a hydraulic or organic overload within 5 years at that facility?

If yes, this planning module for sewage facilities will not be reviewed by the municipality, delegated local agency and/or DEP until this inconsistency with Chapter 94 is resolved or unless there is an approved CAP granting an allocation for this project. A letter granting allocations to this project under the CAP must be attached to the planning module.

If no, the treatment facility permittee must sign below to indicate that this facility has adequate treatment capacity and is able to provide wastewater treatment services for the proposed development in accordance with both §71.53(d)(3) and Chapter 94 requirements and that this proposal will not impact that status.

- b. Name of Agency, Authority, Municipality City of Allentown, Lehigh County Authority, Agent

Name of Responsible Agent Liesel M. Gross

Agent Signature *Liesel M. Gross*

Date 7/21/2016

K. TREATMENT AND DISPOSAL OPTIONS (See Section K of instructions)

This section is for land development projects that propose construction of wastewater treatment facilities. Please note that, since these projects require permits issued by DEP, these projects may **NOT** receive final planning approval from a delegated local agency. Delegated local agencies must send these projects to DEP for final planning approval.

Check the appropriate box indicating the selected treatment and disposal option.

- 1. Spray irrigation (other than individual residential spray systems (IRSIS)) or other land application is proposed, and the information requested in Section K.1. of the planning module instructions are attached.
- 2. Recycle and reuse is proposed and the information requested in Section K-2 of the planning module instructions is attached.
- 3. A discharge to a dry stream channel is proposed, and the information requested in Section K.3. of the planning module instructions are attached.
- 4. A discharge to a perennial surface water body is proposed, and the information requested in Section K.4. of the planning module instructions are attached.

L. PERMEABILITY TESTING (See Section L of instructions)

- The information required in Section L of the instructions is attached.

M. PRELIMINARY HYDROGEOLOGIC STUDY (See Section M of instructions)

- The information required in Section M of the instructions is attached.

N. DETAILED HYDROGEOLOGIC STUDY (See Section N of instructions)

The detailed hydrogeologic information required in Section N. of the Instructions is attached.

O. SEWAGE MANAGEMENT (See Section O of instructions)

(1-3 for completion by the developer(project sponser), 4-5 for completion by the non-municipal facility agent and 6 for completion by the municipality)

Yes No

1. Is connection to, or construction of, a DEP permitted, non-municipal sewage facility or a local agency permitted, community onlot sewage facility proposed.

If Yes, respond to the following questions, attach the supporting analysis, and an evaluation of the options available to assure long-term proper operation and maintenance of the proposed non-municipal facilities. If No, skip the remainder of Section O.

2. Project Flows _____ gpd

Yes No

3. Is the use of nutrient credits or offsets a part of this project?

If yes, attach a letter of intent to purchase the necessary credits and describe the assurance that these credits and offsets will be available for the remaining design life of the non-municipal sewage facility;

(For completion by non-municipal facility agent)

4. Collection and Conveyance Facilities

The questions below are to be answered by the organization/individual responsible for the non-municipal collection and conveyance facilities. The individual(s) signing below must be legally authorized to make representation for the organization.

Yes No

- a. If this project proposes sewer extensions or tap-ins, will these actions create a hydraulic overload on any existing collection or conveyance facilities that are part of the system?

If yes, this sewage facilities planning module will not be accepted for review by the municipality, delegated local agency and/or DEP until this issue is resolved.

If no, a representative of the organization responsible for the collection and conveyance facilities must sign below to indicate that the collection and conveyance facilities have adequate capacity and are able to provide service to the proposed development in accordance with Chapter 71 §71.53(d)(3) and that this proposal will not affect that status.

- b. Collection System

Name of Responsible Organization _____

Name of Responsible Agent _____

Agent Signature _____

Date _____

- c. Conveyance System

Name of Responsible Organization _____

Name of Responsible Agent _____

Agent Signature _____

Date _____

5. Treatment Facility

The questions below are to be answered by a representative of the facility permittee. The individual signing below must be legally authorized to make representation for the organization.

Yes No

- a. If this project proposes the use of an existing non-municipal wastewater treatment plant for the disposal of sewage, will this action create a hydraulic or organic overload at that facility?

If yes, this planning module for sewage facilities will not be reviewed by the municipality, delegated local agency and/or DEP until this issue is resolved.

If no, the treatment facility permittee must sign below to indicate that this facility has adequate treatment capacity and is able to provide wastewater treatment services for the proposed development in accordance with §71.53(d)(3) and that this proposal will not impact that status.

- b. Name of Facility _____
Name of Responsible Agent _____
Agent Signature _____
Date _____

(For completion by the municipality)

6. The **SELECTED OPTION** necessary to assure long-term proper operation and maintenance of the proposed non-municipal facilities is clearly identified with documentation attached in the planning module package.

P. PUBLIC NOTIFICATION REQUIREMENT (See Section P of Instructions)

This section must be completed to determine if the applicant will be required to publish facts about the project in a newspaper of general circulation to provide a chance for the general public to comment on proposed new land development projects. This notice may be provided by the applicant or the applicant's agent, the municipality or the local agency by publication in a newspaper of general circulation within the municipality affected. Where an applicant or an applicant's agent provides the required notice for publication, the applicant or applicant's agent shall notify the municipality or local agency and the municipality and local agency will be relieved of the obligation to publish. The required content of the publication notice is found in Section P of the instructions.

To complete this section, each of the following questions must be answered with a "yes" or "no". Newspaper publication is required if any of the following are answered "yes".

Yes No

1. Does the project propose the construction of a sewage treatment facility?
2. Will the project change the flow at an existing sewage treatment facility by more than 50,000 gallons per day?
3. Will the project result in a public expenditure for the sewage facilities portion of the project in excess of \$100,000?
4. Will the project lead to a major modification of the existing municipal administrative organizations within the municipal government?
5. Will the project require the establishment of *new* municipal administrative organizations within the municipal government?
6. Will the project result in a subdivision of 50 lots or more? (onlot sewage disposal only)
7. Does the project involve a major change in established growth projections?
8. Does the project involve a different land use pattern than that established in the municipality's Official Sewage Plan?

P. PUBLIC NOTIFICATION REQUIREMENT cont'd. (See Section P of instructions)

9. Does the project involve the use of large volume onlot sewage disposal systems (Flow > 10,000 gpd)?
10. Does the project require resolution of a conflict between the proposed alternative and consistency requirements contained in §71.21(a)(5)(i), (ii), (iii)?
11. Will sewage facilities discharge into high quality or exceptional value waters?
- Attached is a copy of:
- the public notice,
- all comments received as a result of the notice,
- the municipal response to these comments.
- No comments were received. A copy of the public notice is attached.

Q. FALSE SWEARING STATEMENT (See Section Q of instructions)

I verify that the statements made in this component are true and correct to the best of my knowledge, information and belief. I understand that false statements in this component are made subject to the penalties of 18 PA C.S.A. §4904 relating to unsworn falsification to authorities.

Elizabeth Helsel

Name (Print)

Engineer

Title

515 W. Hamilton Street, Suite 508, Allentown, PA 18101

Address

484-778-4653

Telephone Number

Elizabeth Helsel
8/5/16

Signature

Date

R. REVIEW FEE (See Section R of instructions)

The Sewage Facilities Act establishes a fee for the DEP planning module review. DEP will calculate the review fee for the project and invoice the project sponsor **OR** the project sponsor may attach a self-calculated fee payment to the planning module prior to submission of the planning package to DEP. (Since the fee and fee collection procedures may vary if a "delegated local agency" is conducting the review, the project sponsor should contact the "delegated local agency" to determine these details.) Check the appropriate box.

- I request DEP calculate the review fee for my project and send me an invoice for the correct amount. I understand DEP's review of my project will not begin until DEP receives the correct review fee from me for the project.
- I have calculated the review fee for my project using the formula found below and the review fee guidance in the instructions. I have attached a check or money order in the amount of \$800 payable to "Commonwealth of PA, DEP". Include DEP code number on check. I understand DEP will not begin review of my project unless it receives the fee and determines the fee is correct. If the fee is incorrect, DEP will return my check or money order, send me an invoice for the correct amount. I understand DEP review will NOT begin until I have submitted the correct fee.
- I request to be exempt from the DEP planning module review fee because this planning module creates **only** one new lot and is the **only** lot subdivided from a parcel of land as that land existed on December 14, 1995. I realize that subdivision of a second lot from this parcel of land shall disqualify me from this review fee exemption. I am furnishing the following deed reference information in support of my fee exemption.

County Recorder of Deeds for _____ County, Pennsylvania

Deed Volume _____ Book Number _____

Page Number _____ Date Recorded _____

R. REVIEW FEE (continued)

Formula:

1. For a new collection system (with or without a Clean Streams Law Permit), a collection system extension, or individual tap-ins to an existing collection system use this formula.

$$\#16 \quad \text{Lots (or EDUs)} \times \$50.00 = \$ 800$$

The fee is based upon:

- The number of lots created or number of EDUs whichever is higher.
 - For community sewer system projects, one EDU is equal to a sewage flow of 400 gallons per day.
2. For a surface or subsurface discharge system, use the appropriate one of these formulae.

- A. A new surface discharge greater than 2000 gpd will use a flat fee:

\$ 1,500 per submittal (non-municipal)
\$ 500 per submittal (municipal)

- B. An increase in an existing surface discharge will use:

$$\# \quad \text{Lots (or EDUs)} \times \$35.00 = \$$$

to a maximum of \$ 1,500 per submittal (non-municipal) or \$ 500 per submittal (municipal)

The fee is based upon:

- The number of lots created or number of EDUs whichever is higher.
 - For community sewage system projects one EDU is equal to a sewage flow of 400 gallons per day.
 - For non-single family residential projects, EDUs are calculated using projected population figures
- C. A sub-surface discharge system that requires a permit under The Clean Streams Law will use a flat fee:

\$ 1,500 per submittal (non-municipal)
\$ 500 per submittal (municipal)

SECTION 3.1

LEHIGH COUNTY AUTHORITY – WATER CAPACITY LETTER

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



LEHIGH COUNTY AUTHORITY

1053 SPRUCE STREET • P.O. BOX 3348 • ALLENTOWN, PA 18106-0348
610-398-2503 • FAX 610-398-8413
email: service@lehighcountyauthority.org

June 2, 2016

Ms. Shannon Callouri, Director of Planning
City of Allentown Planning Commission
435 Hamilton Street, 4th Floor
Allentown, PA 18101

RECEIVED

JUN 06 2016

SUBJECT: Tower Six
Sixth & Hamilton Streets
City of Allentown, Lehigh County, PA
Water Service

ALLENTOWN

Dear Ms. Callouri:

Lehigh County Authority (LCA) is willing to provide public water service to serve 183,489 square feet of office and retail space proposed to be constructed at the southwest corner of Sixth Street and Hamilton Street in Allentown, PA. Water usage is estimated to be 5,853 gallons per day.

Water service is conditioned upon the following:

1. LCA written approval of the site, plumbing and fire protection system plans, as applicable. Plans shall be submitted in a timely manner to avoid delays in the project.
2. Developer obtaining all permits from the municipality and PA-DOT, as applicable, to construct the water service.
3. Developer executing a Construction Permit with LCA for construction of the public portion of the water service.
4. Developer installation of the water service in accordance with the approved plans and applicable LCA policies and regulations, including the current General Specifications for Water System Construction.
5. Developer compliance with the terms and conditions of LCA's Rules and Regulations for Water Service, including completion of an Application for Water Service and payment of applicable connection fees.

Sincerely,

Edward L. Hoyle, Jr., P.E.
Chief Engineer

Cc: Charles Myers, Rettew Associates, Inc.

Every drop matters. Every customer counts.

SECTION 3.2

LEHIGH COUNTY AUTHORITY – SEWER CAPACITY LETTER

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



LEHIGH COUNTY AUTHORITY

1053 SPRUCE STREET • P.O. BOX 3348 • ALLENTOWN, PA 18106-0348
610-398-2503 • FAX 610-398-8413
email: service@lehighcountyauthority.org

June 27, 2016

Shannon Calluori
Director of Planning, City of Allentown
435 Hamilton Street
Allentown, PA 18101

SUBJECT: Tower Six
City of Allentown, Lehigh County, PA
Public Sewerage Service - Will Serve Letter

RECEIVED
JUL 05 2016
ALLENTOWN

Dear Ms. Calluori:

Lehigh County Authority (LCA) is willing to provide public sewerage service in the requested amount of 6,440 GPD to the proposed office building with office and retail space located at the southwest corner of 6th Street and Hamilton Street in the city.

Sewer service is conditioned upon the following:

1. The developer obtaining approval of a PA-DEP Sewage Facilities Planning Module.
2. LCA approval of developer-prepared sewer system plans.
3. Issuance of a LCA construction permit and developer's adherence to the terms and conditions as specified therein.
4. Developer obtaining all permits needed to construct the sewer lateral. This includes any construction and road-opening permits issued by LCA, the municipality, or PennDOT.
5. Developer installation of the sewer lateral in accordance with the approved plans and applicable LCA policies and regulations.
6. Developer compliance with the terms and conditions of LCA's Rules and Regulations for Sewerage Service, including completion of an Application for Sewer Service and payment of applicable connection fees.

Sincerely,

Edward L. Hoyle, Jr., P.E.
Chief Engineer

Cc: Charles Myers, Rettew Associates, Inc.

SECTION 3.3

PROJECT NARRATIVE

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

TOWER SIX SERFASS CONSTRUCTION COMPANY

City of Allentown
Lehigh County, Pennsylvania

Project Narrative

Serfass Construction Company is proposing the development of Tower 6 which is on approximately 0.36 acres. The proposed property is located at the southwest corner of the 6th Street and Hamilton Street intersection in Allentown, Pennsylvania. The project will consist of a multi-story office building with retail and office space.

Based on flow estimates found in Allentown's Codified Ordinance for Sewer (Article 947.04) and using Allentown's Equivalent Dwelling Unit (EDU) rate of 175.5 gpd/EDU, the estimated sewer flow for the project is 6,440.46 gallons per day, or 36.70 City EDUs (16 DEP EDUs at 400 gpd/EDU).


Description	SF	EDU/SF	EDUs	Gallons Per Day
Retail Space	15,029	0.0002	3.01	527.52
Office/ Mechanical Space	168,460	0.0002	33.69	5,912.95
TOTAL:	183,489		36.70	6,440.46

Anticipated wastewater will be conveyed to Lehigh County Authority's sewer line located along South 6th Street. The final wastewater treatment will take place at the City of Allentown Wastewater Treatment Plant. Water will also be provided by the Lehigh County Authority.

SECTION 3.4

USGS LOCATION MAP

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

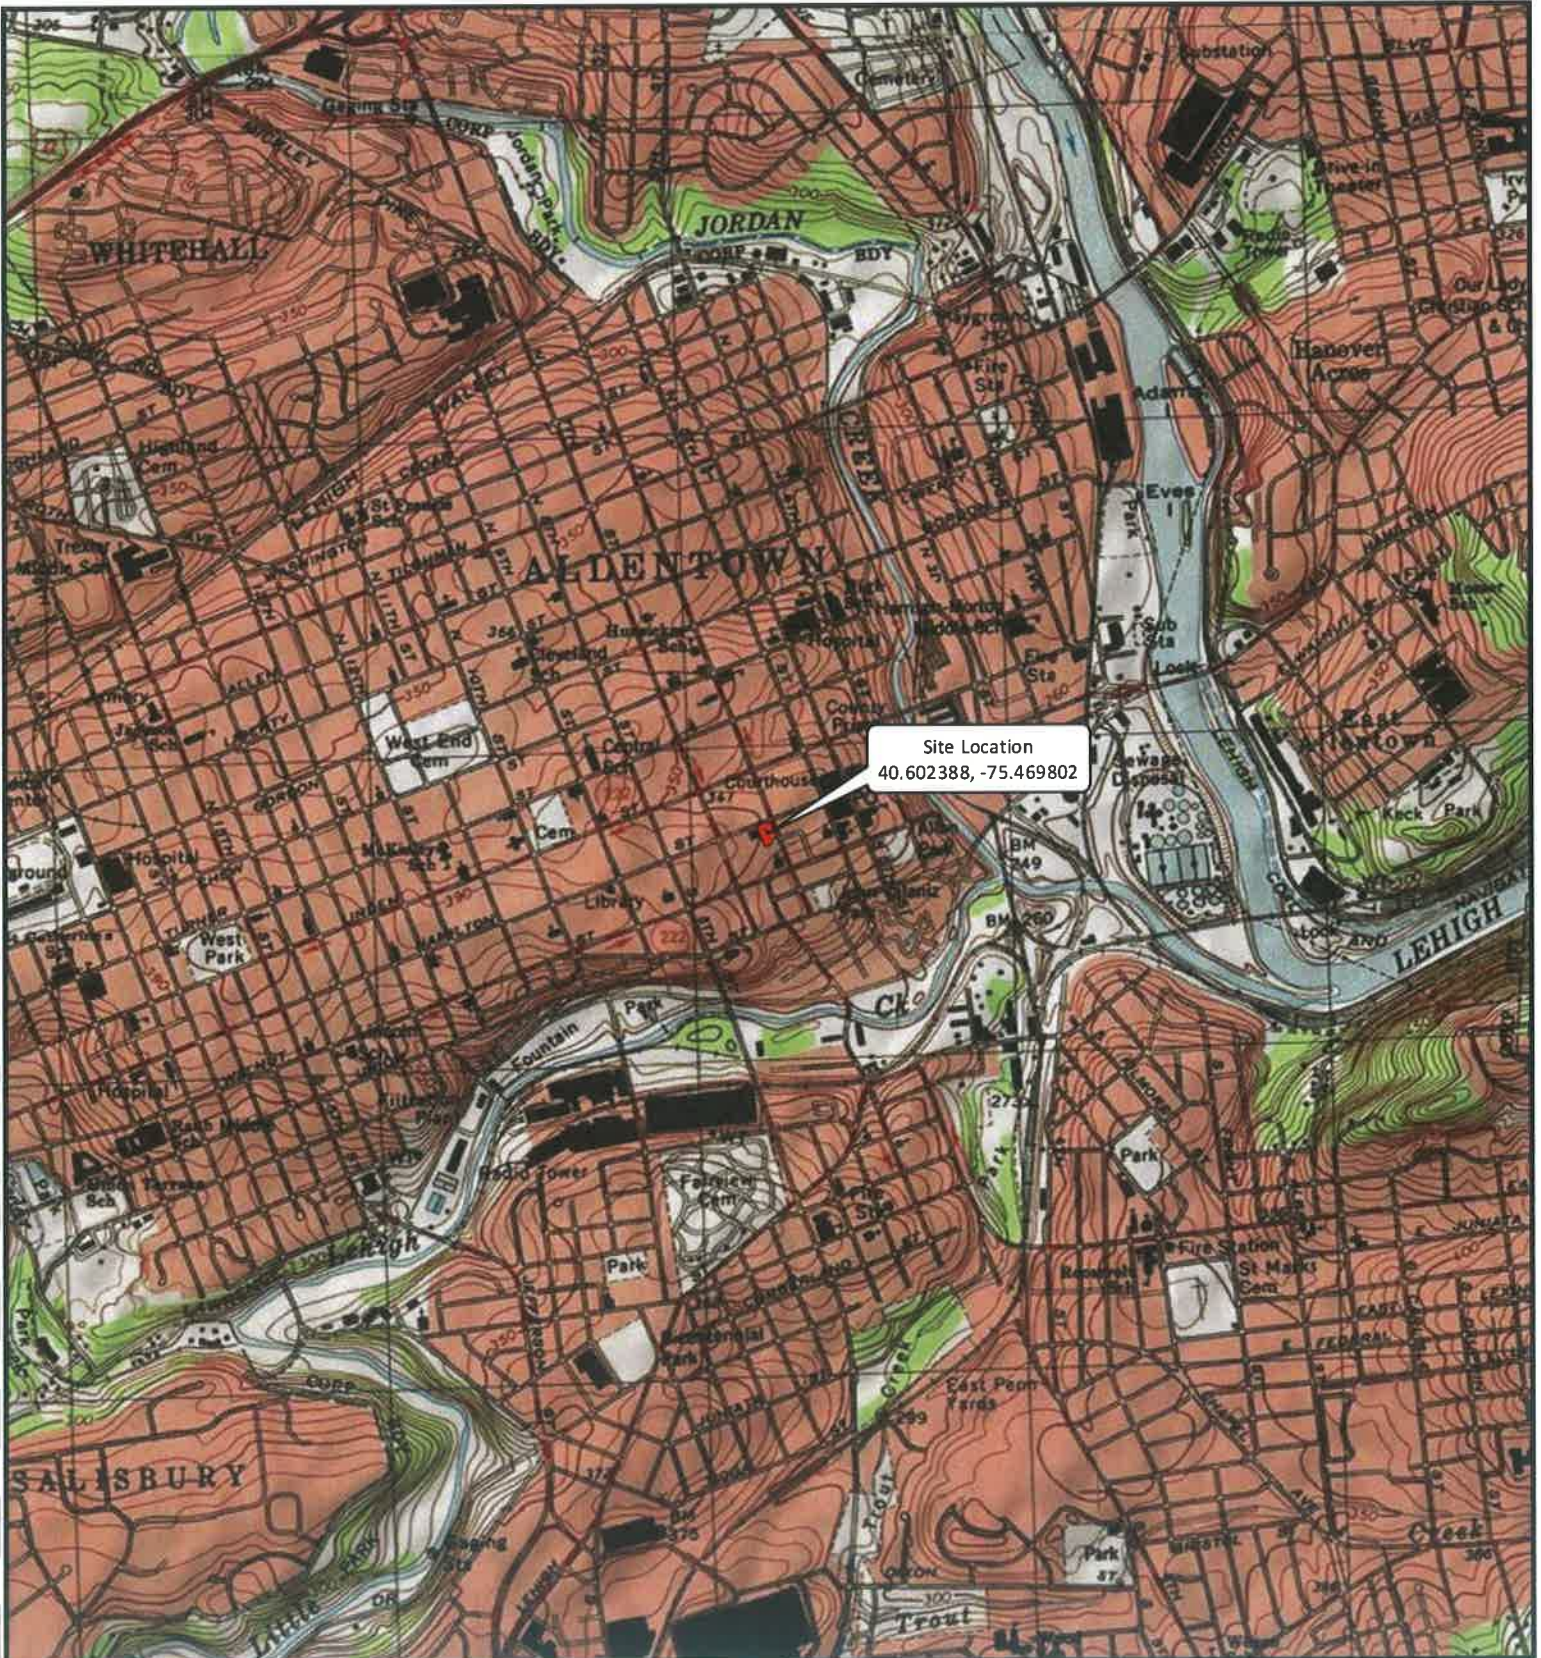

Site Location
40.602388, -75.469802

 Site Boundary

Serfass Construction Company

Tower 6

Figure 1 - Site Location Map

Project No. 106092000



RETTEW

SECTION 3.5

PLOT PLAN

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

SURVEY NOTES

- BENCHMARK: MASONRY NAIL SET IN THE CONCRETE SIDEWALK AT THE NORTHEAST INTERSECTION W. HAMILTON STREET AND S. SIXTH STREET, NAVD 1988 ELEVATION=347.69'
- BASIS OF SURVEY IS PA STATE PLANE COORDINATE SYSTEM SOUTH ZONE, NAD83 (2011), BASED ON PRIOR SURVEY CONTROL SET BY RETIEW ASSOCIATES, INC.
- THE PROPERTIES SHOWN ON THIS PLAN ARE SUBJECT TO ANY EASEMENTS, RIGHT-OF-WAYS, RESTRICTIONS, EXCEPTIONS, OR OTHER ENCUMBRANCES AS MAY BE DISCOVERED THROUGH TITLE SEARCHES. TITLE SEARCHES WERE NOT AVAILABLE AS OF THE DATE OF THIS PLAN.
- UNDERGROUND UTILITY LOCATIONS ARE APPROXIMATE AND WERE DETERMINED FROM VISIBLE LOCATION, ACT 187 UTILITY RESPONSES AND/OR BEST AVAILABLE PLAN INFORMATION (RETIEW CANNOT GUARANTEE THE EXACT LOCATION OF ANY UNDERGROUND UTILITIES OR STRUCTURES. AN EXACT LOCATION CAN ONLY BE OBTAINED BY SUBSURFACE EXPLORATION, WHICH IS NOT A PART OF THIS CONTRACT PERFORMANCE).
- NO RECENT UTILITY MARKINGS WERE PRESENT AT THE TIME OF SURVEY.
- EXISTING FEATURES SHOWN HEREON ARE BASED ON A SURVEY PERFORMED BY RETIEW ASSOCIATES, INC., COMPLETED IN APRIL 2016.

MAP REFERENCES

- "FINAL MINOR SUBDIVISION PLAN LOT CONSOLIDATION PLAN SCHOENS ALLENTOWN LLC", PREPARED BY ARTHUR A SWALLOW ASSOCIATES, LAST REVISED 10/09/13 AND FILED IN THE LEHIGH COUNTY RECORDER OF DEEDS OFFICE AS INSTRUMENT #2013038915
- "PRELIMINARY/FINAL MAJOR LAND DEVELOPMENT PLAN FOR COMMUNITY LOT PARKING GARAGE WARD Z", PREPARED BY MASER CONSULTING PA, DATED 8/12/14 AND RECORDED IN THE LEHIGH COUNTY RECORDER OF DEEDS OFFICE AS INSTRUMENT #2015002105
- WATER AND SEWER PLANS PROVIDED TO RETIEW ASSOCIATES BY THE CITY OF ALLENTOWN ENGINEERING DEPARTMENT.

NOTES

- DISCONNECTION OF ELECTRIC, GAS, WATER, SANITARY SEWER, AND ALL OTHER UTILITY SERVICES SHALL BE DISCONNECTED IN ACCORDANCE WITH THE REQUIREMENTS OF EACH UTILITY PROVIDER.
- DISCONNECT AND CAP ALL EXISTING SANITARY SEWER LATERALS AT THE MAIN OR MANHOLE IN ACCORDANCE WITH THE CITY OF ALLENTOWN REQUIREMENTS.
- EROSION AND SEDIMENT CONTROL MEASURES MUST BE IN PLACE AND FUNCTIONING PRIOR TO DEMOLITION AND EARTH DISTURBANCE ACTIVITY. SEE EROSION AND SEDIMENT CONTROL PLAN AND DETAILS.

CONSTRUCTION NOTES


- REPLACE SIDEWALK ALONG W HAMILTON STREET FRONTAGE, MATCH EXISTING MATERIALS AND PATTERNS. EXISTING CURB AND PLANTER TO REMAIN. THREE TREES TO BE REMOVED AND REPLACED. ADA RAMP TO REMAIN.
- EXISTING CISTERN TO BE ABANDONED. COORDINATE WITH CITY OF ALLENTOWN.
- INSTALL TEMPORARY INLET PROTECTION AT THE UPSTREAM INLET ON S. SIXTH STREET AT THE INTERSECTION WITH WALNUT STREET (NOT SHOWN ON PLAN).

LEGEND

EXISTING BOUNDARY LINE	PROPOSED CURB
EXISTING RIGHT-OF-WAY LINE	PROPOSED FENCE
EXISTING EASEMENT LINE	PROPOSED CONTOUR LINE
EXISTING SETBACK LINE	PROPOSED WATER LINE
EXISTING CURB	PROPOSED SANITARY SEWER LINE
EXISTING PAVEMENT	PROPOSED STORM MANHOLE
EXISTING VEGETATION	PROPOSED STORM INLET
	PROPOSED STORM PIPE
	NPDES BOUNDARY
	LIMITS OF DISTURBANCE
	TEMPORARY INLET PROTECTION
	FILTREX SILT SOX
	TEMPORARY ROCK CONSTRUCTION ENTRANCE
	TO BE REMOVED
	BUILDING TO BE RAZED
	SIDEWALK, CURB & PAVEMENT REMOVAL

Type Street

S. Sixth Street
(Variable Width R.O.W.)

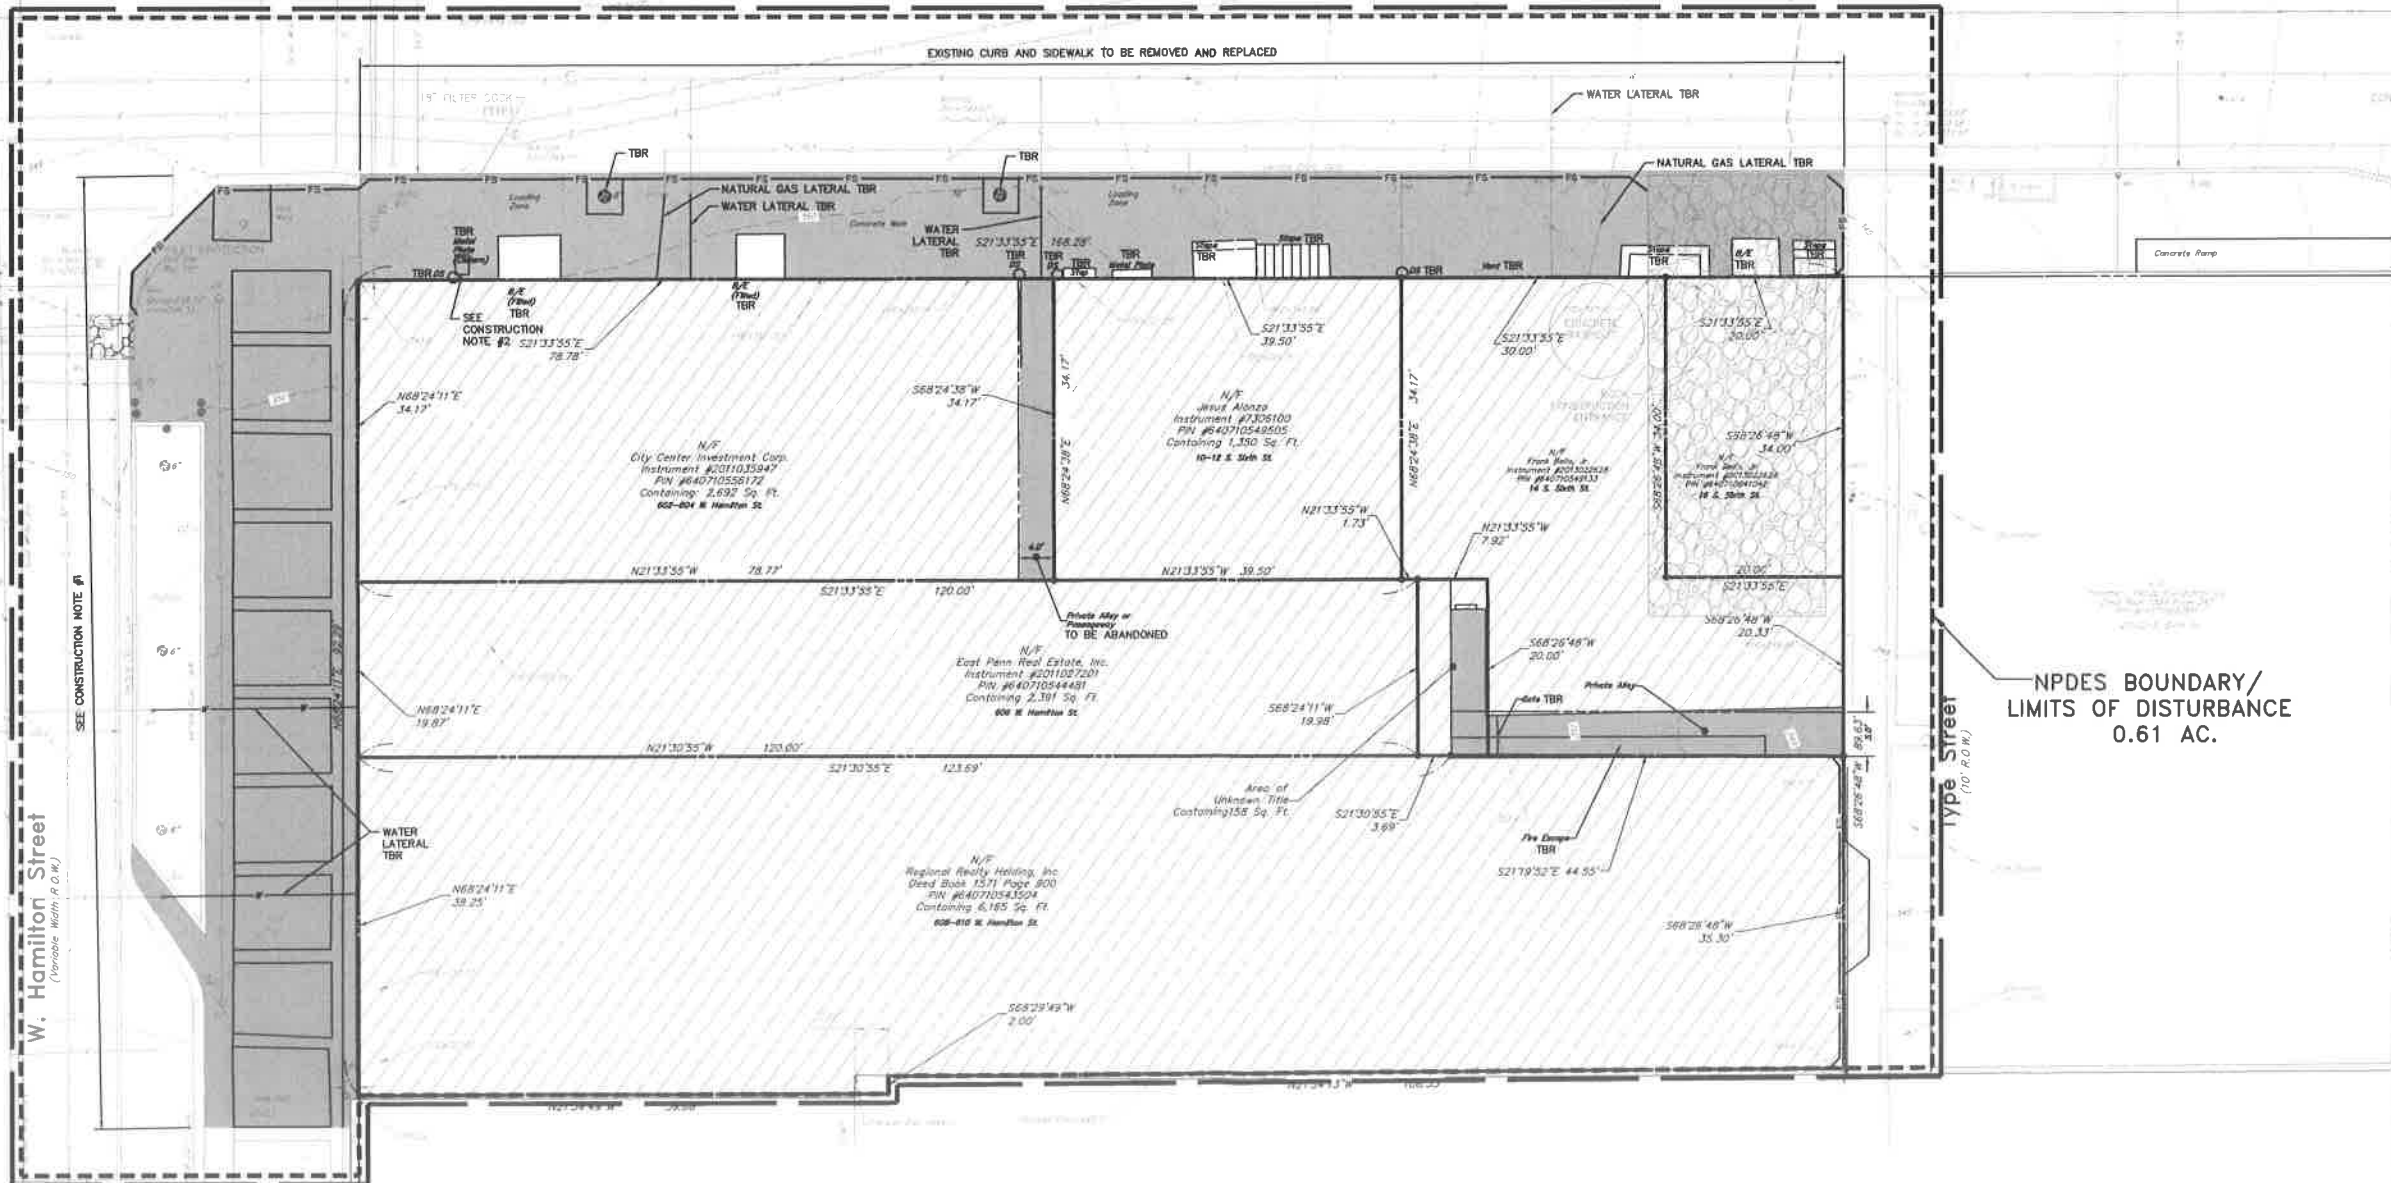

NPDES BOUNDARY/
LIMITS OF DISTURBANCE
0.61 AC.

W. Hamilton Street
(Variable Width R.O.W.)

W. Maple Street

FOR RETIEW ASSOCIATES BY:		MANAGER: DAVID MILLER, P.E.
CLIENT:		DESIGN BY: DDM
CITY CENTER INVESTMENT CORP. 645 HAMILTON STREET, SUITE 600 ALLENTOWN, PA 18101		FIELDBOOK NO. DAIR COLLIER
CITYCENTER		CHKD BY: DDM
SURV. CHIEF:		ASIN
DRAWN BY:		DDM
DRAWING REFERENCE:		NO
DATE:		DATE
1 06/10/16		1 06/10/16
INCLUDE BELLO PROPERTIES		NO
DAVID D. MILLER		NO
PA LIC # PE-054960-E		NO
REVISION		NO

RETIEW
RETIEW Associates, Inc.
515 Hamilton Street, Ste 500, Allentown, PA 18101
Phone (610) 866-8330 • Fax (610) 240-4325
Website: www.retiew.com

Engineers • Planners • Surveyors • Landscape Architects
Government Consultants

EXISTING CONDITIONS/DEMOLITION PLAN
FINAL LAND DEVELOPMENT PLAN
FOR
TOWER SIX

CITY OF ALLENTOWN, 2ND WARD
LEHIGH COUNTY, PA

DATE: MAY 24, 2016
SHEET NO. C-02 of 14
DWG NO. 106092000

PROOF OF RECORDING

PLAN RECORDED IN THE OFFICE OF THE RECORDER OF DEEDS OF LEHIGH COUNTY, PENNSYLVANIA.

IN DOCKET ID # _____, ON THE _____ DAY OF _____, 20____.
 WITNESS MY HAND AND SEAL OF OFFICE THIS _____ DAY OF _____, 20____.

WITNESS: _____
 RECORDER OF DEEDS

PLANNING COMMISSION APPROVAL

THE WITHIN PLOT OR PLAN LOCATED IN THE CITY OF ALLENTOWN, LEHIGH COUNTY, PENNSYLVANIA, WAS APPROVED BY THE ALLENTOWN CITY PLANNING COMMISSION.

CHAIRMAN _____ DATE _____

PLANNING DIRECTOR _____ DATE _____

SECRETARY _____ DATE _____

APPROVED: _____

CITY ENGINEER _____ DATE _____

APPLICANT

CITY CENTER INVESTMENT CORP.
 645 HAMILTON STREET, SUITE 600
 ALLENTOWN, PA 18101

SOURCE OF TITLE

- | | |
|---|---|
| (A) CITY CENTER INVESTMENT CORPORATION
PIN #640710556172
INS #2011035947
CONTAINING 2,692 S.F. | (D) REGIONAL REALTY HOLDING, INC.
PIN #640710543504
CONTAINING 6,165 S.F. |
| (B) JESUS ALONZO
PIN #640710549505
INS #7308100
CONTAINING 1,350 S.F. | (E) FRANK BELLO, JR.
PIN #640710549133
CONTAINING 1,958 S.F. |
| (C) EAST PENN REAL ESTATE, INC.
PIN #640710544481
INS #2011027201
CONTAINING 2,391 S.F. | (F) FRANK BELLO, JR.
PIN #640710641042
CONTAINING 680 S.F. |

STREET ADDRESS

TO BE DESIGNATED

CERTIFICATION OF LEHIGH VALLEY PLANNING COMMISSION

REVIEWED BY THE LEHIGH VALLEY PLANNING COMMISSION


PLANNER _____ DATE _____

ZONING DATA

	REQUIRED	EXISTING	PROPOSED
(A) MINIMUM LOT AREA	2,000 S.F.	2,692 S.F.	15,274 S.F.
(A) MINIMUM LOT WIDTH	20 FT.	78.78 FT.	168.28 FT.
(B) MINIMUM LOT AREA	2,000 S.F.	1,350 S.F.	39.50 FT.
(B) MINIMUM LOT WIDTH	20 FT.	39.50 FT.	
(C) MINIMUM LOT AREA	2,000 S.F.	2,391 S.F.	19.87 FT.
(C) MINIMUM LOT WIDTH	20 FT.	19.87 FT.	
(D) MINIMUM LOT AREA	2,000 S.F.	6,165 S.F.	38.25 FT.
(D) MINIMUM LOT WIDTH	20 FT.	38.25 FT.	
(E) MINIMUM LOT AREA	2,000 S.F.	1,996 S.F.	30.00 FT.
(E) MINIMUM LOT WIDTH	20 FT.	30.00 FT.	
(F) MINIMUM LOT AREA	2,000 S.F.	680 S.F.	20.00 FT.
(F) MINIMUM LOT WIDTH	20 FT.	20.00 FT.	

PROPERTY KEY MAP

PROPOSED CONDITION



IN THE B-2 DISTRICT, THERE ARE NO REGULATIONS OF YARD DIMENSIONS, HEIGHT RESTRICTIONS, OR BUILDING COVERAGE.

TND0 FRONT YARD SETBACKS (ART. 13.14.02):
 HAMILTON STREET = 0 FEET REQUIRED, 0 FEET PROVIDED
 SIXTH STREET = 0 FEET REQUIRED, 0 FEET PROVIDED

SITE DATA

TOTAL AREA	0.062 AC (A) 0.031 AC (B) 0.055 AC (C) 0.141 AC (D) 0.048 AC (E) 0.016 AC (F)
EXISTING NO. OF LOTS	6
PROPOSED NO. OF LOTS	1
EXISTING USE	COMMERCIAL
PROPOSED USE	COMMERCIAL
WATER SUPPLY	PUBLIC (LEHIGH COUNTY AUTHORITY)
SANITARY SEWER SUPPLY	PUBLIC (LEHIGH COUNTY AUTHORITY)

SURVEY DATA

I HEREBY CERTIFY THAT THIS PLAN HAS BEEN COMPILED FROM A SURVEY ACTUALLY MADE ON THE GROUND, THAT IT IS CORRECT AND AT THE TIME THE SURVEY WAS MADE, THERE WERE NO EASEMENTS OR ENCROACHMENTS ACROSS PROPERTY LINES, OTHER THAN THOSE SHOWN.

(REGISTERED SURVEYOR) _____ 20____

NOTE:


PLAN SHEETS C-01, C-03, C-04 AND C-06 ARE TO BE RECORDED, AND SHOULD BE REFERENCED COLLECTIVELY FOR NOTES, DATA, AND CERTIFICATIONS.

S. Sixth Street
 (Variable Width R.O.W.)

W. Hamilton Street
 (Variable Width R.O.W.)

W. Maple Street

Type Street
 (10' R.O.W.)

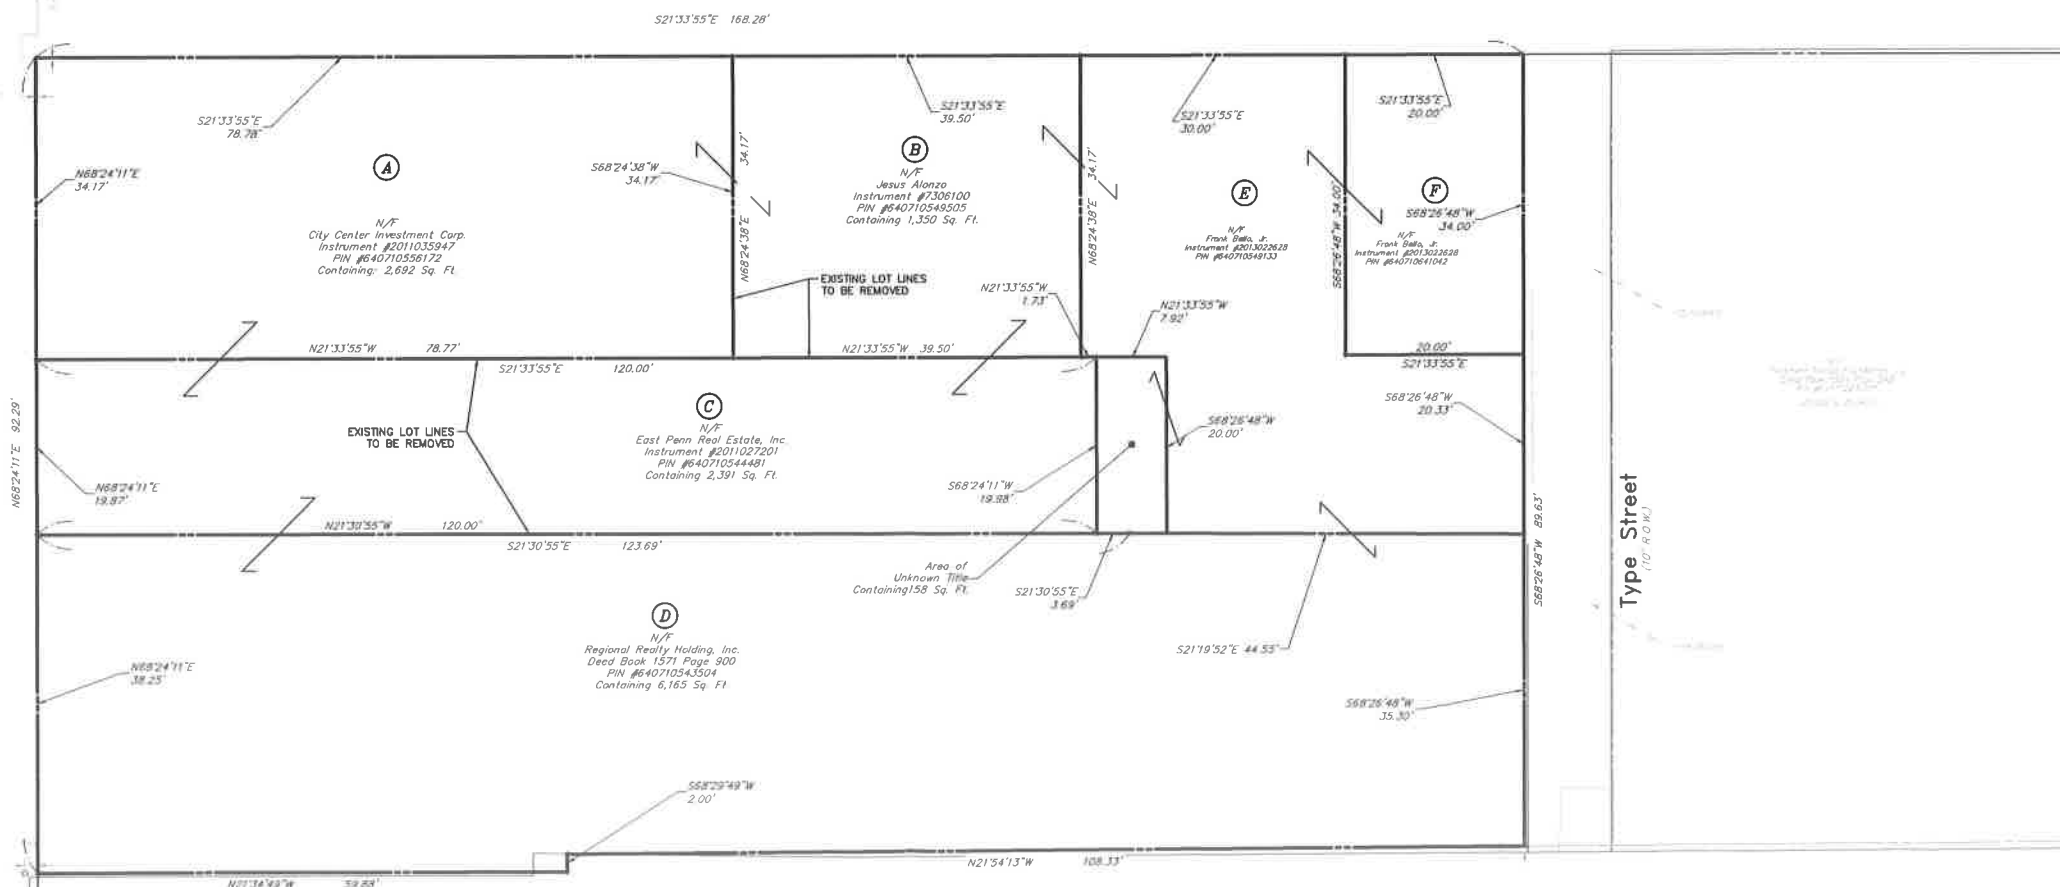

FOR REVIEW ASSOCIATES BY:

REFS:

MANAGER:	DAVID MILLER, P.E.	CHKD BY:	DDM
DESIGN BY:	DDM	FIELDBOOK NO.:	
SURV. CHIEF:		DATA COLLECTOR:	
ASIN:		CHKD BY:	DDM
DRAWN BY:	ASN		

CLIENT:
 CITY CENTER INVESTMENT CORP.
 645 HAMILTON STREET, SUITE 600
 ALLENTOWN, PA 18101

CITYCENTER
 LEHIGH VALLEY

RETTEW ASSOCIATES, INC.
 515 W. Hamilton Street, Ste 506, Allentown, PA 18101
 Phone: (610) 868-8330 • Fax: (610) 240-4525
 Website: www.rettew.com

LOT LINE CONSOLIDATION PLAN
 FINAL LAND DEVELOPMENT PLAN
 FOR
TOWER SIX

DATE: MAY 24, 2016
 SHEET NO. C-03 of 14
 DWG. NO. 106092000

REVISION NO. DATE
 1 06/10/16 INCLUDE BELLO PROPERTIES
 DAVID D. MILLER, P.E. PA LIC. # PE-054980-E

GENERAL NOTES

1. AT CONTRACTORS OPTION, A SINGLE WATER SUPPLY LINE CAN BE PROVIDED WITH THE DOMESTIC LINE BRANCHING OFF THE MAIN (FIRE) LINE WITHIN THE BUILDING. CONTRACTOR TO CONFIRM WITH BUILDING CODES AND INSURANCE REQUIREMENTS.
2. REFER TO ARCHITECTURAL DRAWINGS FOR FINAL LOCATION OF UTILITY SERVICE CONNECTIONS.

WATER AND SEWER NOTES

1. ALL WATER SYSTEM CONSTRUCTION SHALL CONFORM TO THE CITY OF ALLENTOWN DESIGN SPECIFICATIONS FOR WATER AND WASTEWATER.
2. APPROVED CITY OF ALLENTOWN PLUMBING AND FIRE PROTECTION PLANS SHALL BE SUBMITTED FOR LEHIGH COUNTY AUTHORITY (LCA) REVIEW AND WRITTEN APPROVAL OF THE PROPOSED INSTALLATION OF METERS, DETECTOR CHECKS AND BACKFLOW PREVENTION DEVICES PRIOR TO INSTALLATION.
3. A MINIMUM TWO (2)-HOUR 150 PSI PRESSURE TEST SHALL BE PERFORMED ON A WATER SERVICE LATERAL.
4. THE EXISTING VALVE AT THE CONNECTION POINT TO THE WATER SYSTEM MAY NOT PASS A PRESSURE TEST AS REQUIRED BY LCA, NFPA OR OTHER AGENCY FOR NEW CONSTRUCTION. THE DEVELOPER SHALL BEAR THE COST TO REPAIR OR REPLACE THIS VALVE TO MEET TESTING REQUIREMENTS.
5. SEE PLUMBING AND FIRE PROTECTION SYSTEM PLANS FOR CONTINUATION OF WATER SERVICE.
6. CONTACT LCA AT 610-398-2503 TO SCHEDULE A PROPOSED CONNECTION TO THE WATER SYSTEM. A MINIMUM OF 3 BUSINESS DAYS' NOTICE SHALL BE GIVEN.
7. THE LCA OPERATIONS DEPARTMENT MUST BE NOTIFIED AT LEAST 2 WEEKS PRIOR TO PERFORMING A HIGH VOLUME FLUSH OF THE PLUMBING OR FIRE PROTECTION SYSTEM, A FIRE FLOW TEST OR FIRE PUMP TEST.
8. THE LCA CUSTOMER SERVICE DEPARTMENT WILL BE NOTIFIED TO SCHEDULE AN INSPECTION OF THE METER SETTING PRIOR TO INITIATION OF WATER SERVICE.
9. WATER METERS AND BACKFLOW PREVENTION DEVICES WILL BE REQUIRED.
10. LCA REQUIRES AN APPROVED SET OF BUILDING PLANS FROM THE CITY OF ALLENTOWN PRIOR TO ACTIVATING THE WATER AND SEWER CONNECTION.
11. SHOP DRAWINGS OF THE PROPOSED WATER AND SEWER CONNECTION MATERIALS MUST BE SUBMITTED FOR LCA APPROVAL. LCA WILL RETAIN TWO COPIES OF THE SHOP DRAWINGS FOR THEIR FILES.

LEGEND

EXISTING BOUNDARY LINE	PROPOSED CURB	PROPOSED SANITARY SEWER STRUCTURE LABEL
EXISTING RIGHT-OF-WAY LINE	PROPOSED CONTOUR LINE	PROPOSED SANITARY SEWER MANHOLE
EXISTING EASEMENT LINE	PROPOSED SPOT ELEVATION	PROPOSED STORM INLET
EXISTING SETBACK LINE	PROPOSED FINISHED FLOOR ELEVATION	EXISTING SPOT ELEVATION
EXISTING CURB	PROPOSED WATER LINE	PROPOSED STORM PIPE
EXISTING PAVEMENT	PROPOSED SANITARY SEWER LINE	PROPOSED STORM STRUCTURE LABEL
EXISTING VEGETATION	DECIDUOUS TREE	STONE TRENCH
	EVERGREEN TREE	
EXISTING TREE LINE		
EXISTING FENCE		
EXISTING UTILITY POLE		
EXISTING OVERHEAD TELEPHONE LINE		
EXISTING UNDERGROUND TELEPHONE LINE		
EXISTING OVERHEAD ELECTRIC LINE		
EXISTING UNDERGROUND ELECTRIC LINE		
EXISTING WELL		
EXISTING WATER VALVE		
EXISTING FIRE HYDRANT		
EXISTING WATER LINE		
EXISTING SANITARY SEWER MANHOLE		
EXISTING SANITARY SEWER LINE		
EXISTING SANITARY SEWER FORCEMAIN		
EXISTING TELEPHONE BOX		
EXISTING GAS LINE		
EXISTING GAS VALVE		
EXISTING STORM MANHOLE		
EXISTING STORM INLET		
EXISTING STORM HEADWALL/ENDWALL		
EXISTING STORM PIPE		
EXISTING CONTOUR LINE		
EXISTING ELECTRIC MANHOLE		


S. Sixth Street
(Variable Width R.O.W.)

W. Hamilton Street
(Variable Width R.O.W.)

W. Maple Street

Type Street

Type Street
(10' R.O.W.)

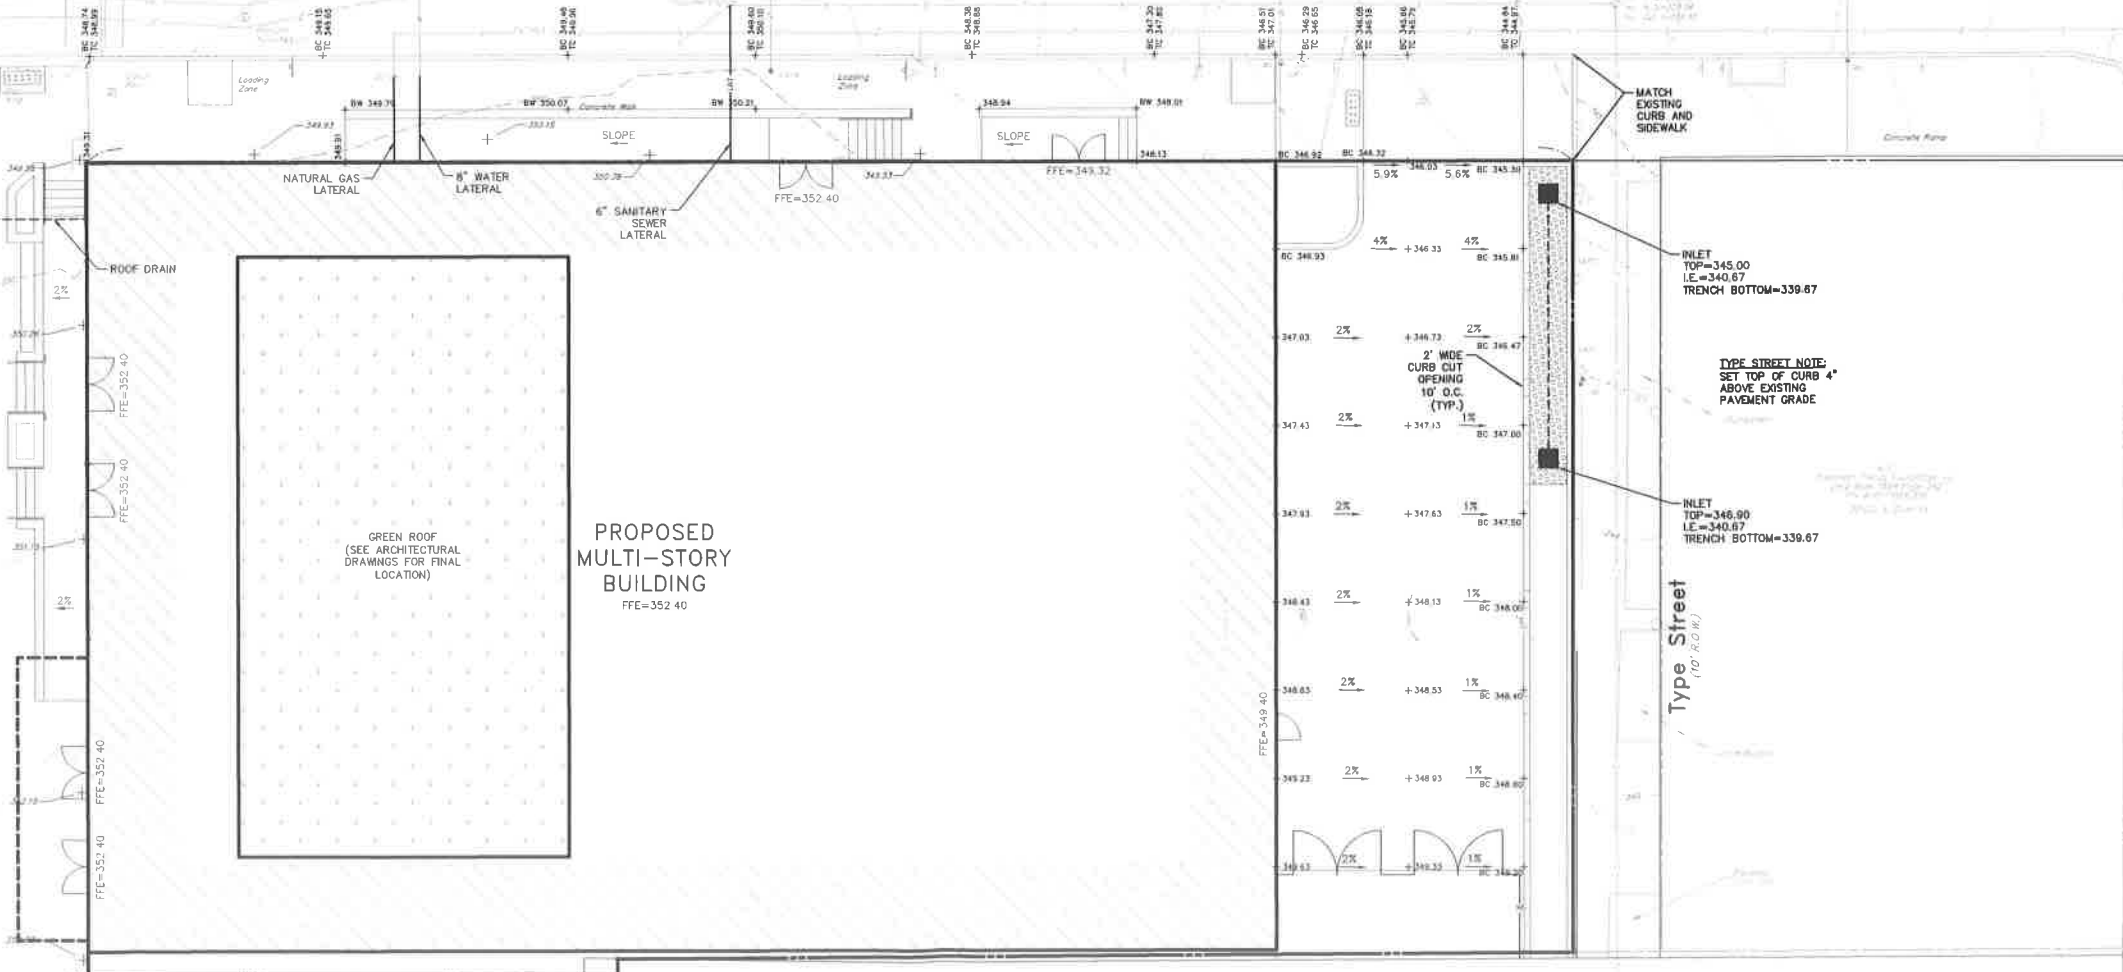

CLIENT
CITY CENTER INVESTMENT CORP.
645 HAMILTON STREET, SUITE 600
ALLENTOWN, PA 18101

RETTEW
RETTEW Associates, Inc.
515 Hamilton Street, Ste 18101
Allentown, PA 18101
Tel: (610) 240-6325
Email: rettew@rettew.com
Website: www.rettew.com

GRADING & UTILITY PLAN
FINAL LAND DEVELOPMENT PLAN
FOR
TOWER SIX

DATE: MAY 24, 2016
SHEET NO. C-05 OF 14
DWG. NO. 106092000

MANAGER: DAVID MILLER, P.E.
DESIGN BY: DDM
SURV. CHIEF: DDM
DRAWN BY: ASN
CHECKED BY: DDM
FIELDBOOK NO. DDM
DATE: 05/10/16

NO.	DATE	REVISION
1	05/10/16	INCLUDE BELLO PROPERTIES

DRAWING REFERENCE:
C:\Projects\444444\444444.dwg

CITY OF ALLENTOWN, 2ND WARD
LEHIGH COUNTY, PA

PLANT SCHEDULE				
SYMBOL KEY	QUANTITY	BOTANICAL NAME	COMMON NAME	SITE/CONDITIONS
QP	3	QUERCUS PHELLOS	WILLOW OAK	EXISTING PLANTER
QP	2	QUERCUS PHELLOS	WILLOW OAK	5'x5' TREE GRATE
QP	1	QUERCUS PHELLOS	WILLOW OAK	NEW PLANTER AT DRIVEWAY

NOTES:

- TOTAL STREET FRONTAGE = 260.57 LF
PER THE CITY SHADE TREE ORDINANCE, 1 SHADE TREE IS REQUIRED FOR EVERY 40 LF OF STREET FRONTAGE
7 STREET TREES REQUIRED
6 STREET TREES PROVIDED (ON-SITE)
1 STREET TREE TO BE PROVIDED (OFF-SITE)
- STREET TREES SHALL BE SUBJECT TO ALL RULES AND REGULATIONS OF THE SHADE TREE ORDINANCE CONCERNING PRUNING, PROTECTION, MAINTENANCE AND PRESERVATION.

Right of Way Line (Width Varies)


Type Street

LEGEND

EXISTING BOUNDARY LINE	EXISTING RIGHT-OF-WAY LINE	EXISTING CASHEMIFY LINE	EXISTING SETBACK LINE	EXISTING CURB	EXISTING PAVEMENT	EXISTING VEGETATION	EXISTING TREE LINE	EXISTING FENCE	EXISTING UTILITY POLE	EXISTING UNDERGROUND TELEPHONE LINE	EXISTING UNDERGROUND TELEPHONE LINE	EXISTING OVERHEAD ELECTRIC LINE	EXISTING UNDERGROUND ELECTRIC LINE	EXISTING WELL	EXISTING WATER VALVE	EXISTING FIRE HYDRANT	EXISTING WATER LINE	EXISTING SANITARY SEWER LINE	EXISTING SANITARY SEWER LINE	EXISTING SANITARY SEWER FORCE MAIN	EXISTING TELEPHONE BOX	EXISTING GAS LINE	EXISTING GAS VALVE	EXISTING STORM MANHOLE	EXISTING STORM INLET	EXISTING STORM HEADWALL/ENDWALL	EXISTING STORM PIPE	EXISTING CONTOUR LINE	EXISTING ELECTRIC MANHOLE
PROPOSED CURB	PROPOSED CONTOUR LINE	PROPOSED WATER LINE	PROPOSED SANITARY SEWER LINE	PROPOSED STORM MANHOLE	PROPOSED STORM INLET	PROPOSED STORM PIPE	PROPOSED DECIDUOUS TREE	LANDSCAPING TAG	PROPOSED LIGHT POLE	STONE TRENCH																			

S. Sixth Street
(Variable Width R.O.W.)

W. Hamilton Street
(Variable Width R.O.W.)

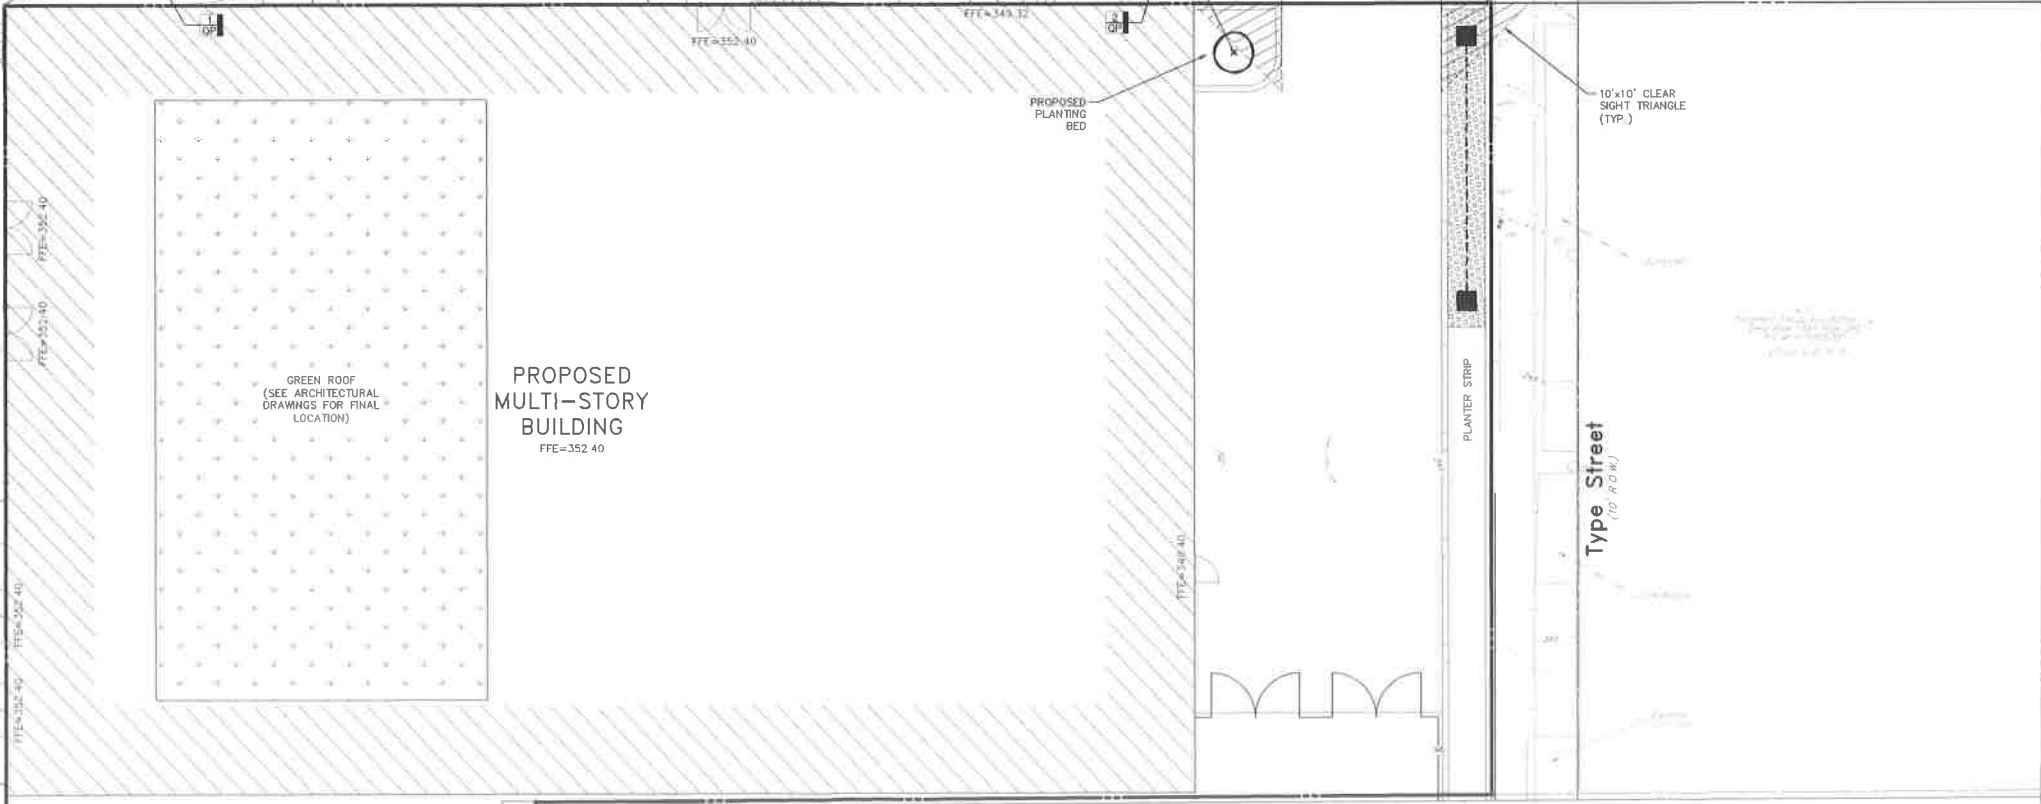


NOTES:


- SEE SHEET C-09 FOR LIGHTING INFORMATION

FOR REVIEW ASSOCIATES BY:		DATE		NO.		REVISION	
DAVID D. MILLER		06/10/16		1		INCLUDE BELLO PROPERTIES	
PA. LIC. # PE-054960-E							
MANAGER: DAVID MILLER, P.E.		CHECKED BY: DDM		DESIGN BY: DDM		SURV. CHIEF: ASN	
CLIENT: CITY CENTER INVESTMENT CORP.		645 HAMILTON STREET, SUITE 600		ALLENTOWN, PA 18101		CITYCENTER	
SCALE: 1"=10'		0 5 10 20 30		DRAWING REFERENCE: C:\0070\p\subarea_0101\06092000-Plan US Plan.dwg			
REVIEW ASSOCIATES, INC.		515 Wharton Street, Ste 500		Allentown, PA 18101		Tel: (610) 240-9325	
www.review.com		Email: info@review.com		Website: www.review.com		Environmental Consultants	
LANDSCAPE & LIGHTING PLAN		FINAL LAND DEVELOPMENT PLAN		FOR		TOWER SIX	
CITY OF ALLENTOWN, 2ND WARD		LEHIGH COUNTY, PA		DATE: MAY 24, 2016		SHEET NO. C-06 OF 14	
				DWG. NO. 106092000			

NOTES:
 1. ADJUST TO GRADE WITH CONCRETE GRADE RINGS. BOLT FRAME TO MANHOLE USING (4) 3/4" STN. STL. BOLTS EQUALLY SPACED AND EMBEDDED 3" MIN. (4" MAX. HEIGHT)
 2. MECHANICALLY VIBRATED PRECAST CONCRETE RISER AND TOP SHALL CONFORM TO A.S.T.M. SPEC. C-478




PLAN

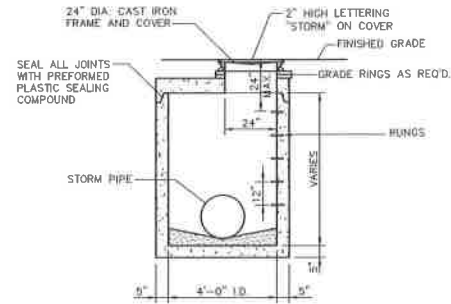

SECTION


STORM MANHOLE

NOT TO SCALE
07/03/06

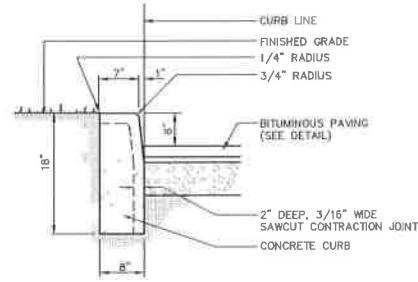


VERTICAL CURB DETAIL

NOT TO SCALE
07/03/06

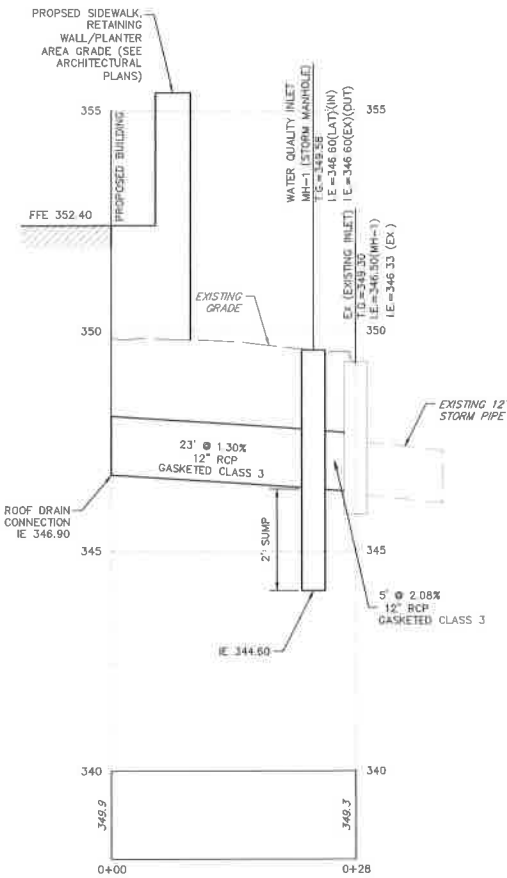


"CENTERLINE PROFILE OF Inlet"

HORIZONTAL SCALE - 1"=10'
 VERTICAL SCALE - 1"=2'

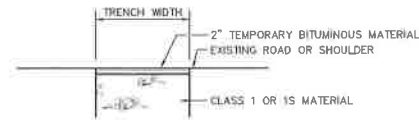


TEMPORARY RESTORATION FOR PennDOT & TOWNSHIP ROADWAYS, ALLEYS OR SHOULDERS

NOT TO SCALE
07/03/06

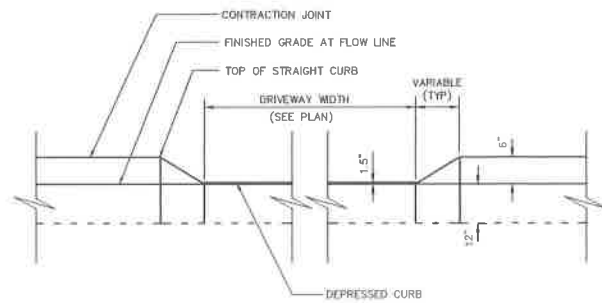


DRIVEWAY CURB CUT

NOT TO SCALE
07/03/06

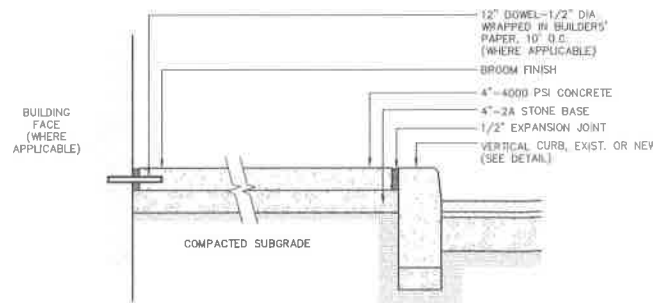

CONCRETE WALK DETAIL

NOT TO SCALE
07/03/06

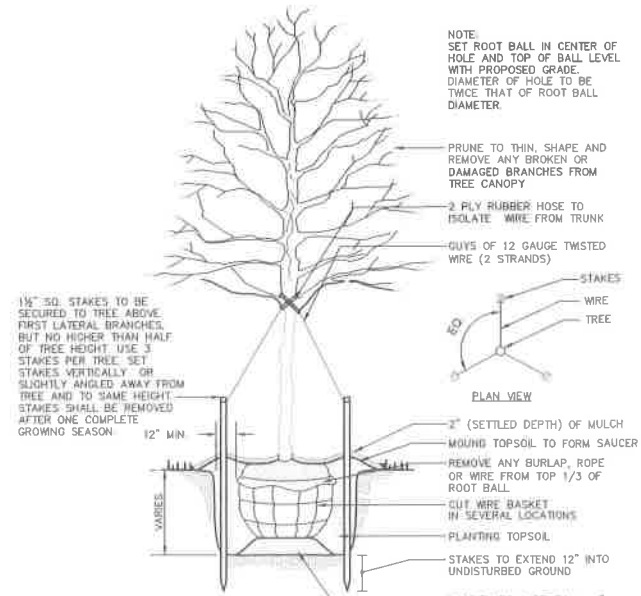

DECIDUOUS TREE PLANTING

NOT TO SCALE
07/03/06

FOR RETIEW ASSOCIATES BY:

REFERENCES:

MANAGER: DAVID MILLER, P. E.
 DESIGN BY: DDM
 SURV. CHIEF: FEEDBOOK NO. 0181 COLLEGE
 DRAWN BY: ASN
 CHECK BY: DDM

CLIENT: CITY CENTER INVESTMENT CORP., 645 HAMILTON STREET, SUITE 600 ALLENTOWN, PA 18101



RETIEW
 RETIEW Associates, Inc.
 515 Hamilton Street, Ste. 508, Allentown, PA, 18101
 Phone: (610) 260-4325
 Email: retiew@retiew.com
 Website: www.retiew.com

CONSTRUCTION DETAILS & PROFILES
 FINAL LAND DEVELOPMENT PLAN
 FOR

TOWER SIX







DATE: MAY 24, 2016
 SHEET NO. C-07 OF 14
 DWG. NO. 106092000

CITY OF ALLENTOWN, 2ND WARD
 LEHIGH COUNTY, PA

DAVID D. MILLER
 PA. LIC. # PE-054980-E
 1 06/10/16
 INCLUDE BELLO PROPERTIES
 REVISION

LANDSCAPING NOTES

1. THE BACKFILL MIXTURE FOR TREES, SHRUBS AND GROUNDCOVERS SHALL BE SPECIFIED BASED UPON SOIL TESTS AND CULTURAL REQUIREMENTS.
2. PLANTING BED SHALL BE MULCHED WITH SHREDDED HARDWOOD BARK 3" THICK, THROUGHOUT (TYP.). PLANTING BEDLINES SHALL BE EDGED WITH A SPADE PRIOR TO MULCHING WHERE EDGING IS NOT USED.
3. CONTRACTOR SHALL VERIFY PLANT QUANTITIES PRIOR TO SELECTING PLANTS AT NURSERY SOURCES. NOTIFY LANDSCAPE ARCHITECT OF DISCREPANCIES BETWEEN PLANTING PLANS AND PLANT LIST. IN THE EVENT OF A DISCREPANCY, THE PLANTING PLANS SHALL PREVAIL.
4. PLANT MATERIAL SHALL BE TAGGED AT THE NURSERY OR APPROVED ONLINE BY THE PROJECT LANDSCAPE ARCHITECT PRIOR TO PLANTING.
5. MINIMUM DISTANCE BETWEEN CANOPY TREES AND ROADWAY/PARKING LOT LIGHT POLES SHALL BE TEN FEET.
6. ALL PLANT MATERIALS USED SHALL BE TRUE TO NAME AND SIZE IN CONFORMITY WITH THE AMERICAN STANDARD OF NURSERY STOCK AND SHALL BE TYPICAL OF THEIR SPECIES AND VARIETY. ALL PLANTS SHALL HAVE NORMAL WELL-DEVELOPED BRANCHES AND VIGOROUS ROOT SYSTEMS. THEY SHALL BE HEALTHY, VIGOROUS, FREE FROM DEFECTS, DISFIGURING KNOTS, ABRASSIONS OF THE BARK, SUNSCALD INJURIES, PLANT DISEASES, INSECT EGGS, BORERS AND ALL FORMS OF INFECTION. ALL PLANTS SHALL BE NURSERY GROWN.
7. ALL PLANT MATERIAL SHALL BEAR THE SAME RELATION TO FINISHED GRADE AS IT BORE TO EXISTING GRADE AT THE NURSERY.
8. ANY SUBSTITUTIONS OF PLANT MATERIAL WITH REGARD TO SIZE, SPECIES, VARIETY, ETC., SHALL BE SUBJECT TO APPROVAL BY THE PROJECT LANDSCAPE ARCHITECT.
9. UNDER NO CIRCUMSTANCES SHOULD THE MAIN LEADER OF A DECIDUOUS OR EVERGREEN TREE BE DAMAGED OR REMOVED.
10. PLANTS PLANTED IN ROWS SHALL BE MATCHED SPECIMENS AND BE UNIFORM IN SIZE AND FORM.
11. ALL PLANT MATERIAL IS TO BE GUARANTEED FOR A PERIOD OF ONE YEAR FROM TIME OF FINAL ACCEPTANCE OF THE PROJECT OR AS REGULATED BY THE OWNER. IF ANY PLANTS ARE DEAD OR IN AN UNHEALTHY CONDITION BEFORE FINAL ACCEPTANCE OF THE PROJECT, THE LANDSCAPE CONTRACTOR SHALL REPLACE THEM AT HIS EXPENSE. THE DETERMINATION OF WHICH PLANTS REQUIRE REPLACEMENT SHALL BE DETERMINED BY THE PROJECT LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE.
12. THE CONTRACTOR WILL BE HELD RESPONSIBLE FOR ANY DAMAGE TO EXISTING UTILITIES OR STRUCTURES CAUSED BY ANY PERSON, VEHICLE, EQUIPMENT, OR TOOLS RELATED TO THE EXECUTION OF THIS CONTRACT.
13. EXCAVATION NEAR EXISTING UTILITIES, OR WITHIN THE DRIPLINE OF EXISTING TREES TO BE SAVED, SHALL BE CAREFULLY PERFORMED BY HAND.
14. SHADE TREES LOCATED ADJACENT TO ROADWAYS AND SIDEWALKS SHALL HAVE A MINIMUM FIRST BRANCH HEIGHT OF 6'.
15. THE PLANT MATERIAL, SIZE AND QUANTITY ARE LISTED IN THE PLANT LIST TABLE.
16. CONTRACTOR IS TO PROVIDE A SCHEDULE OF VALUES WHEN BIDDING THE LANDSCAPING AS A LUMP-SUM ADD ALTERNATE ITEM.
17. THE TOPSOIL USED FOR THIS PROJECT SHALL BE IN STRICT CONFORMANCE WITH THE PROJECT SPECIFICATIONS. ANY TOPSOIL NOT MEETING THE ENGINEER'S APPROVAL SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

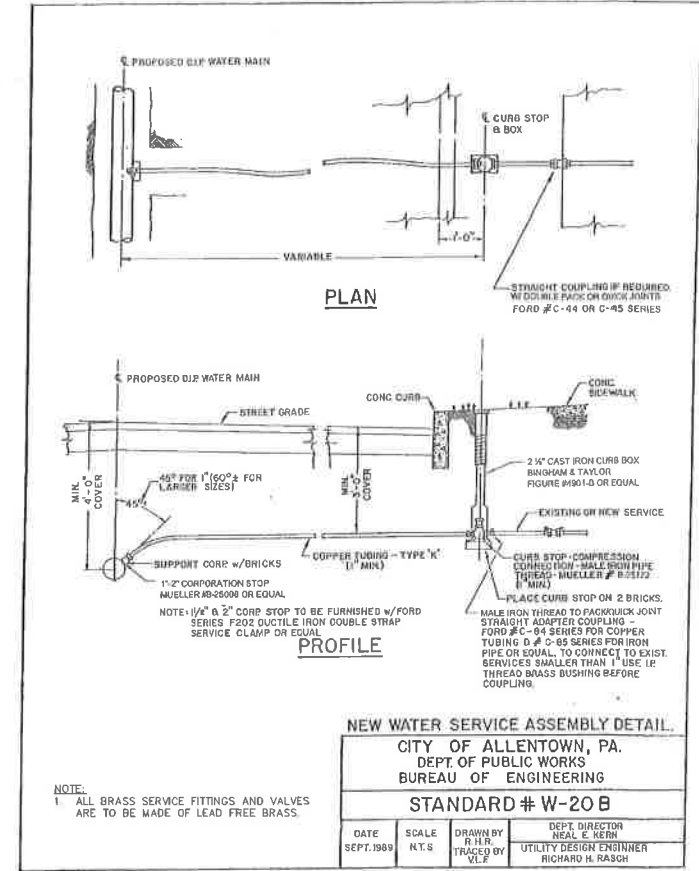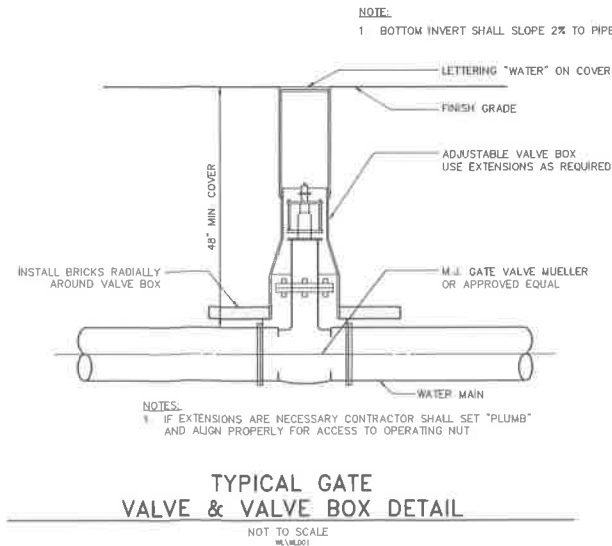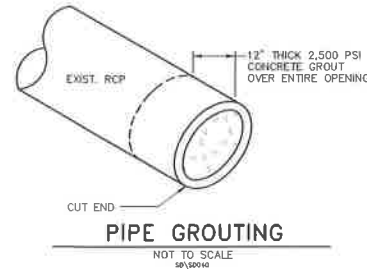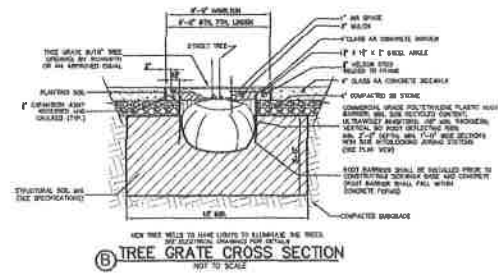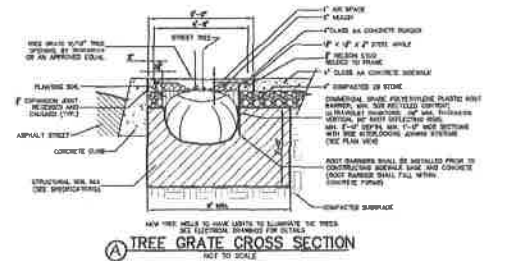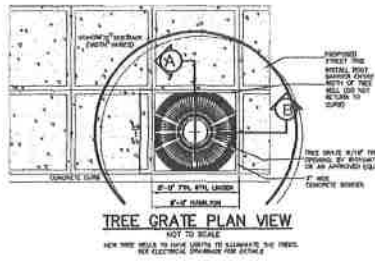

REVIEW ASSOCIATES, INC.
 515 Wharton Street, Ste. 502, Allentown, PA 18101
 Tel: (610) 261-4525
 Email: review@review.com
 Website: www.review.com

CITYCENTER
 LEHIGH VALLEY

CONSTRUCTION DETAILS
 FINAL LAND DEVELOPMENT PLAN
 FOR
TOWER SIX



CITY OF ALLENTOWN, 2ND WARD LEHIGH COUNTY, PA

DATE: MAY 24, 2016
 SHEET NO. C-08 OF 14
 DWG. NO. 106092000

FOR REVIEW ASSOCIATES BY:
 MANAGER: DAVID MILLER, P.E.
 DESIGN BY: DDM
 SURV. CHIEF: FELDBOOK NO. DDM
 DRAWN BY: DDM
 ASN
 CHD BY: DDM

DATE: 06/10/16
 NO. 1
 REVISION: INCLUDE BELLO PROPERTIES
 DAVID D. MILLER
 P.A. LIC # PE-054960-E

AS NOTED

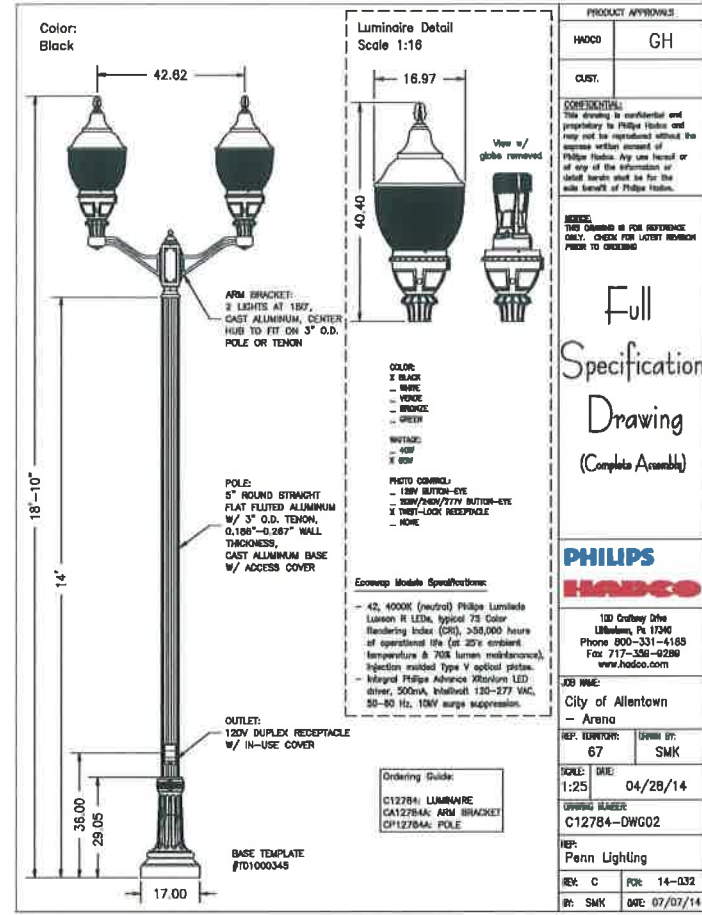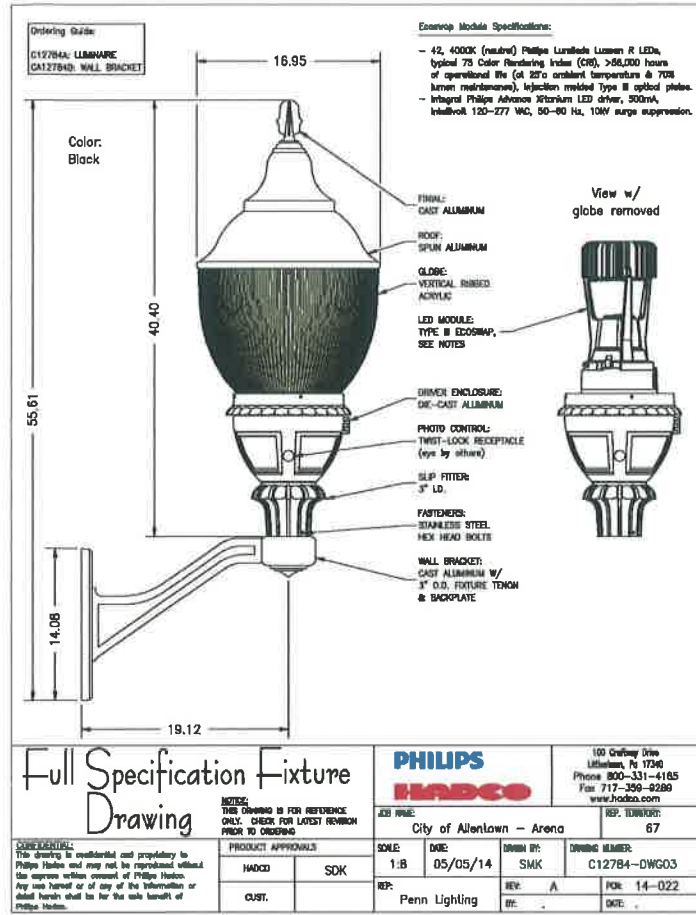

LIGHTING DETAILS
FINAL LAND DEVELOPMENT PLAN
FOR
TOWER SIX
CITY OF ALLENTOWN, 2ND WARD
LEHIGH COUNTY, PA

DATE: MAY 24, 2016
SHEET NO C-09 OF 14
DWG NO 106092000

RETTEW
Associates, Inc.
506 Allentown, PA 18101
Phone (610) 866-8330 - Fax (484) 240-4525
Email: rettew@rettew.com
Website: www.rettew.com

Engineers • Planners • Surveyors • Landscape Architects
INTERNATIONAL CONSULTANTS

CITY CENTER
UNION MARKET

CITY CENTER INVESTMENT CORP.
645 HAMILTON STREET, SUITE 600
ALLENTOWN, PA 18101

AS NOTED

MANAGER: DAVID MILLER, P. E.
CHECKED BY: DDM
SURV. CHIEF: DDM
DRAWN BY: DDM

REFS:

DRAWING REFERENCE:
1. 06/10/16 INCLUDE BELLO PROPERTIES REVISION

FOR RETTEW ASSOCIATES BY:

DAVID D. MILLER
PA. LIC # PE-059880-E

CONSTRUCTION NOTES

1. REPLACE SIDEWALK ALONG W HAMILTON STREET FRONTAGE. MATCH EXISTING MATERIALS AND PATTERNS. EXISTING CURB AND PLANTER TO REMAIN. THREE TREES TO BE REMOVED AND REPLACED. ADA RAMP TO REMAIN.
2. EXISTING CISTERN TO BE ABANDONED. COORDINATE WITH CITY OF ALLENTOWN.
3. INSTALL TEMPORARY INLET PROTECTION AT THE UPSTREAM INLET ON S. SIXTH STREET AT THE INTERSECTION WITH WALNUT STREET (NOT SHOWN ON PLAN).

NOTE

1. NPDES BOUNDARY IS THE LIMIT SHOWN FOR THIS PROJECT SITE AND THE PREVIOUSLY PERMITTED TWO CITY CENTER, THREE CITY CENTER, FOUR CITY CENTER AND FIVE CITY CENTER FLATS.

SOILS CLASSIFICATION

MA: MADE LAND, LIMESTONE MATERIAL 0 TO 3 PERCENT SLOPES
SEE SHEET C-14 FOR SOIL LIMITATIONS AND RESOLUTIONS.

RECEIVING WATER CLASSIFICATION WATER QUALITY DESIGNATION

- JORDAN CREEK
- CHAPTER 93 DESIGNATED USE:
 - TROUT STOCKING (TSF)
 - MIGRATORY FISHES (MF)
- EXISTING USE:
 - NONE


LEGEND

- EXISTING BOUNDARY LINE
- EXISTING RIGHT-OF-WAY LINE
- EXISTING CASSEMENT LINE
- EXISTING SETBACK LINE
- EXISTING CURB
- EXISTING PAVEMENT
- EXISTING VEGETATION
- EXISTING TREE LINE
- EXISTING FENCE
- EXISTING UTILITY POLE
- EXISTING OVERHEAD TELEPHONE LINE
- EXISTING UNDERGROUND TELEPHONE LINE
- EXISTING OVERHEAD ELECTRIC LINE
- EXISTING UNDERGROUND ELECTRIC LINE
- EXISTING WELL
- EXISTING WATER VALVE
- EXISTING FIRE HYDRANT
- EXISTING WATER LINE
- EXISTING SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER LINE
- EXISTING SANITARY SEWER FORCE MAIN
- EXISTING TELEPHONE BOX
- EXISTING GAS LINE
- EXISTING GAS VALVE
- EXISTING STORM MANHOLE
- EXISTING STORM INLET
- EXISTING STORM HEADWALL/ENDWALL
- EXISTING STORM PIPE
- EXISTING CONTOUR LINE
- EXISTING ELECTRIC MANHOLE
- PROPOSED CURB
- PROPOSED FENCE
- PROPOSED CONTOUR LINE
- PROPOSED WATER LINE
- PROPOSED SANITARY SEWER LINE
- PROPOSED STORM MANHOLE
- PROPOSED STORM INLET
- PROPOSED STORM PIPE
- NPDES BOUNDARY
- LIMITS OF DISTURBANCE
- TEMPORARY INLET PROTECTION
- FILIREX SALT SOX
- TEMPORARY ROCK CONSTRUCTION ENTRANCE
- STONE TRENCH


SITE

RECEIVING WATERSHED - JORDAN CREEK

LITTLE LEHIGH CREEK

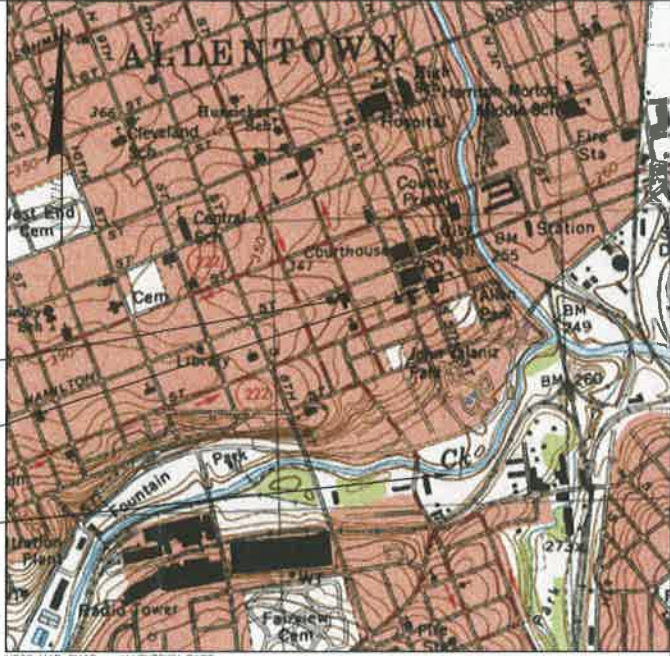

S. Sixth Street
(Variable Width R.O.W.)

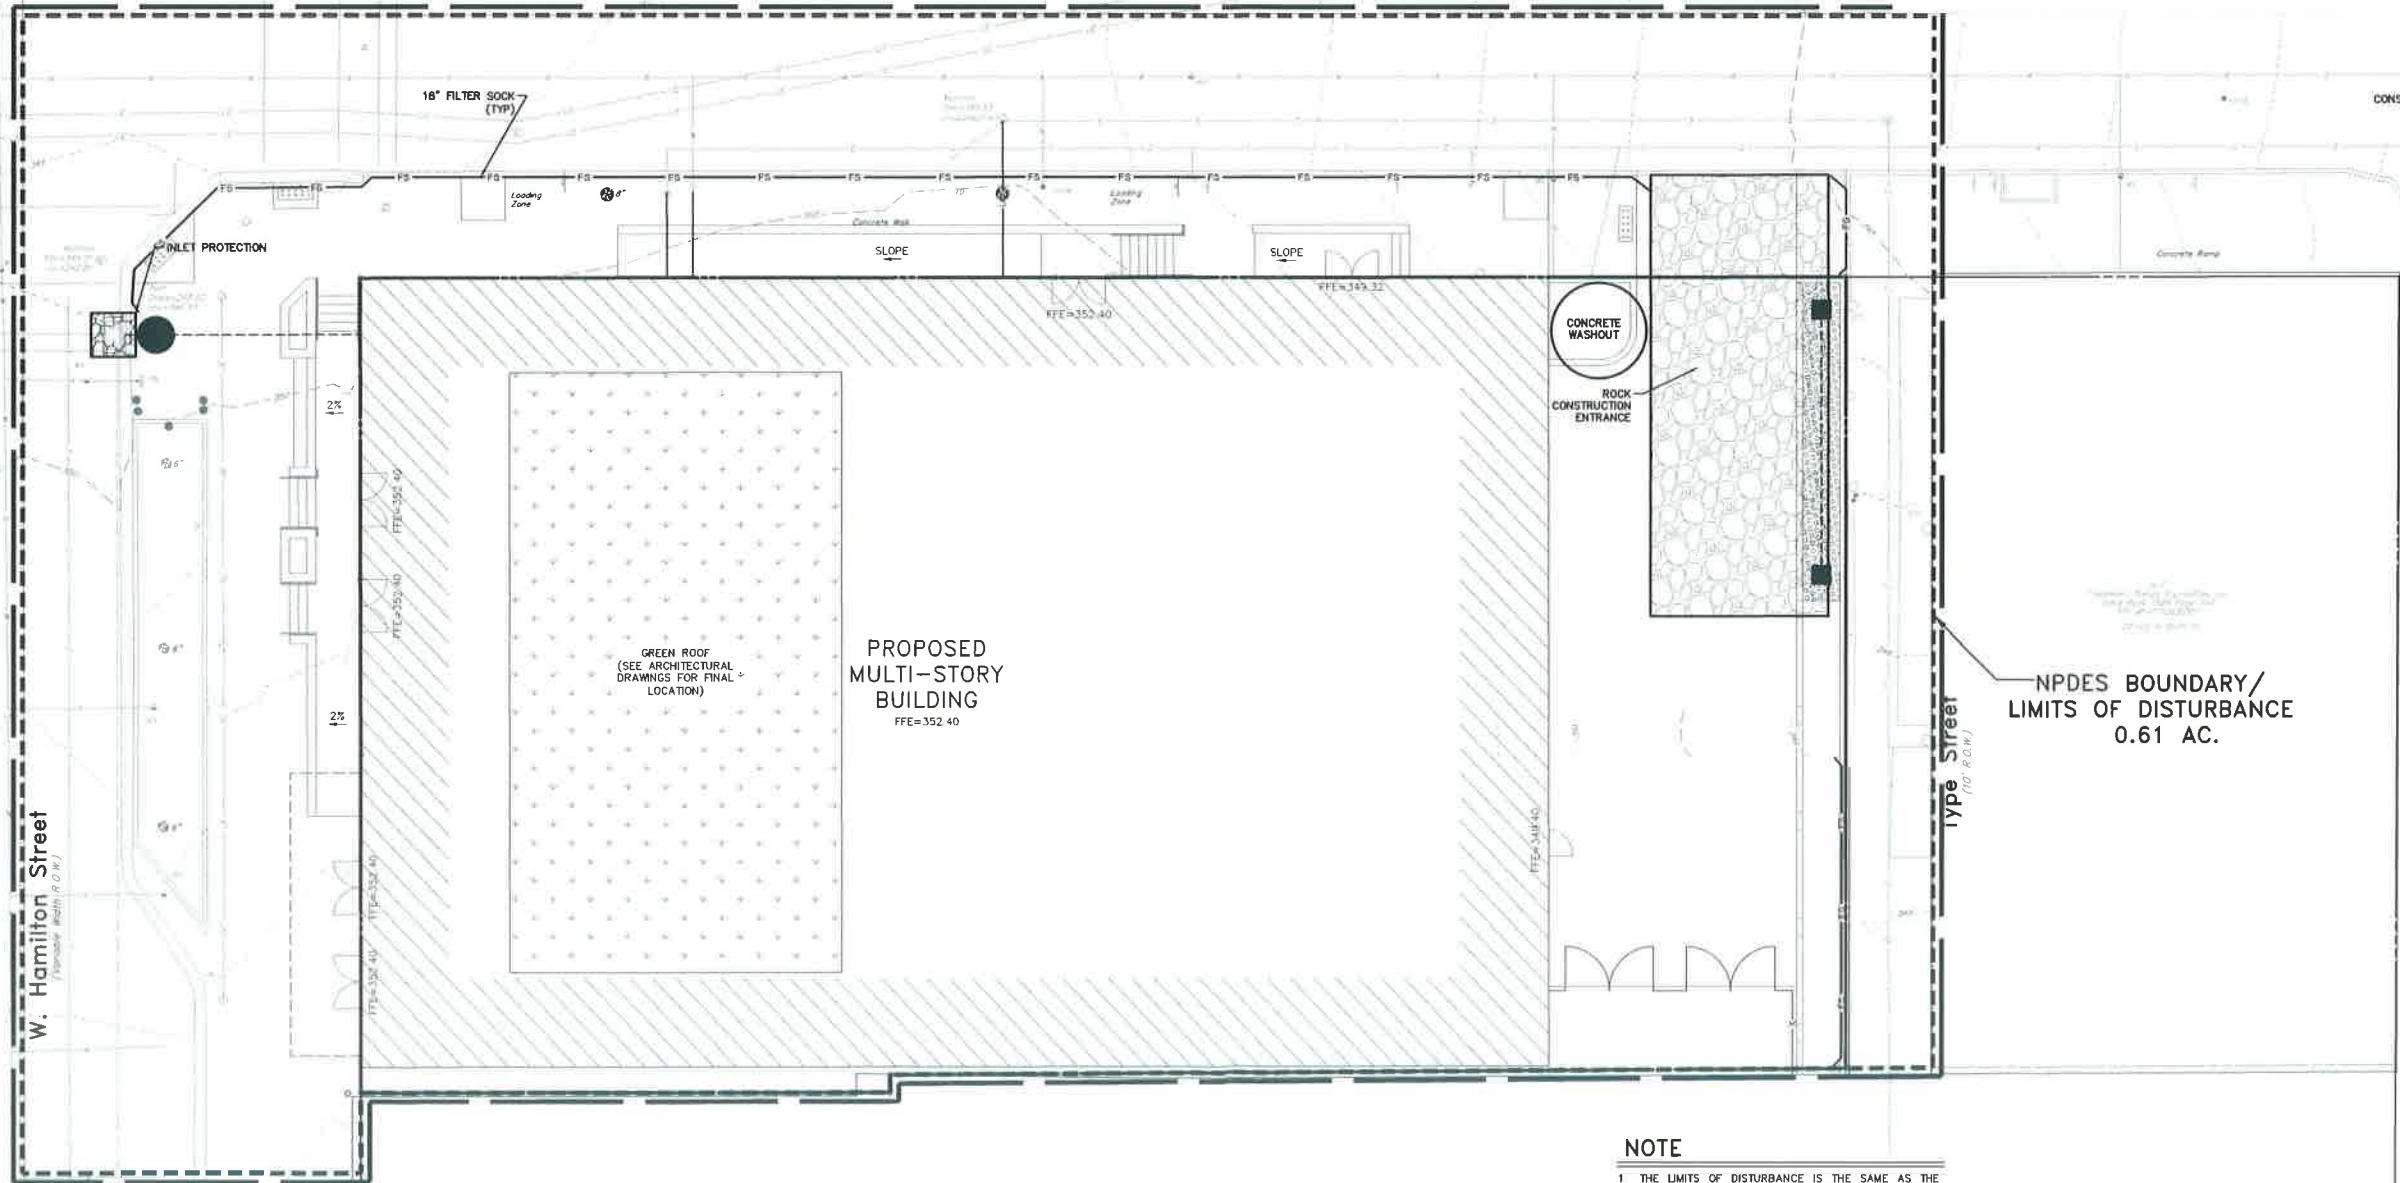

NOTE

1. THE LIMITS OF DISTURBANCE IS THE SAME AS THE NPDES BOUNDARY.

<p>FOR REVIEW ASSOCIATES BY:</p> <p>MANAGER: DAVID MILLER, P.E. DESIGN BY: DDM CHECKED BY: DDM SURV. CHIEF: DDM DRAWN BY: ASN</p>		<p>NO. DATE</p> <p>1 06/10/16 INCLUDE BELLO PROPERTIES REVISION</p>
<p>CLIENT</p> <p>CITY CENTER INVESTMENT CORP. 645 HAMILTON STREET, SUITE 600 ALLENTOWN, PA 18101</p>		<p>SCALE</p> <p>1"=10' 0 5' 10' 20' 30'</p>
<p>REVIEW</p> <p>REVIEW Associates, Inc. 208 Market Street, Allentown, PA 18101 Phone: (610) 866-8330 Fax: (610) 240-6225 Email: review@review.com Website: www.review.com</p> <p>Engineers, Planners, Surveyors, Landscape Architects Environmental Consultants</p>		<p>FOR REVIEW ASSOCIATES BY:</p> <p>MANAGER: DAVID MILLER, P.E. DESIGN BY: DDM CHECKED BY: DDM SURV. CHIEF: DDM DRAWN BY: ASN</p> <p>DRAWING REFERENCE: C:\COTDMP\AF\AF\AF\AF_5120\106092000-Final.dwg</p>
<p>EROSION & SEDIMENT CONTROL PLAN FINAL LAND DEVELOPMENT PLAN FOR</p> <p>TOWER SIX</p> <p>CITY OF ALLENTOWN, 2ND WARD LEHIGH COUNTY, PA</p>		
<p>DATE: MAY 24, 2016</p> <p>SHEET NO. C-10 OF 14</p> <p>DWG NO. 106092000</p>		

PLANT SCHEDULE				
SYMBOL KEY	QUANTITY	BOTANICAL NAME	COMMON NAME	SITE/CONDITIONS
OP	3	QUERCUS PHELLOS	WILLOW OAK	EXISTING PLANTER
OP	2	QUERCUS PHELLOS	WILLOW OAK	5'x5' TREE GRATE
OP	1	QUERCUS PHELLOS	WILLOW OAK	NEW PLANTER AT DRIVEWAY

SOILS CLASSIFICATION

MA: MADE LAND, LIMESTONE MATERIAL 0 TO 3 PERCENT SLOPES

SEE SHEET C-14 FOR SOIL LIMITATIONS AND RESOLUTIONS.


RECEIVING WATER CLASSIFICATION WATER QUALITY DESIGNATION

- JORDAN CREEK
- CHAPTER 93 DESIGNATED USE:
 - TROUT STOCKING (TSF)
 - MIGRATORY FISHES (MF)
- EXISTING USE:
 - NONE


LEGEND

- EXISTING BOUNDARY LINE
- EXISTING RIGHT-OF-WAY LINE
- EXISTING EASEMENT LINE
- EXISTING SETBACK LINE
- EXISTING CURB
- EXISTING PAVEMENT
- EXISTING VEGETATION
- EXISTING TREE LINE
- EXISTING FENCE
- EXISTING UTILITY POLE
- EXISTING OVERHEAD TELEPHONE LINE
- EXISTING UNDERGROUND TELEPHONE LINE
- EXISTING OVERHEAD ELECTRIC LINE
- EXISTING UNDERGROUND ELECTRIC LINE
- EXISTING WELL
- EXISTING WATER VALVE
- EXISTING FIRE HYDRANT
- EXISTING WATER LINE
- EXISTING SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER LINE
- EXISTING SANITARY SEWER FORCEMAIN
- EXISTING TELEPHONE BOX
- EXISTING GAS LINE
- EXISTING GAS VALVE
- EXISTING STORM MANHOLE
- EXISTING STORM INLET
- EXISTING STORM HEADWALL/ENDWALL
- EXISTING STORM PIPE
- EXISTING CONTOUR LINE
- EXISTING ELECTRIC MANHOLE
- PROPOSED CURB
- PROPOSED PAVEMENT
- PROPOSED FENCE
- PROPOSED CONTOUR LINE
- PROPOSED WATER LINE
- PROPOSED SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER LINE
- PROPOSED STORM MANHOLE
- PROPOSED STORM INLET
- PROPOSED STORM PIPE
- NPDES BOUNDARY LIMITS OF DISTURBANCE
- STONE TRENCH

SITE
RECEIVING WATERSHED - JORDAN CREEK
LITTLE LEHIGH CREEK

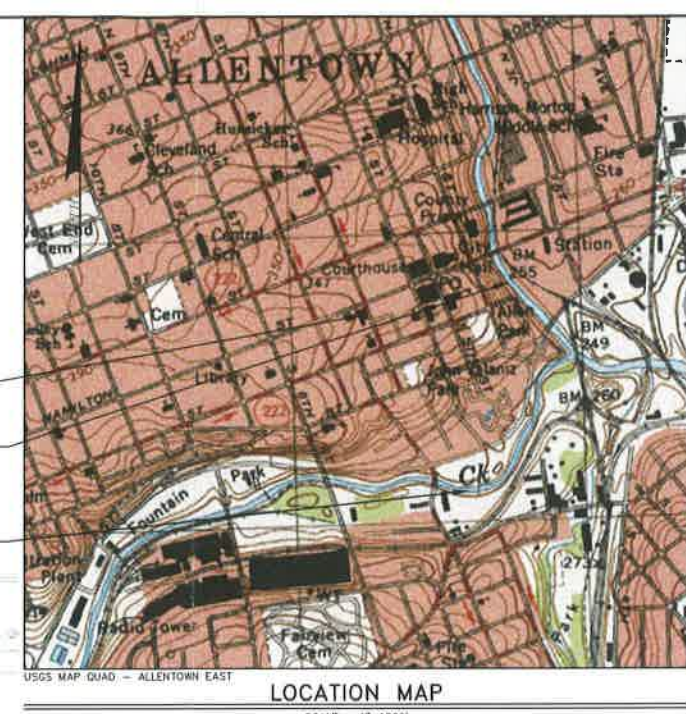

S. Sixth Street
(Variable Width R.O.W.)

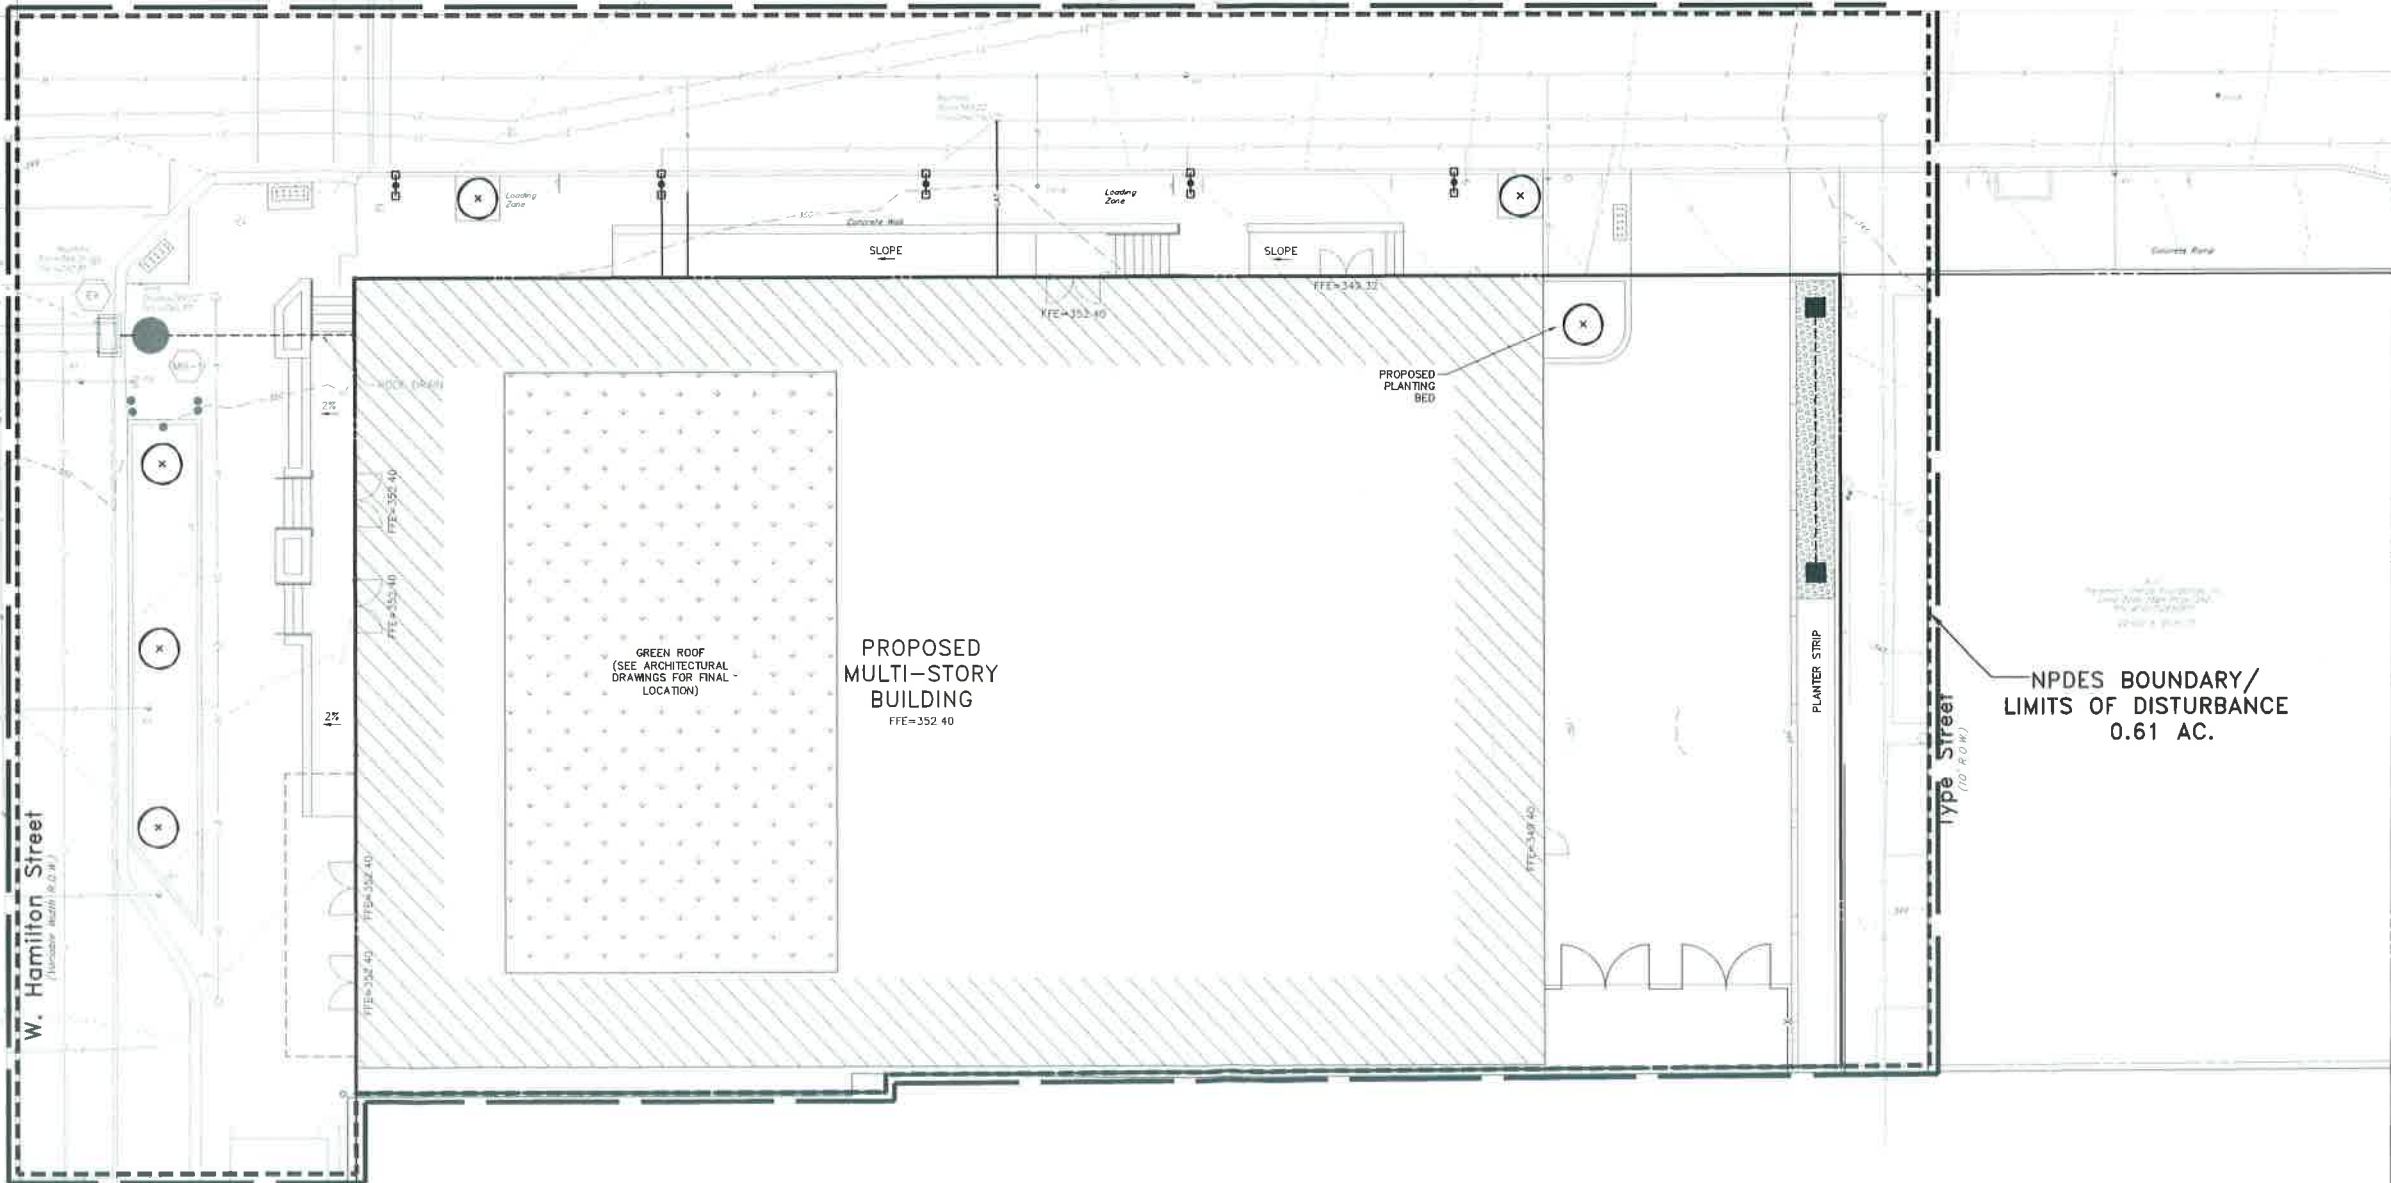

NOTES

- NPDES BOUNDARY IS THE LIMIT SHOWN FOR THIS PROJECT SITE AND THE PREVIOUSLY PERMITTED TWO CITY CENTER, THREE CITY CENTER AND FOUR CITY CENTER PROJECT.
- A MINIMUM GREEN ROOF AREA OF 2,550 S.F. SHALL BE PROVIDED FOR STORMWATER MANAGEMENT PURPOSES.

FOR RETIEW ASSOCIATES BY:

MANAGER: DAVID MILLER, P.E.
 DESIGN BY: DDM
 SURV. CHIEF: DDM
 DRAWN BY: ASN
 CHECKED BY: DDM

CLIENT: CITY CENTER INVESTMENT CORP., 645 HAMILTON STREET, SUITE 600 ALLENTOWN, PA 18101

RETIEW Associates, Inc. 915 Hamilton Street, Ste. 502, Allentown, PA 18101
 Phone: (610) 261-1111 Fax: (610) 261-4525
 Email: retiew@retiew.com Website: www.retiew.com

Engineers • Planners • Surveyors • Landscape Architects
 Environmental Consultants


CITY OF ALLENTOWN, 2ND WARD LEHIGH COUNTY, PA

DATE: MAY 24, 2016
 SHEET NO: C-13 OF 14
 DWG NO: 106092000

NO. DATE
 1 06/10/16 INCLUDE BELLO PROPERTIES REVISION

DAVID D. MILLER
 P.A. LIC # PE-054980-E

City of Allentown Sanitary Sewer System

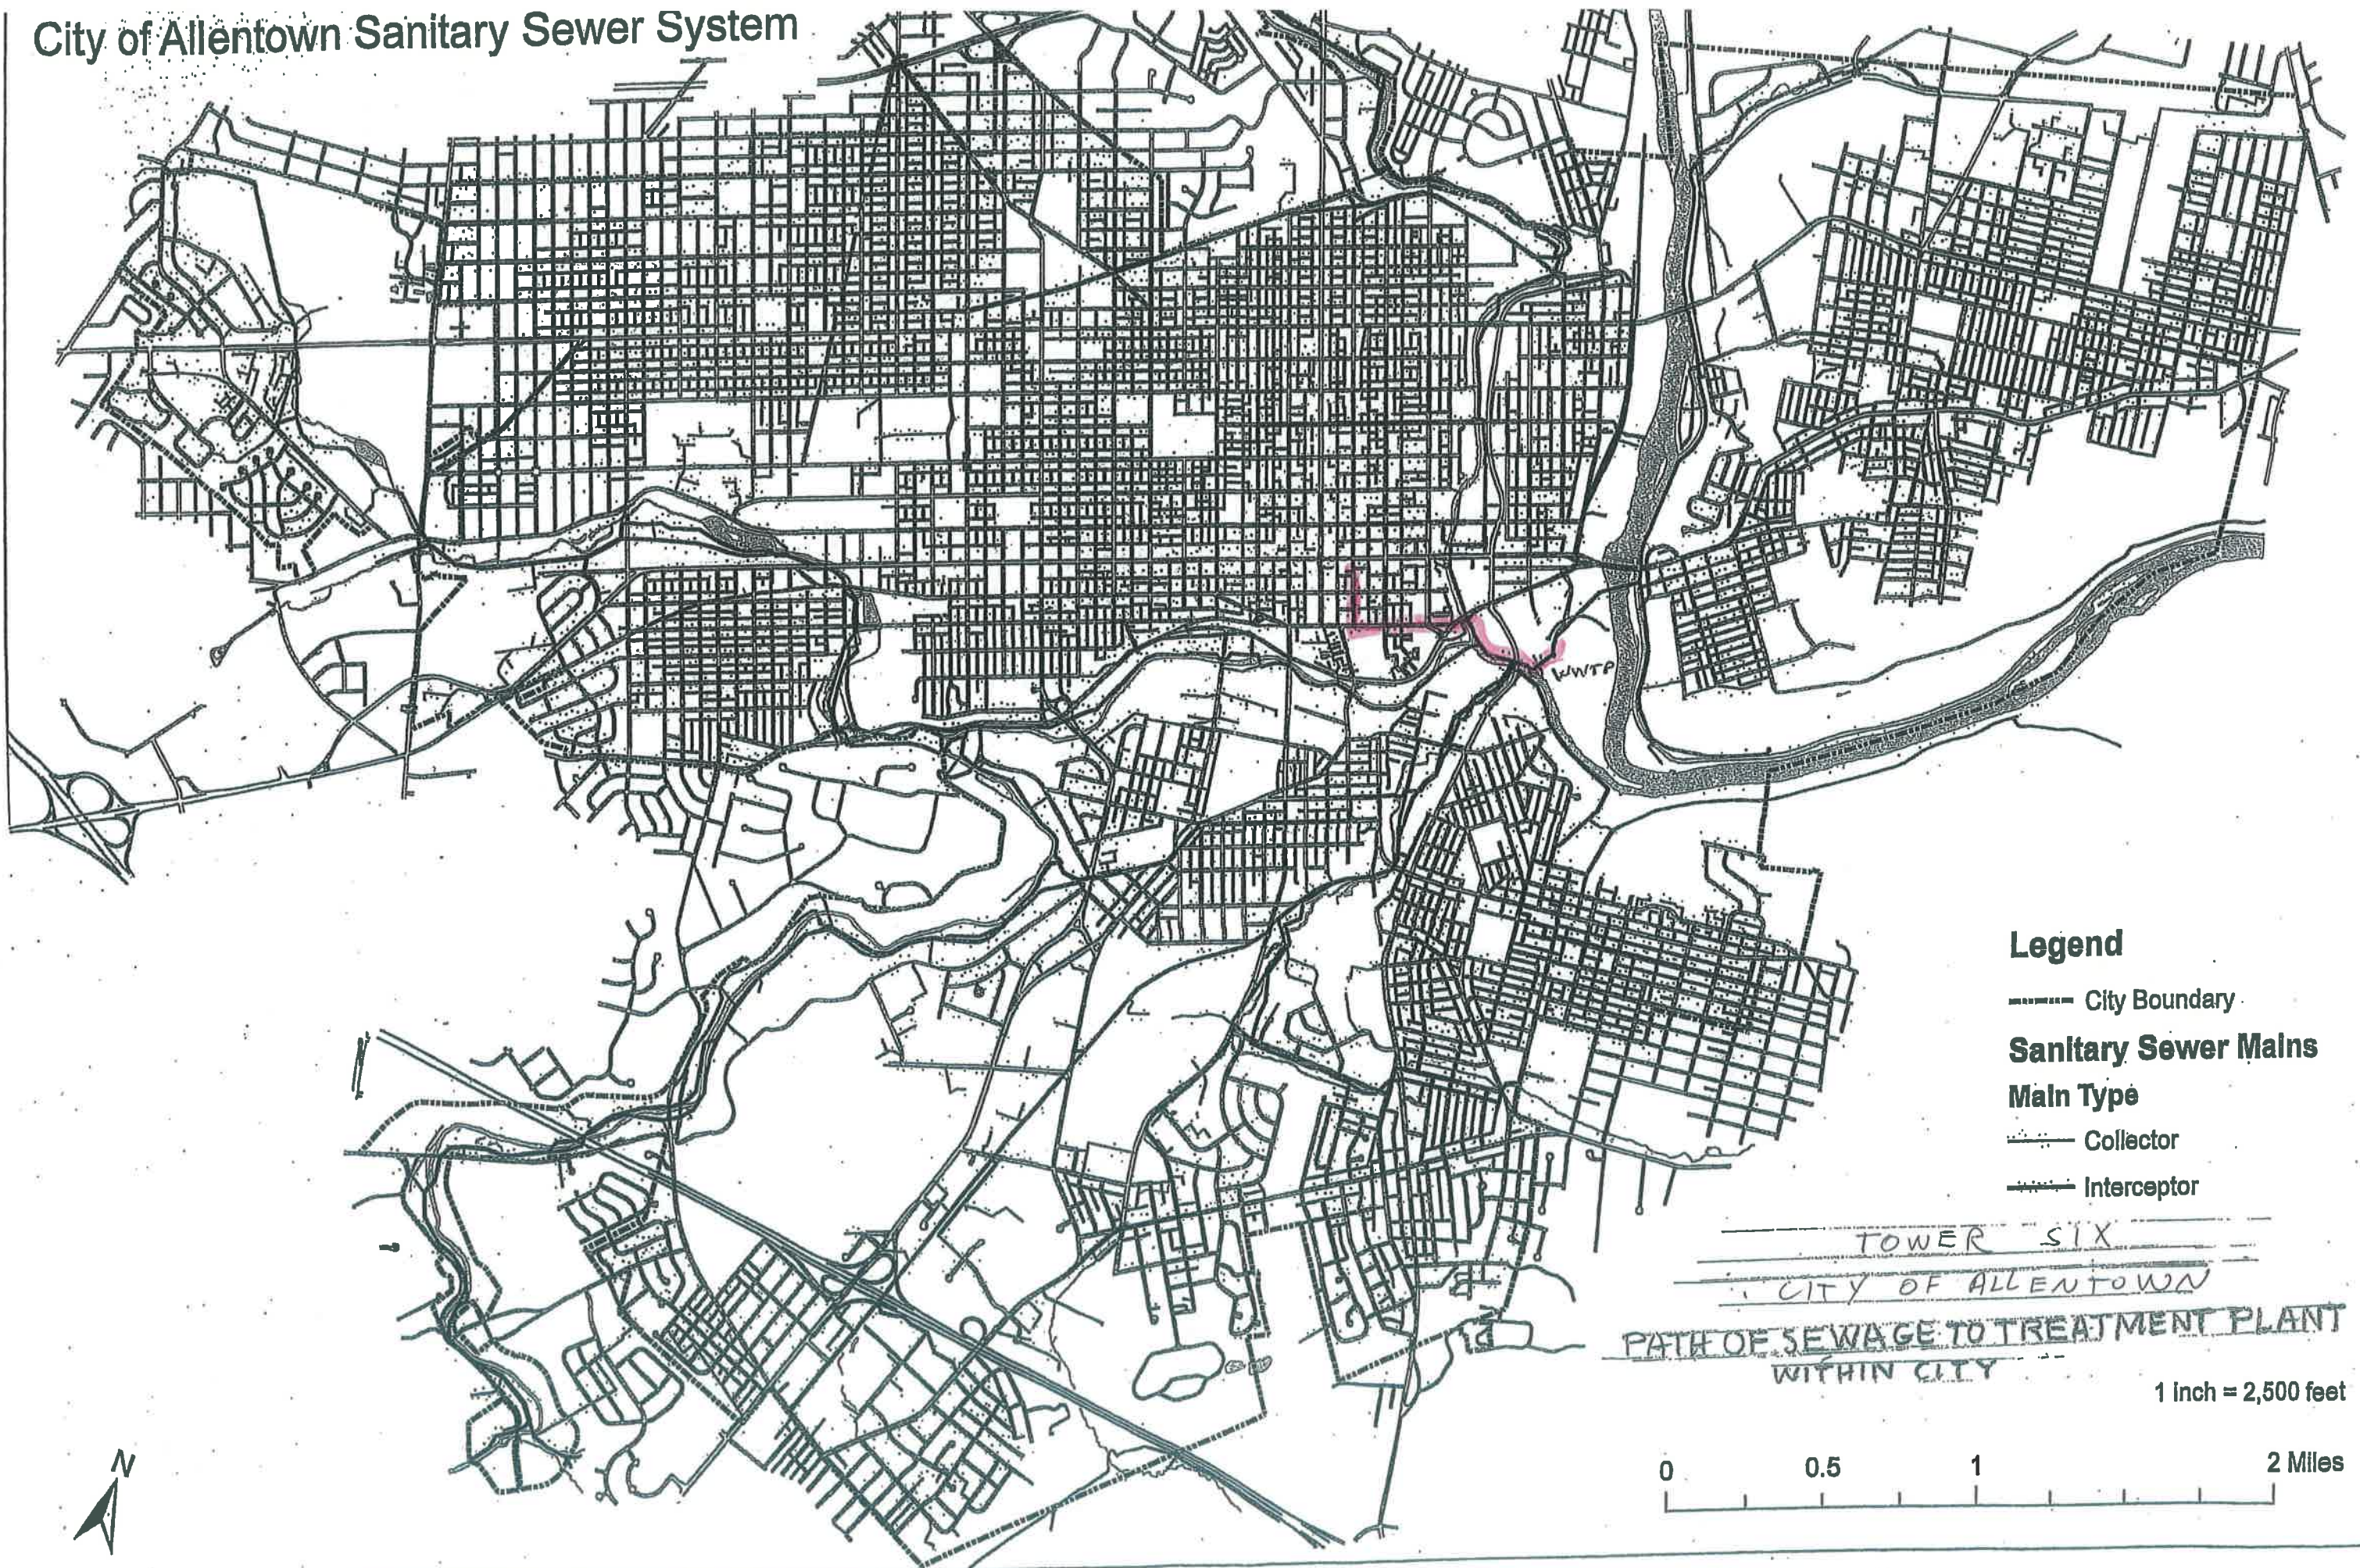

Legend

----- City Boundary

Sanitary Sewer Mains

Main Type

----- Collector

----- Interceptor

TOWER SIX
CITY OF ALLENTOWN
PATH OF SEWAGE TO TREATMENT PLANT
WITHIN CITY

1 inch = 2,500 feet



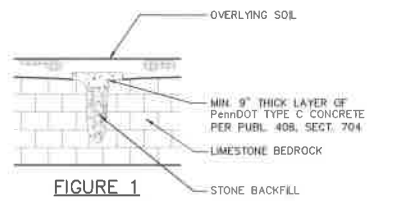


FIGURE 1
 FIGURE 1 REPRESENTS A SINKHOLE CREATED BY A SOLUTION CAVITY WHICH PINCHES OUT WITH DEPTH. THIS TYPE OF SINKHOLE IS USUALLY SMALL. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SINKHOLE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.

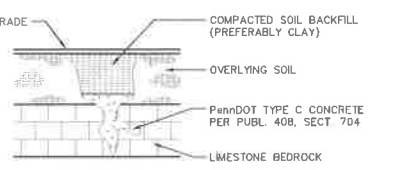


FIGURE 2
 FIGURE 2 REPRESENTS AN ACTIVE SINKHOLE NEAR THE GROUND SURFACE. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SINKHOLE.
 B. PLUGGING THE SHALLOW HOLE WITH CONCRETE.
 C. BACKFILLING OVER THE CONCRETE WITH COMPACTED SOIL (PREFERABLY CLAY) TO THE SURROUNDING GROUND SURFACE.
 EACH SINKHOLE PRESENTS A SLIGHTLY DIFFERENT SITUATION AND CORRECTIVE METHODS WILL VARY. REGARDLESS OF THE METHOD USED, SURFACE DRAINAGE MUST BE DIRECTED FROM THE CORRECTED SINKHOLE AND EXTREME CARE MUST BE TAKEN TO COMPLETELY SEAL THE SINKHOLE AND THEREBY PREVENT ANY REOCCURRENCE.
 A PROFESSIONAL GEOLOGIST OR SOILS ENGINEER SHALL BE CONSULTED DURING CONSTRUCTION ACTIVITY IN THE VICINITY OF ANY KNOWN CLOSED DEPRESSIONS, SINK HOLES, ROCK OUTCROPS, FRACTURE TRACES, ETC. OR IF ANY ABNORMAL SOIL OR SUBGRADE CONDITIONS ARE ENCOUNTERED ELSEWHERE ON THE SITE. ANY PREVENTATIVE AND/OR CORRECTIVE MEASURES TO BE TAKEN WILL BE DONE AS DIRECTED BY THE PROFESSIONAL GEOLOGIST OR SOILS ENGINEER BASED UPON SITE-SPECIFIC NEEDS DURING THE CONSTRUCTION ACTIVITY.

SINKHOLE REMEDIATION
 NO SCALE
 05/2004

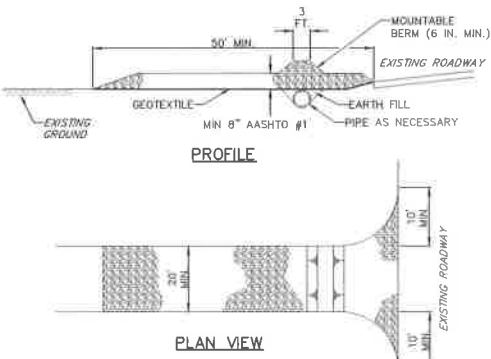


FIGURE 3
 FIGURE 3 REPRESENTS A ROCK CONSTRUCTION ENTRANCE. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE ENTRANCE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE ENTRANCE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 MOUNTABLE BERM USED TO PROVIDE PROPER COVER FOR PIPE.
 NOTES:
 REMOVE TOPSOIL PRIOR TO INSTALLATION OF ROCK CONSTRUCTION ENTRANCE. EXTEND ROCK OVER FULL WIDTH OF ENTRANCE.
 RUNOFF SHALL BE DIVERTED FROM ROADWAY TO A SUITABLE SEDIMENT REMOVAL BMP PRIOR TO ENTERING ROCK CONSTRUCTION ENTRANCE.
 MOUNTABLE BERM SHALL BE INSTALLED WHEREVER OPTIONAL CULVERT PIPE IS USED AND PROPER PIPE COVER AS SPECIFIED BY MANUFACTURER IS NOT OTHERWISE PROVIDED. PIPE SHALL BE SIZED APPROPRIATELY FOR SIZE OF DITCH BEING CROSSED.
 MAINTENANCE ROCK CONSTRUCTION ENTRANCE THICKNESS SHALL BE CONSTANTLY MAINTAINED TO THE SPECIFIED DIMENSIONS BY ADDING ROCK. A STOCKPILE SHALL BE MAINTAINED ON SITE FOR THIS PURPOSE. ALL SEDIMENT DEPOSITED ON PAVED ROADWAYS SHALL BE REMOVED AND RETURNED TO THE CONSTRUCTION SITE IMMEDIATELY IF EXCESSIVE AMOUNTS OF SEDIMENT ARE BEING DEPOSITED ON ROADWAY. EXTEND LENGTH OF ROCK CONSTRUCTION ENTRANCE BY 50 FOOT INCREMENTS UNTIL CONDITION IS ALLEVIATED OR INSTALL WASH RACK. WASHING THE ROADWAY OR SWEEPING THE DEPOSITS INTO ROADWAY DITCHES, SEWERS, CULVERTS, OR OTHER DRAINAGE COURSES IS NOT ACCEPTABLE.

**STANDARD CONSTRUCTION DETAIL #3-1
 ROCK CONSTRUCTION ENTRANCE**
 NOT TO SCALE

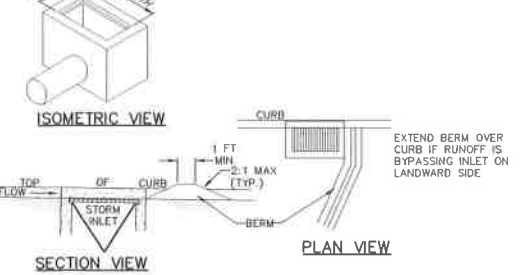
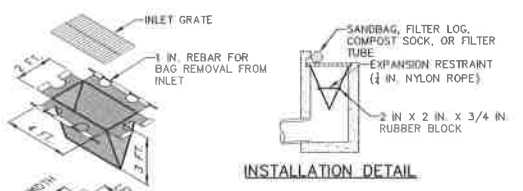


FIGURE 4
 FIGURE 4 REPRESENTS A FILTER BAG INLET PROTECTION. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 MAXIMUM DRAINAGE AREA = 1/2 ACRE.
 INLET PROTECTION SHALL NOT BE REQUIRED FOR INLET TRIBUTARY TO SEDIMENT BASIN OR TRAP BERMS SHALL BE REQUIRED FOR ALL INSTALLATIONS.
 ROLLED EARTHEN BERM SHALL BE MAINTAINED UNTIL ROADWAY IS PAVED. ROAD SUBBASE BERM SHALL BE MAINTAINED UNTIL ROADWAY SURFACE RECEIVES FINAL COAT.
 AT A MINIMUM, THE FABRIC SHALL HAVE A MINIMUM GRAB TENSILE STRENGTH OF 120 LBS. A MINIMUM BURST STRENGTH OF 200 PSI, AND A MINIMUM TRAPEZOIDAL TEAR STRENGTH OF 50 LBS. FILTER BAGS SHALL BE CAPABLE OF TRAPPING ALL PARTICLES NOT PASSING A NO. 40 SIEVE.
 INLET FILTER BAGS SHALL BE INSPECTED ON A WEEKLY BASIS AND AFTER EACH RUNOFF EVENT BAGS SHALL BE EMPTIED AND RINSED OR REPLACED WHEN HALF FULL OR WHEN FLOW CAPACITY HAS BEEN REDUCED 50% AS TO CAUSE FLOODING OR BYPASSING OF THE INLET. DAMAGED OR CLOGGED BAGS SHALL BE REPLACED. A SUPPLY SHALL BE MAINTAINED ON SITE FOR REPLACEMENT OF BAGS. ALL NEEDED REPAIRS SHALL BE INITIATED IMMEDIATELY AFTER THE INSPECTION. DISPOSE OF ACCUMULATED SEDIMENT AS WELL AS ALL USED BAGS ACCORDING TO THE PLAN NOTES.
 DO NOT USE ON MAJOR PAVED ROADWAYS WHERE PONDING MAY CAUSE TRAFFIC HAZARDS.

**STANDARD CONSTRUCTION DETAIL #4-15
 FILTER BAG INLET PROTECTION - TYPE C INLET**
 NOT TO SCALE

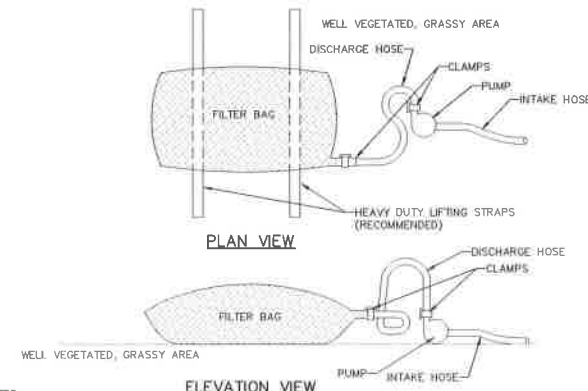


FIGURE 5
 FIGURE 5 REPRESENTS A PUMPED WATER FILTER BAG. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 LOW VOLUME FILTER BAGS SHALL BE MADE FROM NON-WOVEN GEOTEXTILE MATERIAL SEWN WITH HIGH STRENGTH, DOUBLE STITCHED "J" TYPE SEAMS. THEY SHALL BE CAPABLE OF TRAPPING PARTICLES LARGER THAN 150 MICRONS. HIGH VOLUME FILTER BAGS SHALL BE MADE FROM WOVEN GEOTEXTILES THAT MEET THE FOLLOWING STANDARDS:

PROPERTY	TEST METHOD	MINIMUM STANDARD
AVG. WIDE WIDTH STRENGTH	ASTM D-4884	60 LB/IN
GRAB TENSILE	ASTM D-4852	205 LB
PUNCTURE	ASTM D-4853	110 LB
MULLEN BURST	ASTM D-3786	350 PSI
UV RESISTANCE	ASTM D-4355	70%
ADS % RETAINED	ASTM D-4751	80 SIEVE

 A SUITABLE MEANS OF ACCESSING THE BAG WITH MACHINERY REQUIRED FOR DISPOSAL PURPOSES SHALL BE PROVIDED. FILTER BAGS SHALL BE REPLACED WHEN THEY BECOME 1/2 FULL OF SEDIMENT. SPARE BAGS SHALL BE KEPT AVAILABLE FOR REPLACEMENT OF THOSE THAT HAVE FAILED OR ARE FILLED. BAGS SHALL BE PLACED ON STRAPS TO FACILITATE REMOVAL. UNLESS BAGS COME WITH LIFTING STRAPS ALREADY ATTACHED.
 BAGS SHALL BE LOCATED IN WELL-VEGETATED (GRASSY) AREA, AND DISCHARGE ONTO STABLE, EROSION RESISTANT AREAS. WHERE THIS IS NOT POSSIBLE, A GEOTEXTILE UNDERLAYMENT AND FLOW PATH SHALL BE PROVIDED. BAGS MAY BE PLACED ON FILTER STONE TO INCREASE DISCHARGE CAPACITY. BAGS SHALL NOT BE PLACED ON SLOPES GREATER THAN 5% FOR SLOPES EXCEEDING 5%. CLEAN ROCK OR OTHER NON-ERODIBLE AND NON-POLLUTING MATERIAL MAY BE PLACED UNDER THE BAG TO REDUCE SLOPE STEEPNESS.
 NO DOWNSLOPE SEDIMENT BARRIER IS REQUIRED FOR MOST INSTALLATIONS. COMPOST BERM OR COMPOST FILTER SOCK SHALL BE INSTALLED BELOW BAGS LOCATED IN HO OR EV WATERSHEDS. WITHIN 50 FEET OF ANY RECEIVING SURFACE WATER OR WHERE GRASSY AREA IS NOT AVAILABLE.
 THE PUMP DISCHARGE HOSE SHALL BE INSERTED INTO THE BAGS IN THE MANNER SPECIFIED BY THE MANUFACTURER AND SECURELY CLAMPED. A PIECE OF PVC PIPE IS RECOMMENDED FOR THIS PURPOSE.
 THE PUMPING RATE SHALL BE NO GREATER THAN 750 GPM OR 1/2 THE MAXIMUM SPECIFIED BY THE MANUFACTURER, WHICHEVER IS LESS. PUMP INTAKES SHALL BE FLOATING AND SCREENED.
 FILTER BAGS SHALL BE INSPECTED DAILY. IF ANY PROBLEM IS DETECTED, PUMPING SHALL CEASE IMMEDIATELY AND NOT RESUME UNTIL THE PROBLEM IS CORRECTED.

**STANDARD CONSTRUCTION DETAIL #3-16
 PUMPED WATER FILTER BAG**
 NOT TO SCALE

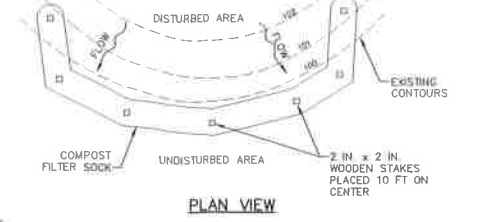
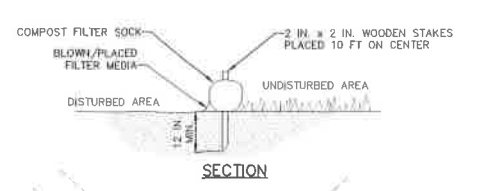


FIGURE 6
 FIGURE 6 REPRESENTS A COMPOST FILTER SOCK. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 SOCK FABRIC SHALL MEET STANDARDS OF TABLE 4.1 OF THE PA DEP EROSION CONTROL MANUAL. COMPOST SHALL MEET THE STANDARDS OF TABLE 4.2 OF THE PA DEP EROSION CONTROL MANUAL.
 COMPOST FILTER SOCK SHALL BE PLACED AT EXISTING LEVEL GRADE. BOTH ENDS OF THE BARRIER SHALL BE EXTENDED AT LEAST 8 FEET UP SLOPE AT 45 DEGREES TO THE MAIN BARRIER ALIGNMENT. MAXIMUM SLOPE LENGTH ABOVE ANY BARRIER SHALL NOT EXCEED THAT SPECIFIED FOR THE SIZE OF THE SOCK AND THE SLOPE OF ITS TRIBUTARY AREA.
 TRAFFIC SHALL NOT BE PERMITTED TO CROSS COMPOST FILTER SOCKS.
 ACCUMULATED SEDIMENT SHALL BE REMOVED WHEN IT REACHES 1/2 THE ABOVE GROUND HEIGHT OF THE BARRIER AND DISPOSED IN THE MANNER DESCRIBED ELSEWHERE IN THE PLAN.
 COMPOST FILTER SOCKS SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
 BIODEGRADABLE COMPOST FILTER SOCKS SHALL BE REPLACED AFTER 6 MONTHS. PHOTODEGRADABLE SOCKS AFTER 1 YEAR. POLYPROPYLENE SOCKS SHALL BE REPLACED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.
 UPON STABILIZATION OF THE AREA TRIBUTARY TO THE SOCK, STAKES SHALL BE REMOVED. THE SOCK MAY BE LEFT IN PLACE AND VEGETATED OR REMOVED IN THE LATTER CASE, THE MESH SHALL BE CUT OPEN AND THE MULCH SPREAD AS A SOIL SUPPLEMENT.

**STANDARD CONSTRUCTION DETAIL #4-1
 COMPOST FILTER SOCK**
 NOT TO SCALE

FILTER SOCK NOTE:
 ALL FILTER SOCKS ARE TO BE INSTALLED BY A CERTIFIED FILTREXX INSTALLER. CONTACT FILTREXX INTERNATIONAL FOR THE NEAREST INSTALLER AT (440) 926-2607.

**TABLE 4.1
 Compost Sock Fabric Minimum Specifications**

Material Type	3 mil HDPE	5 mil HDPE	5 mil HDPE	Multi-Filament Polypropylene (MFPP)	Heavy Duty Multi-Filament Polypropylene (HDMFPP)
Material Characteristics	Photo-degradable	Photo-degradable	Bio-degradable	Photo-degradable	Photo-degradable
Sock Diameters	12" 18"	12" 18" 24" 32"	12" 18" 24" 32"	12" 18" 24" 32"	12" 18" 24" 32"
Mesh Opening	3/8"	3/8"	3/8"	3/8"	1/8"
Tensile Strength		26 psi	26 psi	44 psi	202 psi
Ultraviolet Stability % Original Strength (ASTM G-155)	23% at 1000 hr.	23% at 1000 hr.		100% at 1000 hr.	100% at 1000 hr.
Minimum Functional Longevity	6 months	9 months	6 months	1 year	2 years

Two-ply systems

Inner Containment Netting	HDPE biaxial net Continuously wound Fusion-welded junctures 3/4" X 3/4" Max. aperture size
Outer Filtration Mesh	Composite Polypropylene Fabric (Woven layer and non-woven fleece mechanically fused via needle punch) 3/16" Max. aperture size

Sock fabrics composed of burlap may be used on projects lasting 6 months or less.
 Filtrexx & JMD

Compost should be a well decomposed, weed-free organic matter derived from agriculture, food, slum grindings, and yard or wood/bark organic matter sources. The compost should be aerobically composted. The compost should possess no objectionable odors and should be reasonably free (<1%

**TABLE 4.2
 Compost Standards**

Organic Matter Content	25% - 100% (dry weight basis)
Organic Portion	Fibrous and elongated 6:1 - 8:1
Medium Content	30% - 60%
Particle Size	30% - 60% pass through 3/8" sieve
Soluble Salt Concentration	5.0 g/l (maximum)

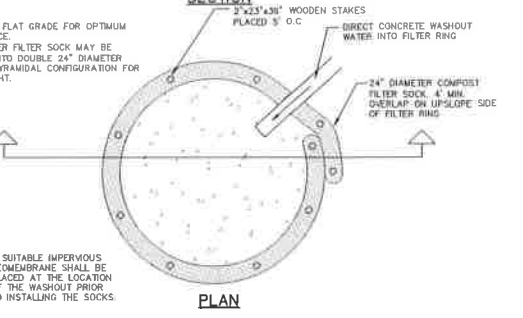
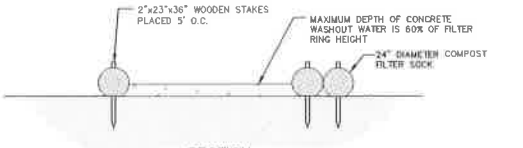


FIGURE 7
 FIGURE 7 REPRESENTS A COMPOST SOCK CONCRETE WASHOUT DETAIL. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 1. INSTALL ON FLAT GRADE FOR OPTIMUM PERFORMANCE.
 2. 18\"/>

**STANDARD CONSTRUCTION DETAIL #4-6
 ROCK FILTER OUTLET**
 NOT TO SCALE



FIGURE 8
 FIGURE 8 REPRESENTS A ROCK FILTER OUTLET. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 A ROCK FILTER OUTLET SHALL BE INSTALLED WHERE FAILURE OF A SILT FENCE OR STRAW BALE BARRIER HAS OCCURRED DUE TO CONCENTRATED FLOW. ANCHORED COMPOST LAYER SHALL BE USED ON UPSLOPE FACE IN HO AND EV WATERSHEDS.
 SEDIMENT SHALL BE REMOVED WHEN ACCUMULATIONS REACH 1/3 THE HEIGHT OF THE OUTLET.

**STANDARD CONSTRUCTION DETAIL #4-8
 COMPOST FILTER SOCK**
 NOT TO SCALE



FIGURE 9
 FIGURE 9 REPRESENTS A COMPOST FILTER SOCK. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 SOCK FABRIC SHALL MEET STANDARDS OF TABLE 4.1 OF THE PA DEP EROSION CONTROL MANUAL. COMPOST SHALL MEET THE STANDARDS OF TABLE 4.2 OF THE PA DEP EROSION CONTROL MANUAL.
 COMPOST FILTER SOCK SHALL BE PLACED AT EXISTING LEVEL GRADE. BOTH ENDS OF THE BARRIER SHALL BE EXTENDED AT LEAST 8 FEET UP SLOPE AT 45 DEGREES TO THE MAIN BARRIER ALIGNMENT. MAXIMUM SLOPE LENGTH ABOVE ANY BARRIER SHALL NOT EXCEED THAT SPECIFIED FOR THE SIZE OF THE SOCK AND THE SLOPE OF ITS TRIBUTARY AREA.
 TRAFFIC SHALL NOT BE PERMITTED TO CROSS COMPOST FILTER SOCKS.
 ACCUMULATED SEDIMENT SHALL BE REMOVED WHEN IT REACHES 1/2 THE ABOVE GROUND HEIGHT OF THE BARRIER AND DISPOSED IN THE MANNER DESCRIBED ELSEWHERE IN THE PLAN.
 COMPOST FILTER SOCKS SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
 BIODEGRADABLE COMPOST FILTER SOCKS SHALL BE REPLACED AFTER 6 MONTHS. PHOTODEGRADABLE SOCKS AFTER 1 YEAR. POLYPROPYLENE SOCKS SHALL BE REPLACED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.
 UPON STABILIZATION OF THE AREA TRIBUTARY TO THE SOCK, STAKES SHALL BE REMOVED. THE SOCK MAY BE LEFT IN PLACE AND VEGETATED OR REMOVED IN THE LATTER CASE, THE MESH SHALL BE CUT OPEN AND THE MULCH SPREAD AS A SOIL SUPPLEMENT.

**STANDARD CONSTRUCTION DETAIL #4-9
 COMPOST FILTER SOCK**
 NOT TO SCALE



FIGURE 10
 FIGURE 10 REPRESENTS A COMPOST FILTER SOCK. THE METHOD USED FOR ITS CORRECTION INCLUDES:
 A. EXCAVATING THE OVERLYING SOIL FROM AROUND THE SURFACE TO THE EXTENT NECESSARY TO DETERMINE THE APPROPRIATE CORRECTION METHOD AND TO EXPOSE A COMPETENT LIMESTONE BEDROCK LEDGE AROUND THE SURFACE.
 B. BACKFILLING WITH STONE.
 C. CAPPING THE STONE BACKFILL WITH A LAYER OF CONCRETE WHICH EXTENDS SEVERAL FEET OVER THE COMPETENT LIMESTONE BEDROCK LEDGE WHICH HAS BEEN EXPOSED.
 D. COVERING THE LAYER OF CONCRETE WITH SOIL TO MATCH THE SURROUNDING GRADE.
 NOTES:
 SOCK FABRIC SHALL MEET STANDARDS OF TABLE 4.1 OF THE PA DEP EROSION CONTROL MANUAL. COMPOST SHALL MEET THE STANDARDS OF TABLE 4.2 OF THE PA DEP EROSION CONTROL MANUAL.
 COMPOST FILTER SOCK SHALL BE PLACED AT EXISTING LEVEL GRADE. BOTH ENDS OF THE BARRIER SHALL BE EXTENDED AT LEAST 8 FEET UP SLOPE AT 45 DEGREES TO THE MAIN BARRIER ALIGNMENT. MAXIMUM SLOPE LENGTH ABOVE ANY BARRIER SHALL NOT EXCEED THAT SPECIFIED FOR THE SIZE OF THE SOCK AND THE SLOPE OF ITS TRIBUTARY AREA.
 TRAFFIC SHALL NOT BE PERMITTED TO CROSS COMPOST FILTER SOCKS.
 ACCUMULATED SEDIMENT SHALL BE REMOVED WHEN IT REACHES 1/2 THE ABOVE GROUND HEIGHT OF THE BARRIER AND DISPOSED IN THE MANNER DESCRIBED ELSEWHERE IN THE PLAN.
 COMPOST FILTER SOCKS SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
 BIODEGRADABLE COMPOST FILTER SOCKS SHALL BE REPLACED AFTER 6 MONTHS. PHOTODEGRADABLE SOCKS AFTER 1 YEAR. POLYPROPYLENE SOCKS SHALL BE REPLACED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.
 UPON STABILIZATION OF THE AREA TRIBUTARY TO THE SOCK, STAKES SHALL BE REMOVED. THE SOCK MAY BE LEFT IN PLACE AND VEGETATED OR REMOVED IN THE LATTER CASE, THE MESH SHALL BE CUT OPEN AND THE MULCH SPREAD AS A SOIL SUPPLEMENT.

FOR RETIEW ASSOCIATES BY:

MANAGER: DAVID MILLER, P.E.
 DESIGN BY: DDM
 SURVY CHIEF: REIDBOOK NO. DATA COLLECTOR: DDM
 DRAWN BY: ASN
 CHECKED BY: DDM

DATE: 10/10/16
 NO. 1061092000

DAVID D. MILLER
 P.A. LIC. # PE-054980-E

INCLUDE BELLO PROPERTIES

REVISION

CITY CENTER
 CLIENT: CITY CENTER INVESTMENT CORP.
 645 HAMILTON STREET, SUITE 600
 ALLENTOWN, PA 18101

REVIEW Associates, Inc.
 515 Wharton Street, Ste 500, Allentown, PA 18101
 Phone: (610) 262-4225
 Fax: (610) 262-4225
 Email: reid@review.com
 Website: www.review.com

Engineers • Planners • Surveyors • Landscape Architects
 Environmental Consultants

AS NOTED

EROSION & SEDIMENT CONTROL DETAILS
 FINAL LAND DEVELOPMENT PLAN
 FOR
TOWER SIX
 CITY OF ALLENTOWN, 2ND WARD
 LEHIGH COUNTY, PA

DATE: MAY 24, 2016
 SHEET NO. C-12 OF 14
 DWG. NO. 1061092000

SECTION 3.6

PHMC COMMENTS

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

Manyi Yeung

From: Walbert, David <dwalbert@pa.gov>
Sent: Monday, April 06, 2015 7:08 AM
To: Manyi Yeung
Subject: RE: Planning Module - PHMC review

That's correct.

David C. Walbert | Sewage Planning Specialist
Department of Environmental Protection
Bethlehem District Office
4530 Bath Pike | Bethlehem, PA 18017-9074
Phone: 610.861.2157 | Fax: 610.861.2072
www.depweb.state.pa.us

From: Manyi Yeung [mailto:myeung@rettew.com]
Sent: Thursday, April 02, 2015 3:24 PM
To: Walbert, David
Cc: Michele Braas
Subject: Planning Module - PHMC review

Hi Dave,

Thank you for taking the time to answer my question regarding PHMC requirement. Per our conversation, please reply and confirm that when earth disturbance is less than 10 acres, PHMC archeological resource screening is not required to submit to PADEP as part of the Planning Module Application.

Thanks,
Manyi

RETTEW

We answer to you.

An Engineering News-Record Top Design Firm

Manyi Yeung, EIT
Engineer
5031 Richard Lane
Suite #111
Mechanicsburg, Pa. 17055
Office: 717.697.3551 x3359
www.rettew.com

SECTION 3.7

PNDI RECEIPT

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

1. PROJECT INFORMATION

Project Name: **Tower 6**

Date of Review: **5/23/2016 09:30:43 AM**

Project Category: **Development, New commercial/industrial development (store, gas station, factory)**

Project Area: **0.84 acres**

County(s): **Lehigh**

Township/Municipality(s): **ALLENTOWN**

ZIP Code: **18101**

Quadrangle Name(s): **ALLENTOWN EAST**

Watersheds HUC 8: **Lehigh**

Watersheds HUC 12: **Little Lehigh Creek-Lehigh River**

Decimal Degrees: **40.602312, -75.469937**

Degrees Minutes Seconds: **40° 36' 8.3240" N, 75° 28' 11.7745" W**


2. SEARCH RESULTS

Agency	Results	Response
PA Game Commission	Potential Impact	FURTHER REVIEW IS REQUIRED, See Agency Response
PA Department of Conservation and Natural Resources	No Known Impact	No Further Review Required
PA Fish and Boat Commission	No Known Impact	No Further Review Required
U.S. Fish and Wildlife Service	No Known Impact	No Further Review Required

As summarized above, Pennsylvania Natural Diversity Inventory (PNDI) records indicate there may be potential impacts to threatened and endangered and/or special concern species and resources within the project area. If the response above indicates "No Further Review Required" no additional communication with the respective agency is required. If the response is "Further Review Required" or "See Agency Response," refer to the appropriate agency comments below. Please see the DEP Information Section of this receipt if a PA Department of Environmental Protection Permit is required.

Note that regardless of PNDI search results, projects requiring a Chapter 105 DEP individual permit or GP 5, 6, 7, 8, 9 or 11 in certain counties (Adams, Berks, Bucks, Carbon, Chester, Cumberland, Delaware, Lancaster, Lebanon, Lehigh, Monroe, Montgomery, Northampton, Schuylkill and York) must comply with the bog turtle habitat screening requirements of the PASPGP.

Tower 6

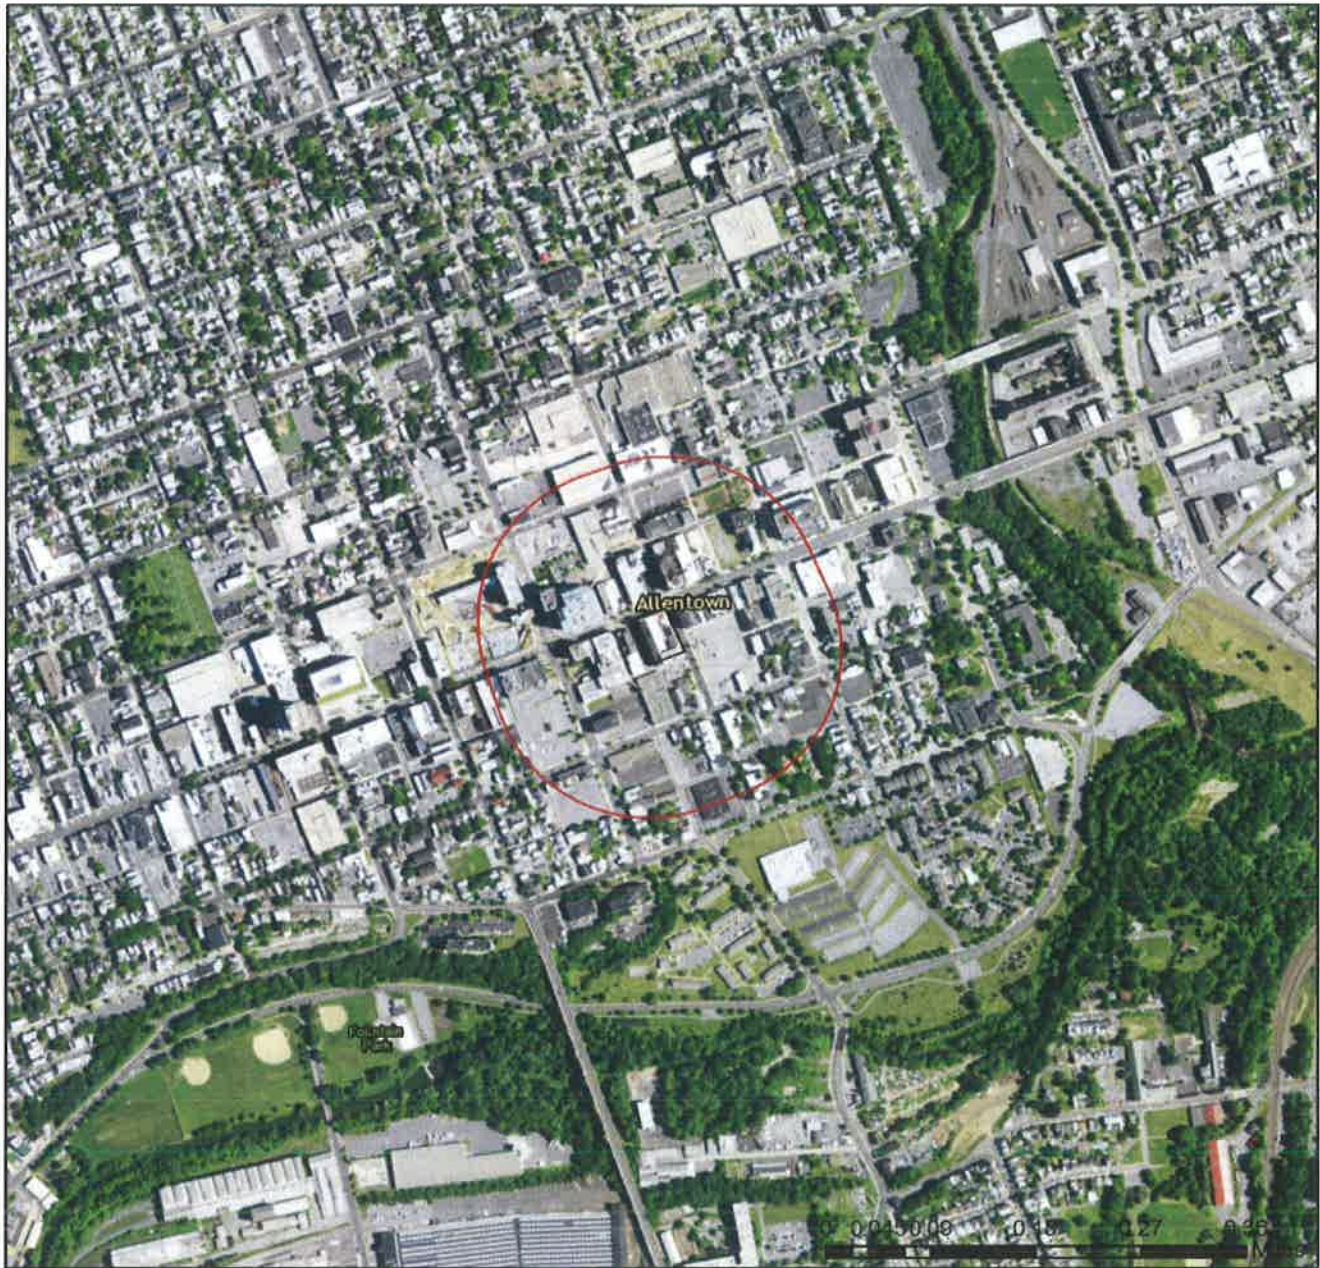


- Project Boundary
- Buffered Project Boundary



Service Layer Credits: Sources: Esri, HERE, DeLorme, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community
Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA,

Tower 6

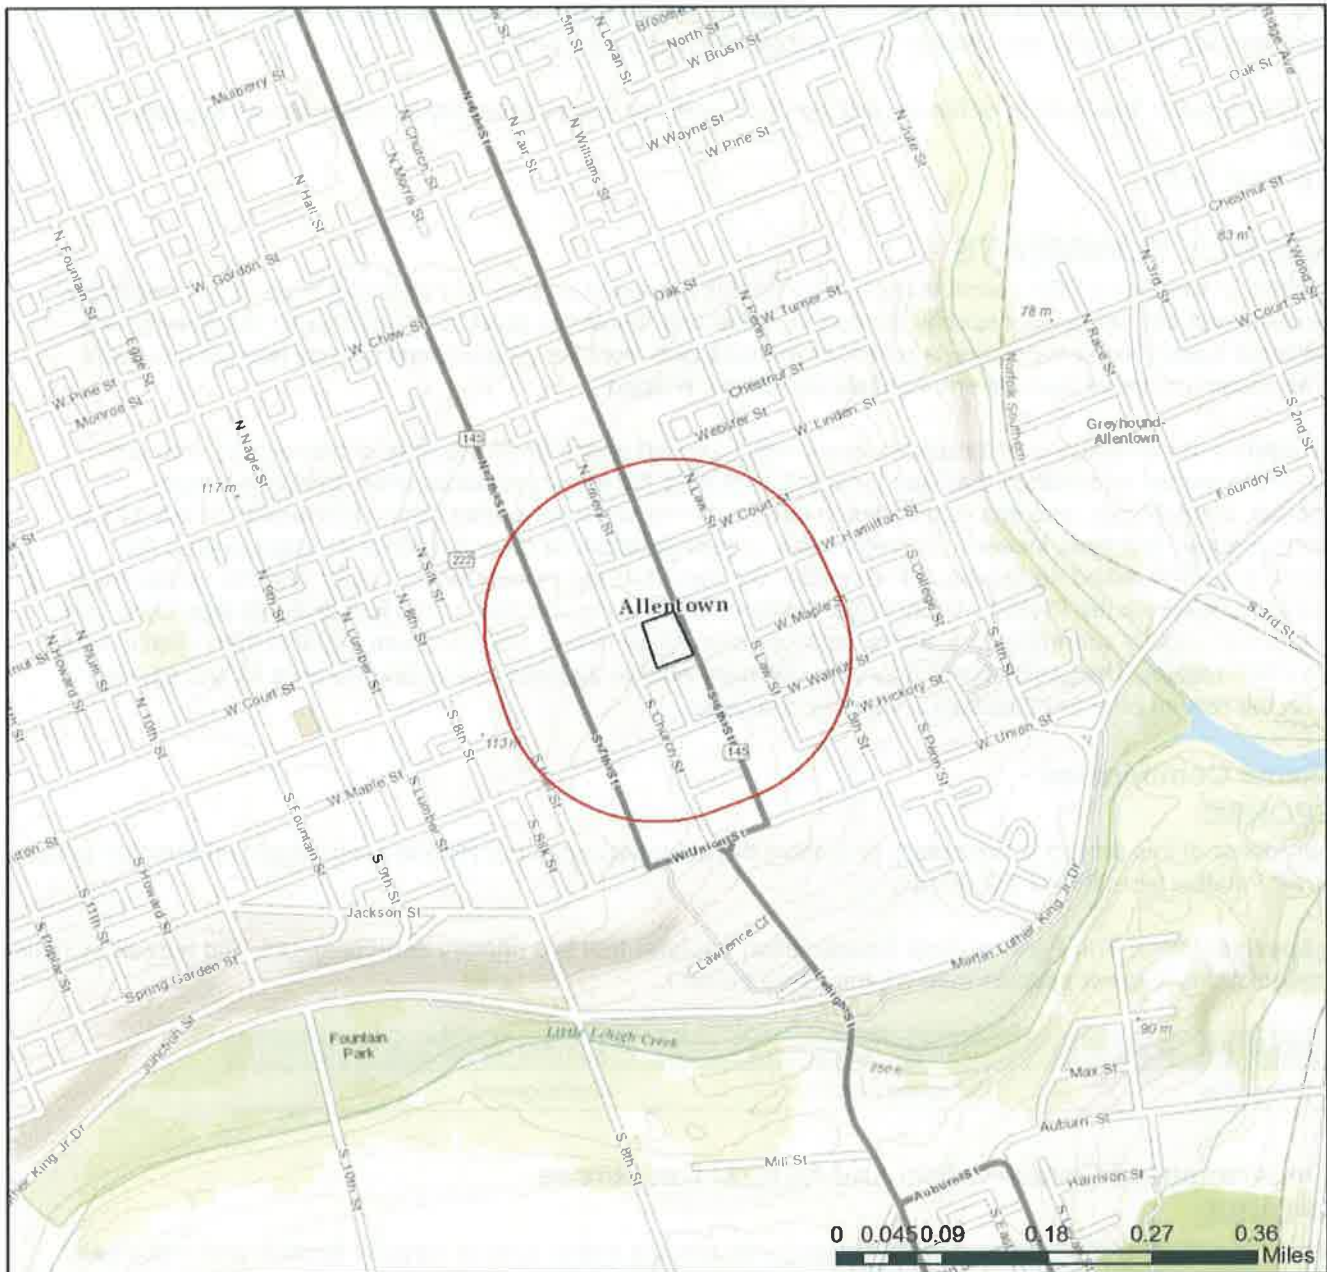

- Project Boundary
- Buffered Project Boundary



Service Layer Credits: Sources: Esri, HERE, DeLorme, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

RESPONSE TO QUESTION(S) ASKED

Q1: The proposed project is in the range of federally-listed bats. Describe how the project will affect bat habitat (forests, woodlots and trees) and indicate what measures will be taken in consideration of this.

Your answer is: No forests, woodlots or trees will be affected by the project.

Q2: Is tree removal, tree cutting or forest clearing of 40 acres or more necessary to implement all aspects of this project?

Your answer is: No

3. AGENCY COMMENTS

Regardless of whether a DEP permit is necessary for this proposed project, any potential impacts to threatened and endangered species and/or special concern species and resources must be resolved with the appropriate jurisdictional agency. In some cases, a permit or authorization from the jurisdictional agency may be needed if adverse impacts to these species and habitats cannot be avoided.

These agency determinations and responses are **valid for two years** (from the date of the review), and are based on the project information that was provided, including the exact project location; the project type, description, and features; and any responses to questions that were generated during this search. If any of the following change: 1) project location, 2) project size or configuration, 3) project type, or 4) responses to the questions that were asked during the online review, the results of this review are not valid, and the review must be searched again via the PNDI Environmental Review Tool and resubmitted to the jurisdictional agencies. The PNDI tool is a primary screening tool, and a desktop review may reveal more or fewer impacts than what is listed on this PNDI receipt. The jurisdictional agencies **strongly advise against** conducting surveys for the species listed on the receipt prior to consultation with the agencies.

PA Game Commission

RESPONSE:

Further review of this project is necessary to resolve the potential impact(s). Please send project information to this agency for review (see WHAT TO SEND).

PGC Species: (Note: The Pennsylvania Conservation Explorer tool is a primary screening tool, and a desktop review may reveal more or fewer species than what is listed below.)

Scientific Name	Common Name	Current Status
Falco peregrinus	Peregrine Falcon	Endangered

PA Department of Conservation and Natural Resources

RESPONSE:

No Impact is anticipated to threatened and endangered species and/or special concern species and resources.

PA Fish and Boat Commission

RESPONSE:

No Impact is anticipated to threatened and endangered species and/or special concern species and resources.

U.S. Fish and Wildlife Service

RESPONSE:

No impacts to **federally** listed or proposed species are anticipated. Therefore, no further consultation/coordination under the Endangered Species Act (87 Stat. 884, as amended; 16 U.S.C. 1531 et seq. is required. Because no take of federally listed species is anticipated, none is authorized. This response does not reflect potential Fish and Wildlife Service concerns under the Fish and Wildlife Coordination Act or other authorities.

* Special Concern Species or Resource - Plant or animal species classified as rare, tentatively undetermined or candidate as well as other taxa of conservation concern, significant natural communities, special concern populations (plants or animals) and unique geologic features.

** Sensitive Species - Species identified by the jurisdictional agency as collectible, having economic value, or being susceptible to decline as a result of visitation.

WHAT TO SEND TO JURISDICTIONAL AGENCIES

If project information was requested by one or more of the agencies above, upload* or email* the following information to the agency(s). Instructions for uploading project materials can be found [here](#). This option provides the applicant with the convenience of sending project materials to a single location accessible to all three state agencies. Alternatively, applicants may email or mail their project materials (see AGENCY CONTACT INFORMATION).

***Note:** U.S.Fish and Wildlife Service requires applicants to mail project materials to the USFWS PA field office (see AGENCY CONTACT INFORMATION). USFWS will not accept project materials submitted electronically (by upload or email).

Check-list of Minimum Materials to be submitted:

___ Project narrative with a description of the overall project, the work to be performed, current physical characteristics of the site and acreage to be impacted.

___ A map with the project boundary and/or a basic site plan (particularly showing the relationship of the project to the physical features such as wetlands, streams, ponds, rock outcrops, etc.)

In addition to the materials listed above, USFWS REQUIRES the following

___ **SIGNED** copy of a Final Project Environmental Review Receipt

The inclusion of the following information may expedite the review process.

___ Color photos keyed to the basic site plan (i.e. showing on the site plan where and in what direction each photo was taken and the date of the photos)

___ Information about the presence and location of wetlands in the project area, and how this was determined (e.g., by a qualified wetlands biologist), if wetlands are present in the project area, provide project plans showing the location of all project features, as well as wetlands and streams.

4. DEP INFORMATION

The Pa Department of Environmental Protection (DEP) requires that a signed copy of this receipt, along with any required documentation from jurisdictional agencies concerning resolution of potential impacts, be submitted with applications for permits requiring PNDI review. Two review options are available to permit applicants for handling PNDI coordination in conjunction with DEP's permit review process involving either T&E Species or species of special concern. Under sequential review, the permit applicant performs a PNDI screening and completes all coordination with the appropriate jurisdictional agencies prior to submitting the permit application. The applicant will include with its application, both a PNDI receipt and/or a clearance letter from the jurisdictional agency if the PNDI Receipt shows a Potential Impact to a species or the applicant chooses to obtain letters directly from the jurisdictional agencies. Under concurrent review, DEP, where feasible, will allow technical review of the permit to occur concurrently with the T&E species consultation with the jurisdictional agency. The applicant must still supply a copy of the PNDI Receipt with its permit application. The PNDI Receipt should also be submitted to the appropriate agency according to directions on the PNDI Receipt. The applicant and the jurisdictional agency will work together to resolve the potential impact(s). See the DEP PNDI policy at <https://conservationexplorer.dcnr.pa.gov/content/resources>.

5. ADDITIONAL INFORMATION

The PNDI environmental review website is a preliminary screening tool. There are often delays in updating species status classifications. Because the proposed status represents the best available information regarding the conservation status of the species, state jurisdictional agency staff give the proposed statuses at least the same consideration as the current legal status. If surveys or further information reveal that a threatened and endangered and/or special concern species and resources exist in your project area, contact the appropriate jurisdictional agency/agencies immediately to identify and resolve any impacts.

For a list of species known to occur in the county where your project is located, please see the species lists by county found on the PA Natural Heritage Program (PNHP) home page (www.naturalheritage.state.pa.us). Also note that the PNDI Environmental Review Tool only contains information about species occurrences that have actually been reported to the PNHP.

6. AGENCY CONTACT INFORMATION

PA Department of Conservation and Natural Resources

Bureau of Forestry, Ecological Services Section
400 Market Street, PO Box 8552
Harrisburg, PA 17105-8552
Email: RA-HeritageReview@pa.gov
Fax: (717) 772-0271

PA Fish and Boat Commission

Division of Environmental Services
450 Robinson Lane, Bellefonte, PA 16823
Email: RA-FBPACENOTIFY@pa.gov

U.S. Fish and Wildlife Service

Pennsylvania Field Office
Endangered Species Section
110 Radnor Rd; Suite 101
State College, PA 16801
NO Faxes Please

PA Game Commission

Bureau of Wildlife Habitat Management
Division of Environmental Planning and Habitat Protection
2001 Elmerton Avenue, Harrisburg, PA 17110-9797
Email: RA-PGC_PNDI@pa.gov
NO Faxes Please

7. PROJECT CONTACT INFORMATION

Name: Ryan S. Coleman
Company/Business Name: RETTEW Associates, Inc.
Address: 3020 Columbia Avenue
City, State, Zip: Lancaster, PA 17603
Phone: (717) 394-3721 Fax: ()
Email: rcoleman@rettew.com

8. CERTIFICATION

I certify that ALL of the project information contained in this receipt (including project location, project size/configuration, project type, answers to questions) is true, accurate and complete. In addition, if the project type, location, size or configuration changes, or if the answers to any questions that were asked during this online review change, I agree to re-do the online environmental review.



applicant/project proponent signature

May 23, 2016
date



Division of Environmental
Planning and Habitat
Protection
717-783-5957

COMMONWEALTH OF PENNSYLVANIA
Pennsylvania Game Commission
2001 ELMERTON AVENUE
HARRISBURG, PA 17110-9797

*"To manage all wild birds, mammals and their habitats
for current and future generations."*

ADMINISTRATIVE BUREAUS:

ADMINISTRATION	717-787-5670
HUMAN RESOURCES	717-787-7836
FISCAL MANAGEMENT	717-787-7314
CONTRACTS AND PROCUREMENT	717-787-6594
LICENSING	717-787-2084
OFFICE SERVICES	717-787-2116
WILDLIFE MANAGEMENT	717-787-5529
INFORMATION & EDUCATION	717-787-6286
WILDLIFE PROTECTION	717-783-6526
WILDLIFE HABITAT MANAGEMENT	717-787-6818
REAL ESTATE DIVISION	717-787-6568
AUTOMATED TECHNOLOGY SERVICES	717-787-4076

www.pgc.state.pa.us

May 31, 2016

Ms. Laura Hall
RETTEW Associates, Inc.
3020 Columbia Avenue
Lancaster, Pennsylvania 17603

PNDI Receipt: project_receipt_tower_6_603925_FINAL_1.pdf
Re: Tower 6
City of Allentown, Lehigh County, Pennsylvania

Dear Ms. Hall,

Thank you for submitting the above referenced project to the Pennsylvania Natural Diversity Inventory (PNDI) for review. The Pennsylvania Game Commission (PGC) screened this project for potential impacts to species and resources of concern under PGC responsibility, which includes birds and mammals only.

No Impact Anticipated

PNDI records indicate species or resources of concern are located in the vicinity of the project. However, based on the information you submitted concerning the nature of the project, the immediate location, and our detailed resource information, the PGC has determined that no impact is likely. Therefore, no further coordination with the PGC will be necessary for this project at this time.

This response represents the most up-to-date summary of the PNDI data files and is valid for two (2) years from the date of this letter. An absence of recorded information does not necessarily imply actual conditions on site. Should project plans change or additional information on listed or proposed species become available, this determination may be reconsidered.

Should the proposed work continue beyond the period covered by this letter, please resubmit the project to this agency as an "Update" (including an updated PNDI receipt, project narrative and accurate map). If the proposed work has not changed and no additional information concerning listed species is found, the project will be cleared for PNDI requirements under this agency for two additional years.

This finding applies to impacts to birds and mammals only. To complete your review of state and federally-listed threatened and endangered species and species of special concern, please be sure that the U.S. Fish and Wildlife Service, the PA Department of Conservation and Natural Resources, and/or the PA Fish and Boat Commission have been contacted regarding this project as directed by the online PNDI ER Tool found at www.naturalheritage.state.pa.us.

Sincerely,



Olivia A. Braun
Environmental Planner
Division of Environmental Planning & Habitat Protection
Bureau of Wildlife Habitat Management
Phone: 717-787-4250, Extension 3128
Fax: 717-787-6957
E-mail: Olbraun@pa.gov

A PNHP Partner



Pennsylvania Natural Heritage Program

OAB/oab

cc: File

SECTION 3.8

ALTERNATIVES ANALYSIS

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

TOWER 6

SERFASS CONSTRUCTION COMPANY

City of Allentown
Lehigh County, Pennsylvania

Alternate Sewer Facilities Analysis:

Serfass Construction Company is proposing the development of Tower 6 which is on approximately 0.36 acres. The proposed property is located at the southwest corner of the 6th Street and Hamilton Street intersection in Allentown, Pennsylvania. The project will consist of a multi-story office building with retail and office space. The added anticipated sewage flow is 6,440.46 gallons per day (gpd).

With the availability of public sewer that is not at capacity it is most reasonable to send the sewage from this development to Lehigh County Authority for collection, conveyance, and then be treated at the City of Allentown Wastewater Treatment Plant for treatment and disposal. This disposal method also provides for the best long-term reliability for the treatment and disposal of the sewage from the development.

SECTION 3.9

PATH OF SEWAGE TO TREATMENT FACILITY

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

SECTION 3.10

ALLENTOWN SEWER ORDINANCE

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

TITLE FIVE - SEWERS

940	Allentown Sewage Disposal
941	Sewage and Industrial Wastes
942	Storm Sewer Ordinance
945	Sewer Rates
947	Sewer Tapping Fees
949	Industrial Cost Recovery System

ARTICLE 940 ALLENTOWN SEWAGE DISPOSAL

940.01	Short Title
940.02	Definitions
940.03	General Sanitary Regulations
940.04	Admission of Authorized Waste Into Storm Sewers
940.05	Connection Permits
940.06	Drainage of Swimming Pools
940.07	Drainage of Air Conditioning or Refrigeration Equipment
940.08	User Charges for Wastewater Discharge to Sanitary Sewer System
940.09	Discharges Subject to Sewer Discharge Ordinance
940.99	Penalty

940.01 SHORT TITLE

The short title of this Article shall be the "Allentown Sewage Disposal." (Ord. 12003 §1 4/18/73; 13581 §1 6/5/97)

940.02 DEFINITIONS

As used in this Article, the following words, terms and phrases shall have the meaning ascribed to them in this Section, except where the context clearly indicates a different meaning.

(a) "**Air conditioning**" means the cooling or dehumidification, or both, of space for human occupancy or for any environmental control.

(b) "**Building drain**" means the sewer or sewers of a building used to convey sewage and/or industrial waste to building sewers or laterals, and in this Article shall relate to the point of connection to the building sewer or laterals at the curb line or property line.

(c) "**Building sewer**" or "**lateral**" means the extension of the building drain from the curb line or property line to the public sewer or other place of disposal.

(d) "**Garbage**" means solid waste resulting from the domestic and commercial preparation, cooking and dispensing of food and from handling, storage and sale of produce.

(e) "**Ground garbage**" means garbage that has been shredded to such a degree that all its particles will be carried freely under normal sewer flow conditions, with no particle greater than one-half (1/2") inch in any dimension.

(f) "**Ground water**" means that which is standing in or passing through the ground.

(g) "**Improved property**" means any property located within the corporate limits of the City upon which there is erected a structure or structures intended for continuous or periodic habitation, occupancy or use by human beings or animals and from which structure or structures sewage and/or industrial waste shall be, or may be discharged, or any property outside the corporate limits of the City upon which there is erected a structure or structures intended for continuous or periodic habitation, occupancy or use by human beings or animals and from which structure sewage and/or industrial waste shall be, or may be, discharged and which wastes are accepted by the City into the City's sewage system as it exists now or with any extensions or enlargements that may be made in the future.

(h) "**Industrial waste**" means solid, liquid or gaseous substances or forms of energy ejected or escaping in the course of any industrial, manufacturing, trade or business process or in the course of development, recovering or processing of natural resources, but not sewage.

(i) "**Manhole**" means a shaft or chamber leading from the surface of the ground to a sewer, large enough to enable a man to gain access to the latter.

(j) "**Municipality**" means any county, county authority, municipal authority, city, borough, town, township or school district.

(k) "**Owner**" means any person vested with ownership, legal or equitable, sole or partial, of any improved property.

(l) "**Person**" means any individual(s), firm, partnership, company, association, society, corporation, or other group or entity.

(m) "**Plumbing Code**" means the Plumbing Code of the City.

(n) "**Plumbing Inspector**" means the Plumbing Inspector of the City or his duly authorized assistant or representative.

(o) "**Premises accessible to the sewerage system.**" Any improved property shall be considered accessible to the sewerage system when the public sewer abuts, bounds or is adjacent to such improved property.

(p) "**Public sewer**" means a sewer in which all owners of abutting properties have equal rights and is controlled by public authority. It shall also include sewers within or without the City limits, which serve one or more persons and discharge into the City sewerage system.

(q) "**Refrigeration**" means the preservation of food products, the maintenance of temperature for aid in process work and the maintenance of storage temperature.

(r) "**Sanitary sewer**" means a sewer which carries sewage and/or authorized industrial wastes and to which storm, surface and ground waters are not intentionally admitted.

(s) "**Sewer**" means a pipe or conduit for carrying sewage, industrial waste or storm or surface water.

(t) "**Sewerage system**" or "**sewerage facility**" means all facilities owned and/or operated by the City, which are used for collecting, pumping, transporting, treating and disposing of sewerage and authorized industrial waste.

(u) "**Shall**" is mandatory; "**may**" is permissive.

(v) "**Storm sewer**" means a sewer which carries storm, surface and ground water and/or authorized industrial waste but not sewage.

(w) "**Surface water**" means that portion of the precipitation which runs off over the surface of the ground.

(x) "**Water as a direct cooling medium**" means the use of water as a refrigerant.

(y) "**Water as an indirect cooling medium**" means the use of water to extract heat from a refrigerant in the water-cooled condensing unit.

(z) "**Water-cooled equipment**" means any equipment using water as a cooling medium for purposes other than air conditioning or refrigeration.

(aa) "**Watercourse**" means a channel in which a flow of water occurs, whether continuously or intermittently. (Ord. 12003 §2 4/18/73; 13581 §1 6/5/97)

940.03 GENERAL SANITARY REGULATIONS

(a) No person shall place, deposit or permit to be deposited in any unsanitary manner on public or private property within the City, or in any area under the jurisdiction of the City, any human or animal excrement, garbage or other objectionable waste.

(b) No person shall discharge to any watercourse, within the City, or in any area under the jurisdiction of the City, any sewage or other polluted waters or industrial waste, except as hereinafter provided.

(c) No person shall discharge into a storm sewer any sewage or unauthorized waste.

(d) Except as hereinafter provided, no person shall construct or maintain any privy, privy vault, septic tank, cesspool or other facility intended or used for the disposal or sewage.

(e) The owner of any premises in the City in which human beings live, are housed, employed or gathered, accessible to the sewerage system, is hereby required at his expense to install suitable toilet facilities therein, and to connect such facilities directly with such sanitary sewerage system in accordance with the provisions of this Article, within ninety (90) days after the date of official notice to do so. If any owner, after notice as provided herein, refuses or neglects to connect such premises with the sewerage system, the City shall cause the connection to be made at the owner's expense.

(f) Where a public sanitary sewer is not available, the building sewer shall be connected to a private sewage disposal system complying with the provisions of the Plumbing Code and the requirements of the Department of Environmental Protection of the Commonwealth of Pennsylvania.

(g) No person shall uncover, make any connections with or opening into, use, alter or disturb any public sewer or appurtenance thereof without first obtaining a written permit from the approving authority.

(h) A separate and independent building sewer shall be provided for every improved property.

(i) Where existing building sewers connected to a public sanitary sewer or public storm sewer are to be abandoned by reason of demolition of buildings and structures or for any other reason, they shall be disconnected and permanently sealed at the curb line or at the public sewer as directed by the approving authority. Existing building sewers may be used in connection with new buildings only when they are found, after examination and testing by the City Plumbing Inspector, to meet all requirements of this Article.

(j) The size, slope, alignment and materials of construction of a building sewer, and the methods to be used in excavating, placing of the pipe, joining, testing and backfilling the trench shall all conform to the requirements of the Building Code and Plumbing Code and other applicable rules and regulations of the City. In the absence of the code provisions or in amplification thereof, the materials and procedures set forth in appropriate specifications of the A.S.T.M. and W.P.C.F. Manuals of Practice shall apply.

(k) Whenever possible, the building sewer shall be brought to the building at a depth below the basement floor. In all buildings in which any building drain is too low to permit gravity to flow to the public sewer, sewage carried by such building drain shall be lifted by an approved means conforming to the Plumbing Code and discharged to the building sewer. Exceptions to this requirement shall be requested, in writing, and approved by the Plumbing Inspector.

Any building floor drains shall have gravity or pumped discharge completely independent of the sanitary sewerage system, except where the entire finished floor is at an elevation above the finished grade around the exterior of the building. (Ord. 12694 §3 2/5/86)

In commercial or industrial buildings, floor drains intended to receive sewage and located below the exterior finished grade may be connected to a drainage system which is connected to the public sewer, subject to the written approval of the Plumbing Inspector. Such approval will be contingent upon the owner or his representative demonstrating that adequate protection has been provided against the introduction of storm water, spring water, ground water, subsurface drainage or building foundation drainage into the public sewer. (Ord. 12694 §3 2/5/86)

(l) No person shall make connection of roof downspouts, exterior foundation drains, areaway drains or other sources of surface runoff or ground water to a building sewer or building drain which in turn is connected directly or indirectly to a public sanitary sewer.

(m) The connection of the building drain to the building sewer, or of the building sewer into the public sewer shall conform to the requirements of the Building Code and Plumbing Code and other applicable rules and regulations of the City or the procedures set forth in appropriate specifications of the A.S.T.M. and W.P.C.F. Manuals of Practice. All such connections shall be made gastight and watertight and shall not be made except in the presence of and under the supervision of the Plumbing Inspector. Any deviation from the prescribed procedures and materials must be approved, in writing, by the approving authority before installation.

(n) When a public sewer becomes accessible, the use of cesspools, sinks, wells, privy vaults, septic tanks or other private sewage disposal systems shall cease and their use for the disposal of sewage shall be abandoned. They shall be cleaned, filled up with approved material and closed; provided, however, that ninety (90) days official notice to discontinue the use thereof shall first have been given. However, if any cesspool, sink, well, privy vault, septic tank or other private sewage

disposal system shall be declared a health hazard by the City's Health Officer, the use thereof shall cease immediately, and it shall be cleaned, filled up and closed immediately.

If any owner or user, after notice as provided herein, refuses or neglects to discontinue the use of cesspools, sinks, wells, privy vaults or other private sewage disposal system and to clean, fill up and close the same, the City shall cause the same to be cleaned, filled up and closed at the owner's expense.

(o) The owner of any improved property shall maintain and repair the building drain and lateral at his own expense and shall remove all trees, tree roots and other obstructions to the building drain and lateral. Where such maintenance or repairs are neglected by the owner, the City may, ten (10) days after mailing written notice to the owner, make or cause to be made such maintenance or repairs as may be necessary and charge the owner of such improved property for the cost thereof. (Ord. 12003 §3 4/18/73; 13581 §1 6/5/97)

940.04 ADMISSION OF AUTHORIZED WASTE INTO STORM SEWERS

(a) Residential, commercial or industrial property may be connected to the storm sewer system or may continue the discharge of waste to the storm sewer system providing the waste to be discharged thereto conforms to the following:

(1) All discharge of waste to storm sewers shall be in compliance with the laws or regulations of the Commonwealth of Pennsylvania or the Federal government or any agency thereof having jurisdiction over streams, rivers, waterways or water resources.

(2) No waste other than unadulterated rain, roof or surface drainage water or authorized industrial waste shall be discharged into a storm sewer and the City may regulate the rate of discharge of such waste into a storm sewer.

(b) No person shall drain any waste water except storm water or authorized industrial waste into any drainage ditch or basin which will ultimately, by natural flow or otherwise, enter into the storm sewer system, or into a stream, river or watercourse. No person shall drain any waste water, except storm water, into any gutter, street or pavement.

(c) All present connections to the storm sewer system that are in violation of any provision of this Article shall be abated immediately and application to connect to the storm sewer system under the provisions of this Article shall be submitted within thirty (30) days after the passage of this Article (April 18, 1973). (Ord. 12003 §5 4/18/73; 13581 §1 6/5/97)

940.05 CONNECTION PERMITS

(a) Prior to installing a private sewage disposal facility, or prior to making a residential or commercial connection to the sewerage system, or prior to making a new connection to the sewerage or to a storm sewer system for discharge of industrial waste, the owner of the improved property where such installation or connection is proposed to be made shall apply to the City, in writing, for a permit for such installation or connection.

(b) Such applications for such installations or connections shall be made on connection permit application forms furnished by the City. Industrial waste connection permit applications shall contain all pertinent data including but not limited to estimated quantity of flow, character of waste, maximum rate of discharge and proposed pretreatment facilities.

(c) There shall be three (3) classes of building sewer connection permits:

- (1) For residential services;
- (2) For commercial services;
- (3) For service to establishments generating industrial wastes.

Fees for sidewalk and street cuts, if applicable, shall be paid in addition to the building sewer connection permit. (Ord. 12694 §11 2/5/86)

(d) All costs and expenses incident to the installation and connection of the building drain and the building sewer shall be borne by the owner. The owner shall indemnify the City from any loss or damage that may directly or indirectly be occasioned by the installation of the building sewer.

(e) The applicant for the building sewer connection permit shall notify the City Plumbing Inspector when the building sewer is ready for inspection and connection to the public sewer or the building drain is ready for inspection and connection to the building sewer. The connection shall be made under the supervision of the City Plumbing Inspector or his representative, who shall be notified twenty-four (24) hours before time for backfilling. (Ord. 12003 §6 4/18/73; 13581 §1 6/5/97)

940.06 DRAINAGE OF SWIMMING POOLS

Drain lines from all swimming pools, in the City, shall be connected to storm sewers or sanitary sewers, and filter back-wash lines shall be discharged to the sanitary sewerage system as follows:

- (a) Filter back-wash shall be discharged to the sanitary sewer.
- (b) Where required, diatomaceous earth filter back-wash shall be connected to the sanitary sewer through settling tanks with four (4) months storage capacity, which tanks shall be readily accessible for removing solid waste for disposal (Ord. 12003 §9 4/18/73; 13581 §1 6/5/97)

940.07 DRAINAGE OF AIR CONDITIONING OR REFRIGERATION EQUIPMENT

(a) No air conditioning, refrigeration or other water-cooled equipment using water as a direct cooling medium may be installed or operated unless a means of water disposal other than discharge into the City's sewers is provided, except as hereinafter provided.

(b) No air conditioning, refrigeration or other water-cooled equipment using water as an indirect cooling medium may be installed or operated unless:

(1) Evaporative condensers, a cooling tower, a spray pond or a similar device requiring no sewer connection (except for seasonal cleaning and flushing) is used; or

(2) A means of water disposal other than discharge into the City's sewers is provided, except as hereinafter provided.

(c) Water from both direct and indirect cooling mediums may be discharged into any adjacent storm sewer, provided that when required, proper controls are installed to automatically shut off the discharge of such water when the water level in the storm sewer reaches three-quarters (3/4) of the depth of the cross section of such sewer, and provided that such discharge shall be in compliance with Section 940.04(a) and Article 942 of the Codified Ordinances of the City of Allentown and any subsequent City Ordinance or regulations governing storm water discharges. (13808 §1 2/3/2000)

(d) Before any such connection to a storm sewer shall be made, appropriate plans shall be submitted to and approved by the approving authority. The City may, however, at any future date, direct the discontinuance of such connections to the City's storm sewers.

(e) All such connections to the storm sewers and the automatic shut off controls, shall be inspected at least annually by a representative of the City. Where automatic shut off controls are found to be defective, all such drainage to the storm sewer shall be prohibited until the defects are corrected. (Ord. 12003 §10 4/18/73; 13581 §1 6/5/97)

940.08 USER CHARGES FOR WASTEWATER DISCHARGE TO SANITARY SEWER SYSTEM

Discharge of any and all wastewater flows to the City sanitary sewer system is absolutely contingent on the payment of user charges based on a user charge system in accordance with Title 40 of the Code of Federal Regulations, Section 35.913-13, and Appendix B to Part 35. This requirement is intended as a minimum and does not prohibit the imposition of sewer service charges in excess of Federal requirements. The purpose of this limitation on the admission of sewage into the City system, is to fulfill Federal requirements and grant conditions associated with the Federal funding of wastewater system improvements. (Ord. 12345 §4 3/21/79; 13581 §1 6/5/97)

940.09 DISCHARGES SUBJECT TO SEWER DISCHARGE ORDINANCE

All discharges into the City sanitary sewer system are also subject to the provisions of the Sewage Discharge Ordinance. (13581 §1 6/5/97)

940.99 PENALTY

Any person violating the provisions of this Article shall be fined not more than One Thousand (\$1,000) Dollars or imprisoned not more than ninety (90) days, or both. (13738 §1 3/4/99)

ARTICLE 941
SEWAGE AND INDUSTRIAL WASTE ORDINANCE
(Passed by Ordinance No. 14686 on February 23, 2009)

- 941 SEWAGE AND INDUSTRIAL WASTES**
- 941.2 GENERAL SEWER USE**
- 941.3 PRETREATMENT OF WASTEWATER**
- 941.4 WASTEWATER DISCHARGE PERMITS**
- 941.5 WASTEWATER DISCHARGE PERMIT ISSUANCE**
- 941.6 REPORTING REQUIREMENTS**
- 941.7 COMPLIANCE MONITORING**
- 941.8 CONFIDENTIAL INFORMATION**
- 941.9 PUBLICATION OF USERS IN SIGNIFICANT NONCOMPLIANCE**
- 941.10 ADMINISTRATIVE ENFORCEMENT REMEDIES**
- 941.11 JUDICIAL ENFORCEMENT REMEDIES**
- 941.12 SUPPLEMENTAL ENFORCEMENT ACTION**
- 941.13 AFFIRMATIVE DEFENSES TO DISCHARGE VIOLATIONS**
- 941.14 HEARING BOARD**
- 941.15 MISCELLANEOUS PROVISIONS**
- 941.16 SURCHARGE**
- 941.17**

941 SEWAGE AND INDUSTRIAL WASTES

Article 941.1.0 General Provisions

- 1.1 Purpose and Policy**
- 1.2 Administration**
- 1.3 Abbreviations**
- 1.4 Definitions**

1.1 Purpose and Policy

This Ordinance sets forth uniform requirements for users of the Publicly Owned Treatment Works for the City of Allentown and enables the City to comply with all applicable State and Federal laws, including the Clean Water Act (33 United States Code §1251 et seq.) and the General Pretreatment Regulations (Title 40 of the Code of Federal Regulations [CFR] Part 403). The objectives of this Ordinance are:

- A. To prevent the introduction of pollutants into the Publicly Owned Treatment Works that will interfere with its operation;
- B. To prevent the introduction of pollutants into the Publicly Owned Treatment Works that will pass through the Publicly Owned Treatment Works, inadequately treated, into receiving waters, or otherwise be incompatible with the Publicly Owned Treatment Works;
- C. To protect both Publicly Owned Treatment Works personnel who may be affected by wastewater and biosolids in the course of their employment and the general public;
- D. To promote reuse and recycling of industrial wastewater and biosolids from the Publicly Owned Treatment Works;

E. To provide for fees for the equitable distribution of the cost of operation, maintenance, and improvement of the Publicly Owned Treatment Works; and

F. To enable the City to comply with its National Pollutant Discharge Elimination System permit conditions, biosolids use and disposal requirements, and any other Federal or State laws to which the Publicly Owned Treatment Works is subject.

This ordinance shall apply to all users of the Publicly Owned Treatment Works. The ordinance authorizes the issuance of wastewater discharge permits; provides for monitoring, compliance, and enforcement activities; establishes administrative review procedures; requires user reporting; and provides for the setting of fees for the equitable distribution of costs resulting from the program established herein.

1.2 Administration

Except as otherwise provided herein, the Director of Public Works shall administer, implement, and enforce the provisions of this Ordinance. Any powers granted to or duties imposed upon the Director of Public works may be delegated by the Director of Public Works to a duly authorized other City employee.

1.3 Abbreviations

The following abbreviations, when used in this Ordinance, shall have the designated meanings:

BOD - Biochemical Oxygen Demand
BMP - Best Management Practice
BMR - Baseline Monitoring Report
CFR - Code of Federal Regulations
CIU - Categorical Industrial User
COD - Chemical Oxygen Demand
EPA - U.S. Environmental Protection Agency
gpd - gallons per day
IU – Industrial User
mg/l - milligrams per liter
NPDES - National Pollutant Discharge Elimination System
NSCIU - Non-Significant Categorical Industrial User
POTW - Publicly Owned Treatment Works
RCRA - Resource Conservation and Recovery Act
SIU - Significant Industrial User
SNC - Significant Noncompliance
SIC - Standard Industrial Classification
TSS - Total Suspended Solids
U.S.C. - United States Code

1.4 Definitions

Unless a provision explicitly states otherwise, the following terms and phrases, as used in this Ordinance, shall have the meanings hereinafter designated.

A. Act or "the Act". The Federal Water Pollution Control Act, also known as the Clean Water Act, as amended, 33 U.S.C. §1251 et seq.

B. Approval Authority. The Regional Administrator of EPA, Region III.

C. Authorized or Duly Authorized Representative of the User.

(1) If the user is a Corporation:

(a) The president, secretary, treasurer, or a vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or

(b) The manager of one or more manufacturing, production, or operating facilities, provided the manager is authorized to make management decisions that govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiate and direct other comprehensive measures to assure long-term environmental compliance with environmental laws and regulations; can ensure that the necessary systems are established or actions taken to gather complete and accurate information for wastewater discharge permit requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.

(2) If the user is a partnership or sole proprietorship: a general partner or proprietor, respectively.

(3) If the user is a Federal, State, or local governmental facility: a director or highest official appointed or designated to oversee the operation and performance of the activities of the government facility, or their designee.

(4) The individuals described in paragraphs 1 through 3, above, may designate a Duly Authorized Representative if the authorization is in writing, the authorization specifies the individual or position responsible for the overall operation of the facility from which the discharge originates or having overall responsibility for environmental matters for the company, and the written authorization is submitted to the City.

D. Biochemical Oxygen Demand or BOD. The quantity of oxygen utilized in the biochemical oxidation of organic matter under standard laboratory procedures for five (5) days at 20 degrees Celsius, usually expressed as a concentration (e.g., mg/l).

E. Best Management Practices or BMPs. Schedules of activities, prohibitions of practices, maintenance procedures, and other management practices to implement the prohibitions listed in Section 2.1 A and B [40 CFR 403.5(a) (1) and (b)]. BMPs include treatment requirements, operating procedures, management plans, and practices to control the discharge of pollutants.

F. Categorical Pretreatment Standard or Categorical Standard. Any regulation containing pollutant discharge limits promulgated by EPA in accordance with Sections 307(b) and (c) of the Act (33 U.S.C. §1317) which apply to a specific category of users and which appear in 40 CFR Chapter I, Subchapter N, Parts 405-471.

G. Categorical Industrial User. An Industrial User subject to a categorical Pretreatment Standard or categorical Standard.

H. City. The City of Allentown or the City Council of Allentown.

I. Chemical Oxygen Demand or COD. A measure of the oxygen required to oxidize all compounds, both organic and inorganic, in water.

J. Control Authority. The City of Allentown

K. Daily Maximum. The arithmetic average of all effluent samples for a pollutant collected during a calendar day.

L. Daily Maximum Limit. The maximum allowable discharge limit of a pollutant during a calendar day. Where Daily Maximum Limits are expressed in units of mass, the daily discharge is the total mass discharged over the course of the day. Where Daily Maximum Limits are expressed in terms of a concentration, the daily discharge is the arithmetic average measurement of the pollutant concentration derived from all measurements taken that day.

M. Environmental Protection Agency or EPA. The U.S. Environmental Protection Agency or, where appropriate, the Regional Water Protection Division Director, or other duly authorized official of said agency.

N. Existing Source. Any source of discharge that is not a "New Source"

O. Grab Sample. A sample which is taken from a wastestream without regard to the flow in the wastestream and over a period of time not to exceed fifteen (15) minutes.

P. Indirect Discharge or Discharge. The introduction of pollutants into the POTW from any nondomestic source.

Q. Instantaneous Limit. The maximum concentration of a pollutant allowed to be discharged at any time, determined from the analysis of any discrete or composited sample collected, independent of the industrial flow rate and the duration of the sampling event.

R. Interference. A discharge, which alone or in conjunction with a discharge or discharges from other sources, inhibits or disrupts the POTW, its treatment processes or operations or its biosolids processes, use or disposal; and therefore, is a cause of a violation of the City's NPDES permit or of the prevention of sewage biosolids use or disposal in compliance with any of the following statutory/regulatory provisions or permits issued there under, or any more stringent State or local regulations: Section 405 of the Act; the Solid Waste Disposal Act, including Title II commonly referred to as the Resource Conservation and Recovery Act (RCRA) ; any State regulations contained in any State biosolids management plan prepared pursuant to Subtitle D of the Solid Waste Disposal Act; the Clean Air Act; the Toxic Substances Control Act; and the Marine Protection, Research, and Sanctuaries Act.

S. Local Limit. Specific discharge limits developed and enforced by the City upon industrial or commercial facilities to implement the general and specific discharge prohibitions listed in 40 CFR 403.5(a) (1) and (b).

T. Medical Waste. Isolation wastes, infectious agents, human blood and blood products, pathological wastes, sharps, body parts, contaminated bedding, surgical wastes, potentially contaminated laboratory wastes, and dialysis wastes.

U. Monthly Average. The sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month.

V. Monthly Average Limit. The highest allowable average of "daily discharges" over a calendar month, calculated as the sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month.

W. New Source.

(1) Any building, structure, facility, or installation from which there is (or may be) a discharge of pollutants, the construction of which commenced after the publication of proposed pretreatment standards under Section 307(c) of the Act which will be applicable to such source if such standards are thereafter promulgated in accordance with that Section, provided that:

(a) The building, structure, facility, or installation is constructed at a site at which no other source is located; or

(b) The building, structure, facility, or installation totally replaces the process or production equipment that causes the discharge of pollutants at an existing source; or

(c) The production or wastewater generating processes of the building, structure, facility, or installation are substantially independent of an existing source at the same site. In determining whether these are substantially independent, factors such as the extent to which the new facility is integrated with the existing plant, and the extent to which the new facility is engaged in the same general type of activity as the existing source, should be considered.

(2) Construction on a site at which an existing source is located results in a modification rather than a new source if the construction does not create a new building, structure, facility, or installation meeting the criteria of Section (1) (b) or (c) above but otherwise alters, replaces, or adds to existing process or production equipment.

(3) Construction of a new source as defined under this paragraph has commenced if the owner or operator has:

(a) Begun, or caused to begin, as part of a continuous on-site construction program

(i) Any placement, assembly, or installation of facilities or equipment; or

(ii) Significant site preparation work including clearing, excavation, or removal of existing buildings, structures, or facilities which is necessary for the placement, assembly, or installation of new source facilities or equipment; or

(b) Entered into a binding contractual obligation for the purchase of facilities or equipment which are intended to be used in its operation within a reasonable time. Options to purchase or contracts which can be terminated or modified without substantial loss, and contracts for feasibility, engineering, and design studies do not constitute a contractual obligation under this paragraph.

X. Noncontact Cooling Water. Water used for cooling which does not come into direct contact with any raw material, intermediate product, waste product, or finished product.

Y. Pass Through. A discharge which exits the POTW into waters of the United States in quantities or concentrations which, alone or in conjunction with a discharge or discharges from other sources, is a cause of a violation of any requirement of the City's NPDES permit, including an increase in the magnitude or duration of a violation.

Z. Person. Any individual, partnership, copartnership, firm, company, corporation, association, joint stock company, trust, estate, governmental entity, or any other legal entity; or their legal representatives, agents, or assigns. This definition includes all Federal, State, and local governmental entities.

AA. pH. A measure of the acidity or alkalinity of a solution, expressed in standard units.

BB. Pollutant. Dredged spoil, solid waste, incinerator residue, filter backwash, sewage, garbage, sewage biosolids, munitions, medical wastes, chemical wastes, biological materials, radioactive materials, heat, wrecked or discarded equipment, rock, sand, cellar dirt, municipal, agricultural and industrial wastes, and certain characteristics of wastewater (including but not limited to pH, temperature, TSS, turbidity, color, BOD, COD, toxicity, or odor).

CC. Pretreatment. The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to, or in lieu of, introducing such pollutants into the POTW. This reduction or alteration can be obtained by physical, chemical, or biological processes; by process changes; or by other means, except by diluting the concentration of the pollutants unless allowed by an applicable pretreatment standard.

DD. Pretreatment Requirements. Any substantive or procedural requirement related to pretreatment imposed on a user, other than a pretreatment standard.

EE. Pretreatment Standard or Standards. Pretreatment standards shall mean prohibited discharge standards, categorical Pretreatment Standards, and Local Limits.

FF. Prohibited Discharge Standards or Prohibited Discharges. Absolute prohibitions against the discharge of certain substances; these prohibitions appear in Section 2.1 of this Ordinance.

GG. Publicly Owned Treatment Works or POTW. A "treatment works", as defined by Section 212 of the Act (33 U.S.C. 11292) which is owned by the City or any municipality which contributes wastewater to the City's system. This definition includes any devices or systems used in the collection, storage, treatment, recycling, and reclamation of sewage or industrial wastes of a liquid nature and any conveyances which convey wastewater to a treatment plant.

HH. Septic Tank Waste. Any sewage from holding tanks such as vessels, chemical toilets, campers, trailers, and septic tanks.

II. Sewage. Human excrement and gray water (household showers, dishwashing operations, etc.).

JJ. Significant Industrial User (SIU)

Except as provided in paragraphs (3) and (4) of this Section, a Significant Industrial User is:

- (1) An Industrial User subject to categorical pretreatment standards; or

(2) An Industrial User that:

(a) Discharges an average of twenty-five thousand (25,000) gpd or more of process wastewater to the POTW (excluding sanitary, noncontact cooling, and boiler blowdown wastewater) ;

(b) Contributes a process wastestream which makes up five (5%) percent or more of the average dry weather hydraulic or organic capacity of the POTW treatment plant; or

(c) Is designated as such by the City on the basis that it has a reasonable potential for adversely affecting the POTW's operation or for violating any pretreatment standard or requirement.

(3) The City may determine that an Industrial User subject to categorical Pretreatment Standards is a Non-Significant Categorical Industrial User rather than a Significant Industrial User on a finding that the Industrial User never discharges more than 100 gallons per day (gpd) of total categorical wastewater (excluding sanitary, non-contact cooling and boiler blowdown wastewater, unless specifically included in the Pretreatment Standard) and the following conditions are met:

(a) The Industrial User, prior to City's finding, has consistently complied with all applicable categorical Pretreatment Standards and Requirements;

(b) The Industrial User annually submits the certification statement required in Section 6.13 [see 40 CFR 403.12(q)], together with any additional information necessary to support the certification statement; and

(c) The Industrial User never discharges any untreated concentrated wastewater.

(4) Upon a finding that a user meeting the criteria in Subsection (2) has no reasonable potential for adversely affecting the POTW's operation or for violating any pretreatment standard or requirement, the City may at any time, on its own initiative or in response to a petition received from a user, and in accordance with procedures in 40 CFR 403.8(f) (6), determine that such user should not be considered a significant industrial user.

KK. Slug Load or Slug Discharge. Any discharge at a flow rate or concentration, which could cause a violation of the prohibited discharge standards in Section 2.1 of this Ordinance. A Slug Discharge is any Discharge of a non-routine, episodic nature, including but not limited to an accidental spill or a non-customary batch Discharge, which has a reasonable potential to cause Interference or Pass Through, or in any other way violate the POTW's regulations, Local Limits or Permit conditions.

LL. Storm Water. Any flow occurring during or following any form of natural precipitation, and resulting from such precipitation, including snowmelt.

MM. North American Industry Classification System (NAICS). A classification pursuant to the *North American Industry Classification System Manual* issued by the United States Office of Management and Budget.

NN. Director of Public Works. The person designated by the City to supervise the operation of the POTW, and who is charged with certain duties and responsibilities by this Ordinance. The term also means a duly authorized representative of the Director of Public Works.

OO. Total Suspended Solids or Suspended Solids. The total suspended matter that floats on the surface of, or is suspended in, water, wastewater, or other liquid, and which is removable by laboratory filtering.

PP. Total Kjeldahl Nitrogen or TKN. The sum of free-ammonia and of organic nitrogen compounds which are converted to ammonium sulfate $(\text{NH}_4)_2\text{SO}_4$ under conditions specified by Standard Methods 20th Edition, Method 4500 or EPA Method 351.

QQ. User or Industrial User. A source of indirect discharge.

RR. Wastewater. Liquid and water-carried industrial wastes and sewage from residential dwellings, commercial buildings, industrial and manufacturing facilities, and institutions, whether treated or untreated, which are contributed to the POTW.

SS. Wastewater Treatment Plant or Treatment Plant. That portion of the POTW that is designed to provide treatment of municipal sewage and industrial waste.

Article 941.2.0 General Sewer Use Requirements

2.1 Prohibited Discharge Standards

2.2 National Categorical Pretreatment Standards

2.3 State Pretreatment Standards

2.4 Local Limits

2.5 City's Right of Revision

2.6 Dilution

2.1 Prohibited Discharge Standards

A. General Prohibitions. No user shall introduce or cause to be introduced into the POTW any pollutant or wastewater that causes pass through or interference. These general prohibitions apply to all users of the POTW whether or not they are subject to categorical pretreatment standards or any other National, State, or local pretreatment standards or requirements.

B. Specific Prohibitions. No user shall introduce or cause to be introduced into the POTW the following pollutants, substances, or wastewater:

- (1) Pollutants which create a fire or explosive hazard in the POTW, including, but not limited to, wastestreams with a closed-cup flashpoint of less than 140 degrees F (60 degrees C) using the test methods specified in 40 CFR 261.21 or Wastewater causing two readings on an explosion hazard meter at the point of discharge into the POTW, or at any point in the POTW, of more than five percent (5%) or any single reading over ten percent (10%) of the Lower Explosive Limit of the meter;
- (2) Wastewater having a pH less than 5.0 or more than 12.5, or otherwise causing corrosive structural damage to the POTW or equipment;
- (3) Solid or viscous substances in amounts, which, alone or in combination with other substances, will cause obstruction of the flow in the POTW resulting in interference;

- (4) Pollutants, including oxygen-demanding pollutants (BOD, etc.), released in a discharge at a flow rate and/or pollutant concentration which, either singly or by interaction with other pollutants, will cause interference with the POTW;
- (5) Wastewater having a temperature that will inhibit biological activity in the treatment plant resulting in interference, but in no case wastewater which causes the temperature at the introduction into the treatment plant to exceed 104 degrees F (40 degrees C) ;
- (6) Petroleum oil, nonbiodegradable cutting oil, or products of mineral oil origin, in amounts that will cause interference or pass through;
- (7) Pollutants that result in the presence of toxic gases, vapors, or fumes within the POTW in a quantity that may cause acute worker health and safety problems;
- (8) Trucked or hauled pollutants, except at discharge points designated by the Director of Public Works in accordance with Section 3.4 of this Ordinance;
- (9) Noxious or malodorous liquids, gases, solids, or other wastewater which, either singly or by interaction with other wastes, are sufficient to create a public nuisance or a hazard to life, or to prevent entry into the sewers for maintenance or repair;
- (10) Wastewater which imparts color which cannot be removed by the treatment process, such as, but not limited to, dye wastes and vegetable tanning solutions, which consequently imparts color to the treatment plant's effluent;
- (11) Wastewater containing any radioactive wastes or isotopes except in compliance with applicable State or Federal regulations;
- (12) Storm water, surface water, ground water, artesian well water, roof runoff, subsurface drainage, significant quantities of condensate, deionized water, noncontact cooling water, and unpolluted water, unless specifically authorized by the Director of Public Works.
- (13) Biosolids, sludges, screenings, or other residues from the pretreatment of industrial wastes;
- (14) Medical wastes, except as specifically authorized by the Director of Public Works in a wastewater discharge permit;
- (15) Wastewater causing, alone or in conjunction with other sources, the treatment plant's effluent to fail a toxicity test;
- (16) Detergents, surface-active agents, or other substances which may cause excessive foaming in the POTW or its discharge;
- (17) Fats, oils, or greases of animal or vegetable origin in concentrations greater than 200 mg/l.

(18) Any substance which is a hazardous waste

(19) under 40 CFR Part 261

Pollutants, substances, or wastewater prohibited by this section shall not be processed or stored in such a manner that they could be discharged to the POTW.

2.2 National Categorical Pretreatment Standards

Users must comply with the categorical pretreatment standards found at 40 CFR Chapter I, Subchapter N, Parts 405-471 which are hereby incorporated.

A. Where a categorical pretreatment standard is expressed only in terms of either the mass or the concentration of a pollutant in wastewater, the Director of Public Works may impose equivalent concentration or mass limits in accordance with Section 2.2D and 2.2E.

B. When the limits in a categorical Pretreatment Standard are expressed only in terms of mass of pollutant per unit of production, the Director of Public Works may convert the limits to equivalent limitations expressed either as mass of pollutant discharged per day or effluent concentration for purposes of calculating effluent limitations applicable to individual Industrial Users.

C. When wastewater subject to a categorical pretreatment standard is mixed with wastewater not regulated by the same standard, the Director of Public Works shall impose an alternate limit using the combined wastestream formula in 40 CFR 403.6(e).

D. When a categorical Pretreatment Standard is expressed only in terms of pollutant concentrations, an Industrial User may request that the City of Allentown convert the limits to equivalent mass limits. The determination to convert concentration limits to mass limits is within the discretion of the Director of Public Works. The City may establish equivalent mass limits only if the Industrial User meets all the conditions set forth in Sections 2.2D(1)(a) through 2.2D(1)(e) below.

- (1) To be eligible for equivalent mass limits, the Industrial User must:
 - a. Employ, or demonstrate that it will employ, water conservation methods and technologies that substantially reduce water use during the term of its wastewater discharge permit;
 - b. Currently use control and treatment technologies adequate to achieve compliance with the applicable categorical Pretreatment Standard, and not have used dilution as a substitute for treatment;
 - c. Provide sufficient information to establish the facility's actual average daily flow rate for all wastestreams, based on data from a continuous effluent flow monitoring device, as well as the facility's long-term average production rate. Both the actual average daily flow rate and the long-term average production rate must be representative of current operating conditions;
 - d. Not have daily flow rates, production levels, or pollutant levels that vary so significantly that equivalent mass limits are not appropriate to control the Discharge; and
 - e. Have consistently complied with all applicable categorical Pretreatment Standards during the period prior to the Industrial User's request for equivalent mass limits.

- (2) An Industrial User subject to equivalent mass limits must:

- a. Maintain and effectively operate control and treatment technologies adequate to achieve compliance with the equivalent mass limits;
 - b. Continue to record the facility's flow rates through the use of a continuous effluent flow monitoring device;
 - c. Continue to record the facility's production rates and notify the Director of Public Works whenever production rates are expected to vary by more than 20 percent from its baseline production rates determined in paragraph 2.2D(1)(c) of this Section. Upon notification of a revised production rate, the Director of Public Works will reassess the equivalent mass limit and revise the limit as necessary to reflect changed conditions at the facility; and
 - d. Continue to employ the same or comparable water conservation methods and technologies as those implemented pursuant to paragraphs 2.2D(1)(a) of this Section so long as it discharges under an equivalent mass limit.

(3) When developing equivalent mass limits, the Director of Public Works:

- a. Will calculate the equivalent mass limit by multiplying the actual average daily flow rate of the regulated process(es) of the Industrial User by the concentration-based Daily Maximum and Monthly Average Standard for the applicable categorical Pretreatment Standard and the appropriate unit conversion factor;
- b. Upon notification of a revised production rate, will reassess the equivalent mass limit and recalculate the limit as necessary to reflect changed conditions at the facility; and
- c. May retain the same equivalent mass limit in subsequent wastewater discharger permit terms if the Industrial User's actual average daily flow rate was reduced solely as a result of the implementation of water conservation methods and technologies, and the actual average daily flow rates used in the original calculation of the equivalent mass limit were not based on the use of dilution as a substitute for treatment pursuant to Section 2.6. The Industrial User must also be in compliance with Section 13.3 regarding the prohibition of bypass.]

E. The Director of Public Works may convert the mass limits of the categorical Pretreatment Standards of 40 CFR Parts 414, 419, and 455 to concentration limits for purposes of calculating limitations applicable to individual Industrial Users. The conversion is at the discretion of the Director of Public Works.

[Note: When converting such limits to concentration limits, the Director of Public Works will use the concentrations listed in the applicable subparts of 40 CFR Parts 414, 419, and 455 and document that dilution is not being substituted for treatment as prohibited by Section 2.6 of this ordinance (see 40 CFR 403.6(d)). In addition, the Director of Public Works will document how the equivalent limits were derived for any changes from concentration to mass limits, or vice versa, and make this information publicly available (see 40 CFR 403.6(c)(7)).]

F. Once included in its permit, the Industrial User must comply with the equivalent limitations developed in this Section (2.2) in lieu of the promulgated categorical Standards from which the equivalent limitations were derived. [Note: See 40 CFR 403.6(c)(7)]

G. Many categorical Pretreatment Standards specify one limit for calculating maximum daily discharge limitations and a second limit for calculating maximum Monthly Average, or 4-day average, limitations. Where such Standards are being applied, the same production or flow figure shall be used in calculating both the average and the maximum equivalent limitation. [Note: See 40 CFR 403.6(c)(8)]

H. Any Industrial User operating under a permit incorporating equivalent mass or concentration limits calculated from a production-based Standard shall notify the Director of Public Works within two (2) business days after the User has a reasonable basis to know that the production level will significantly change within the next calendar month. Any User not notifying the Director of Public

Works of such anticipated change will be required to meet the mass or concentration limits in its permit that were based on the original estimate of the long term average production rate. [Note: See 40 CFR 403.6(c)(9)]

2.3 State Pretreatment Standards

Reserved

2.4 Local Limits

A. The Director of Public Works is authorized to establish Local Limits pursuant to 40 CFR 403.5(c).

B. Limits for discharging pollutants which are of concern to the POTW will be made using headworks loading analyses which has been reviewed and approved by the Approval Authority. Allocations for discharging such pollutants will be made to each significant industrial user. Limits may be in the form of monthly average concentration, daily maximum concentration, or instantaneous maximum concentration. Limits will be contained in the wastewater discharge permits issued and will be applied at the point where the wastewater is discharged to the POTW unless otherwise specified in the permit issued. All concentrations for metallic substances are for "total" metal unless indicated otherwise. The Director of Public Works may impose mass limitations in addition to, or in place of, the concentration-based limitations above.

C. The Director of Public Works may develop Best Management Practices (BMPs), by ordinance or in wastewater discharge permits, to implement Local Limits and the requirements of Section 2.1.

2.5 City's Right of Revision

The City reserves the right to establish, by ordinance or in wastewater discharge permits, more stringent standards or requirements on discharges to the POTW consistent with the purpose of this ordinance.

2.6 Dilution

No user shall ever increase the use of process water, or in any way attempt to dilute a discharge, as a partial or complete substitute for adequate treatment to achieve compliance with a discharge limitation unless expressly authorized by an applicable pretreatment standard or requirement. The Director of Public Works may impose mass limitations on users who are using dilution to meet applicable pretreatment standards or requirements or in other cases when the imposition of mass limitations is appropriate.

Article 941.3.0 Pretreatment of Wastewater

3.1 Pretreatment Facilities

3.2 Additional Pretreatment Measures

3.3 Accidental Discharge/Slug Control Plans

3.4 Hauled Wastewater

3.1 Pretreatment Facilities

Users shall provide wastewater treatment as necessary to comply with this Ordinance and shall achieve compliance with all categorical pretreatment standards, local limits, and the prohibitions set out in Section 2.1 of this Ordinance within the time limitations specified by EPA, the State, or the Director of Public Works, whichever is more stringent. Any facilities necessary for compliance shall be provided, operated, and maintained at the user's expense. Detailed plans describing such facilities and operating procedure shall be submitted to the Director of Public Works for review, and shall be acceptable to the Director of Public Works before such facilities are constructed. Review and acceptance of plans are not an endorsement of the effectiveness of any facilities set forth therein and the

City shall not be held liable in any way for the performance of said facilities. The review of such plans and operating procedures shall in no way relieve the user from the responsibility of modifying such facilities as necessary to produce a discharge acceptable to the City under the provisions of this Ordinance.

3.2 Additional Pretreatment Measures

A. Whenever deemed necessary, the Director of Public Works may require users to restrict their discharge during peak flow periods, designate that certain wastewater be discharged only into specific sewers, relocate and/or consolidate points of discharge, separate sewage wastestreams from industrial wastestreams, and such other conditions as may be necessary to protect the POTW and determine the user's compliance with the requirements of this Ordinance.

B. The Director of Public Works may require any person discharging into the POTW to install and maintain, on their property and at their expense, a suitable storage and flow control facility to ensure equalization of flow. A wastewater discharge permit may be issued solely for flow equalization.

C. Grease, oil, and sand interceptors shall be provided when, in the opinion of the Director of Public Works, they are necessary for the proper handling of wastewater containing excessive amounts of grease and oil, or sand; except that such interceptors shall not be required for residential users. All interception units shall be of type and capacity approved by the Director of Public Works and shall be so located to be easily accessible for cleaning and inspection. Such interceptors shall be inspected, cleaned, and repaired regularly, as needed, by the user at their expense.

D. Users with the potential to discharge flammable substances may be required to install and maintain an approved combustible gas detection meter.

3.3 Accidental Discharge/Slug Control Plans

The Director of Public Works shall evaluate whether each significant industrial user needs an accidental discharge/slug control plan or other action to control slug discharge. The Director of Public Works may require any user to develop, submit for approval, and implement such a plan, or take such other action that may be necessary to control slug discharges. Alternatively, the Director of Public Works may develop such a plan for any user. An accidental discharge/slug control plan shall address, at a minimum, the following:

A. Description of discharge practices, including non-routine batch discharges;

B. Description of stored chemicals;

C. Procedures for immediately notifying the Director of Public Works of any accidental or slug discharge, as required by Section 6.6 of this Ordinance; and

D. Procedures to prevent adverse impact from any accidental or slug discharge. Such procedures include, but are not limited to, inspection and maintenance of storage, areas, handling and transfer of materials, loading and unloading operations, control of plant site runoff, worker training, building of containment structures or equipment, measures for containing toxic organic pollutants, including solvents, and/or measures and equipment for emergency response.

3.4 Hauled Wastewater

A. Any hauler, operator, person or persons cleaning cesspools, septic tanks, privies or any other container governed by this Section shall obtain a license from the City before cleaning such containers and hauling the material to the designated place of disposal within the City.

B. The sewage and wastes discharged into the POTW shall not contain industrial waste, chemicals or other matter, with or without pretreatment that does not conform to the requirements of Section 2.1 or any other requirements established by the City. The Director of Public Works may require the hauler to provide a waste analysis of any load prior to discharge. The director of Public Works may require a hauler to obtain an industrial waste discharge permit.

C. Any waste to be discharged from tank trucks shall be disposed at the location designated by the Director of Public Works at the POTW at the time or times fixed by the Director of Public Works.

D. Haulers must provide a waste-tracking form, or forms, for every load. For each privy, cesspool, septic tank or container cleaned by a hauler, operator or any person, a cleaning permit shall first be obtained from the City by the person or persons intending to clean such a receptacle. This form is to be issued by the City before the beginning of said cleaning work.

The form shall contain the following:

- (1) Name and address of the property owner at the source of the waste;
- (2) Date of issue;
- (3) Name of hauler, operator or person contracted to clean this structure, etc.
- (4) Type of container, septic tank, privy, cesspool or any other, and volume;
- (5) Serial number of permit;
- (6) Signature of person completing the form.

E. Any tank truck or any equipment used or intended to be used for the removal, transportation and disposal of sewage and industrial wastes shall conform to the following requirements:

- (1) The container shall be watertight;
- (2) Tanks, containers or other equipment shall be so constructed that every portion of the interior and exterior can be easily cleaned and shall be kept in a clean and sanitary condition;
- (3) Piping, valves and permanent or flexible connections shall be accessible and easily disconnected for cleaning purposes.
- (4) The inlet opening, or opening to every container, shall be so constructed that the material will not spill outside during filling, transfer or transport.
- (5) The outlet connections shall be so constructed that no material will leak out, run out to other than the point of discharge and shall be of a design and type suitable for the material handled and capable of controlling the flow or discharge without spillage, undue spray or flooding immediate surroundings while in use.
- (6) No connection shall be made at any time between a tap or outlet furnishing potable water on any premises and any container or equipment holding material by any means other than an open connection.

F. The license fee for renewal of a current septage hauler's permit as required herein is to be established in accordance with the requirements of the Charter. No permits are to be issued to any new applicants. All permits to be issued will be to an individual, corporation or firm on file for the year preceding the permit renewal date. A new applicant may obtain a license by purchase of the business of a licensed hauler whose license is current and valid. The new license will be limited to that annual volume of waste

previously disposed of at the plant under the license purchased. This assumption of the business by a new owner limits the area of collection to those townships, boroughs, villages, towns and other governmental boundaries which are serviced by the integrated sewer system served by the City of Allentown. The term of the license shall be from June 1 to May 31 of the succeeding year.

G. The fee for disposal into the City Sewage Treatment Plant, at the location designated, shall be established in accordance with the requirements of the Charter and shall be based on a rate per one thousand (1,000) gallons, or a portion thereof.

H. An application form shall be filled out by the hauler, operator, owner, person or persons, prior to the conducting of such a business within the City as governed in this Section. The application form shall contain the following information:

- (1) Name and address of owner, operator, hauler, person or persons.
- (2) Date of the license issued.
- (3) The fee for the license as required herein to be established in accordance with the requirements of the Charter.
- (4) Term of the license: From June 1 to May 31 of the succeeding year.
- (5) The size and make of truck, containers, etc., stated in gallons.
- (6) Place of storage, garage or parking of trucks, containers, etc., when not in use.
- (7) License cannot be transferred from one operator, owner, person or persons, to another without approval by the City.
- (8) A statement to the effect that such trucks, containers, equipment, etc., will be available for inspection by the person designated to make inspection from the City at such time and place agreeable to both hauler and inspector.
- (9) Refusal of agreement to these conditions of inspection at a reasonable time can be cause for forfeiture of the license.
- (10) A higher fee per load, container or portion thereof can be charged, if the need for processing, extra analyses, etc., shall be necessary.
- (11) If a tank or container contains more than 1,000 gallons, an additional fee shall be charged for each 1,000 gallons additional, or portion thereof. The additional fee, as required herein, is to be established in accordance with the requirements of the Charter.
- (12) It shall be understood by all applicants for a permit or those having a license that the septage haulers' permits are an extended courtesy by the City and upon sixty (60) days notification by the City can be terminated if there is reasonable cause for such type action or there is a necessity to reduce the volume of materials to allow the City to comply with its effluent limitations for discharge to the Lehigh River or for any other functional activity at the wastewater treatment plant operations, which would require a reduction in the septage volume being processed.

I. Failure to secure a license, permit or pay dumping fees, when required, as governed in this Section or operating after suspension or revocation of a license or permit by the City shall constitute a violation of this Section. When a written notice of a violation of any of the provisions of this Section has been served upon any hauler, owner, operator, person or persons in this business, such violation shall be discontinued immediately. In such cases when the violation is of immediate danger to the health of the public, and is in danger of damage to the sewage treatment plant system, such operation must cease at once, until the condition is remedied and abated.

Article 941.4.0 Wastewater Discharge Permits

4.1 Wastewater Analysis

4.2 Wastewater Discharge Permit Requirement

4.3 Wastewater Discharge Permitting: Existing Connection

4.4 Wastewater Discharge Permitting: New Connections

4.5 Wastewater Discharge Application Contents

4.6 Application Signatories and Certification

4.7 Individual Wastewater Discharge Decisions

4.1 Wastewater Analysis

When requested by the Director of Public Works, a user must submit information on the nature and characteristics of its wastewater within ninety (90) days of the request. The Director of Public Works is authorized to prepare a form for this purpose and may periodically require users to update this information.

4.2 Wastewater Discharge Permit Requirement

A. No significant industrial user shall discharge wastewater into the POTW without first obtaining a wastewater discharge permit from the Director of Public Works, except that a significant industrial user that has filed a timely application pursuant to Section 4.3 of this Ordinance may continue to discharge for the time period specified therein.

B. The Director of Public Works may require other users to obtain wastewater discharge permits as necessary to carry out the purposes of this Ordinance.

C. Any violation of the terms and conditions of a wastewater discharge permit shall be deemed a violation of this Ordinance and subjects the wastewater discharge permittee to the sanctions set out in 10 and 12 of this Ordinance. Obtaining a wastewater discharge permit does not relieve a permittee of its obligation to comply with all Federal and State pretreatment standards or requirements or with any other requirements of Federal, State, and local law.

4.3 Wastewater Discharge Permitting: Existing Connection

Any user required to obtain a wastewater discharge permit who was discharging wastewater into the POTW prior to the effective date of this Ordinance and who wishes to continue such discharges in the future, shall, within ninety (90) days after said date, apply to the Director of Public Works for an wastewater discharge permit in accordance with Section 4.5 of this Ordinance, and shall not cause or allow discharges to the POTW to continue after one hundred eighty (180) days of the effective date of this Ordinance except in accordance with a wastewater discharge permit issued by the Director of Public Works.

4.4 Wastewater Discharge Permitting: New Connections

Any user required to obtain a wastewater discharge permit who proposes to begin or recommence discharging into the POTW must obtain such permit prior to the beginning or recommencing of such discharge. An application for this wastewater discharge permit, in accordance with Section 4.5 of this Ordinance, must be filed at least ninety (90) days prior to the date upon which any discharge will begin or recommence.

4.5 Wastewater Discharge Application Contents

A. All users required to obtain a wastewater discharge permit must submit a permit application. The Director of Public Works may require all users to submit as part of an application the following information:

(1) Identifying Information.

- a. The name and address of the facility, including the name of the operator and owner.
- b. Contact information, description of activities, facilities, and plant production processes on the premises;

(2) Environmental Permits. A list of any environmental control permits held by or for the facility.

(3) Description of Operations.

a. A brief description of the nature, average rate of production (including each product produced by type, amount, processes, and rate of production), and standard industrial classifications of the operation(s) carried out by such User. This description should include a schematic process diagram, which indicates points of discharge to the POTW from the regulated processes.

b. Types of wastes generated, and a list of all raw materials and chemicals used or stored at the facility which are, or could accidentally or intentionally be, discharged to the POTW;

c. Number and type of employees, hours of operation, and proposed or actual hours of operation;

d. Type and amount of raw materials processed (average and maximum per day);

e. Site plans, floor plans, mechanical and plumbing plans, and details to show all sewers, floor drains, and appurtenances by size, location, and elevation, and all points of discharge;

(4) Time and duration of discharges;

(5) The location for monitoring all wastes covered by the permit;

(6) Flow Measurement. Information showing the measured average daily and maximum daily flow, in gallons per day, to the POTW from regulated process streams and other streams, as necessary, to allow use of the combined wastestream formula set out in Section 2.2C (40 CFR 403.6(e)).

(7) Measurement of pollutants

a. The categorical Pretreatment Standards applicable to each regulated process and any new categorically regulated processes for Existing Sources.

b. The results of sampling and analysis identifying the nature and concentration, and/or mass, where required by the Standard or by the director of Public Works, of regulated pollutants in the discharge from each regulated process.

c. Instantaneous, Daily Maximum, and long-term average concentrations, or mass, where required, shall be reported.

d. The sample shall be representative of daily operations and shall be analyzed in accordance with procedures set out in Section 6.9 of this ordinance. Where the Standard requires compliance with a BMP or pollution prevention alternative, the User shall submit documentation as required by the Director of Public Works or the applicable Standards to determine compliance with the Standard.

e. Sampling must be performed in accordance with procedures set out in Section 6.10 of this ordinance.

(8) Any other information as may be deemed necessary by the Director of Public Works to evaluate the permit application.

B. Incomplete or inaccurate applications will not be processed and will be returned to the User for revision.

4.6 Application Signatories and Certification

A. All wastewater discharge permit applications, User reports and certification statements must be signed by an Authorized Representative of the User and contain the certification statement in Section 6.14 A.

B. If the designation of an Authorized Representative is no longer accurate because a different individual or position has responsibility for the overall operation of the facility or overall responsibility for environmental matters for the company, a new written authorization satisfying the requirements of this Section must be submitted to the Director of Public Works prior to or together with any reports to be signed by an Authorized Representative.

C. A facility determined to be a Non-Significant Categorical Industrial user by the Director of Public Works pursuant to Section 1.4 II (3) must annually submit the signed certification statement in Section 6.13.

4.7 Individual Wastewater Discharge Decisions

The Director of Public Works will evaluate the data furnished by the user and may require additional information. Within sixty (60) days of receipt of a complete wastewater discharge permit application, the Director of Public Works will determine whether or not to issue an wastewater discharge permit. The Director of Public Works may deny any application for a wastewater discharge permit.

Article 941.5.0 Wastewater Discharge Permit Issuance

5.1 Wastewater Discharge Permit Duration

5.2 Wastewater Discharge Permit Contents

5.3 Wastewater Discharge Permit Appeals

5.4 Wastewater Discharge Permit Modification

5.5 Wastewater Discharge Permit Transfer

5.6 Wastewater Discharge Permit Revocation

5.7 Wastewater Discharge Permit Reissuance

5.8 Regulation of Waste Received from Other Jurisdictions

5.1 Wastewater Discharge Permit Duration

An wastewater discharge permit shall be issued for a specified time period, not to exceed five (5) years from the effective date of the permit. A wastewater discharge permit may be issued for a period less than five (5) years, at the discretion of the Director of Public Works. Each wastewater discharge permit will indicate a specific date upon which it will expire.

5.2 Wastewater Discharge Permit Contents

A wastewater discharge permit shall include such conditions as are deemed reasonably necessary by the Director of Public Works to prevent pass through or interference, protect the quality of the water body receiving the treatment plant's effluent, protect worker health and safety, facilitate biosolids management and disposal, and protect against damage to the POTW.

A. Wastewater discharge permits must contain:

- (1) A statement that indicates wastewater discharge permit issuance date, expiration date and effective date;

- (2) A statement that the wastewater discharge permit is nontransferable without prior notification to the City in accordance with Section 5.5 of this Ordinance, and provisions for furnishing the new owner or operator with a copy of the existing wastewater discharge permit;
- (3) Effluent limits, including Best Management Practices, based on applicable pretreatment standards;
- (4) Self monitoring, sampling, reporting, notification, and record-keeping requirements. These requirements shall include an identification of pollutants or best management practice to be monitored, sampling location, sampling frequency, and sample type based on Federal, State, and local law; and
- (5) A statement of applicable civil and criminal penalties for violation of pretreatment standards and requirements, and any applicable compliance schedule. Such schedule may not extend the time for compliance beyond that required by applicable Federal, State, or local law.
- (6) Requirements to control slug discharge, if determined by the Director of Public Works to be necessary.

B. Wastewater discharge permits may contain, but need not be limited to, the following conditions:

- (1) Limits on the average and/or maximum rate of discharge, time of discharge, and/or requirements for flow regulation and equalization;
- (2) Requirements for the installation of pretreatment technology, pollution control, or construction of appropriate containment devices, designed to reduce, eliminate, or prevent the introduction of pollutants into the treatment works;
- (3) Requirements for the development and implementation of spill control plans or other special conditions including management practices necessary to adequately prevent accidental, unanticipated, or nonroutine discharges;
- (4) Development and implementation of waste minimization plans to reduce the amount of pollutants discharged to the POTW;
- (5) The unit charge or schedule of user charges and fees for the management of the wastewater discharged to the POTW;
- (6) Requirements for installation and maintenance of inspection and sampling facilities and equipment, including flow measurement devices;
- (7) A statement that compliance with the wastewater discharge permit does not relieve the permittee of responsibility for compliance with all applicable Federal and State pretreatment standards, including those which become effective during the term of the wastewater discharge permit; and
- (8) Other conditions as deemed appropriate by the Director of Public Works to ensure compliance with this Ordinance, and State and Federal laws, rules, and regulations.

5.3 Wastewater Discharge Permit Appeals

A. The Director of Public Works shall provide public notice of the issuance of a wastewater discharge permit. Any person, including the user, may petition the Director of Public Works to reconsider the terms of a wastewater discharge permit within thirty (30) days of notice of its issuance.

(1) Failure to submit a timely petition for review shall be deemed to be a waiver of the administrative appeal.

(2) In its petition, the appealing party must indicate the wastewater discharge permit provisions objected to, the reasons for this objection, and the alternative condition, if any, it seeks to place in the wastewater discharge permit.

(3) The effectiveness of the wastewater discharge permit shall not be stayed pending the appeal.

(4) If the Director of Public Works fails to act within thirty (30) days, a request for reconsideration shall be deemed to be denied. Decisions not to reconsider a wastewater discharge permit, not to issue a wastewater discharge permit, or not to modify a wastewater discharge permit shall be considered final administrative actions for purposes of judicial review.

(5) Aggrieved parties seeking review of the final administrative wastewater discharge permit decision may appeal to the Industrial Waste Hearing Board.

5.4 Wastewater Discharge Permit Modification

A. The Director of Public Works may modify a wastewater discharge permit for good cause, including, but not limited to, the following reasons:

(1) To incorporate any new or revised Federal, State, or local pretreatment standards or requirements;

(2) To address significant alterations or additions to the user's operation, process, or wastewater volume or character since the time of wastewater discharge permit issuance;

(3) A change in the POTW that requires either a temporary or permanent reduction or elimination of the authorized discharge;

(4) Information indicating that the permitted discharge poses a threat to the POTW, personnel, biosolids, or the receiving waters;

(5) Violation of any terms or conditions of the wastewater discharge permit;

(6) Misrepresentations or failure to fully disclose all relevant facts in the wastewater discharge permit application or in any required reporting;

(7) Revision of or a grant of variance from categorical pretreatment standards pursuant to 40 CFR 403.13;

(8) To correct typographical or other errors in the wastewater discharge permit; or

(9) To reflect a transfer of the facility ownership or operation to a new owner or operator where requested in accordance with Section 5.5.

5.5 Wastewater Discharge Permit Transfer

Wastewater discharge permits may be transferred to a new owner or operator only if the permittee gives at least ninety (90) days advance notice to the Director of Public Works and the Director of Public Works approves the wastewater discharge permit transfer. The notice to the Director of Public Works must include a written certification by the new owner or operator which:

- A. States that the new owner and/or operator has no immediate intent to change the facility's operations and processes;
- B. Identifies the specific date on which the transfer is to occur; and
- C. Acknowledges full responsibility for complying with the existing wastewater discharge permit.

Failure to provide advance notice of a transfer renders the wastewater discharge permit void as of the date of facility transfer.

5.6 Wastewater Discharge Permit Revocation

The Director of Public Works may revoke a wastewater discharge permit for good cause, including, but not limited to, the following reasons:

- A. Failure to notify the Director of Public Works of significant changes to the wastewater prior to the changed discharge;
- B. Failure to provide prior notification to the Director of Public Works of changed conditions pursuant to Section 6.5 of this Ordinance;
- C. Misrepresentation or failure to fully disclose all relevant facts in the wastewater discharge permit application;
- D. Falsifying self-monitoring reports and certification statements;
- E. Tampering with monitoring equipment;
- F. Refusing to allow the Director of Public Works timely access to the facility premises and records;
- G. Failure to meet effluent limitations;
- H. Failure to pay fines;
- I. Failure to pay sewer charges;
- J. Failure to meet compliance schedules;
- K. Failure to complete a wastewater survey or the wastewater discharge permit application;
- L. Failure to provide advance notice of the transfer of business ownership of a permitted facility; or
- M. Violation of any pretreatment standard or requirement, or any terms of the wastewater discharge permit or this ordinance.

Individual Wastewater discharge permits shall be voidable upon cessation of operations or transfer of business ownership. All wastewater discharge permits issued to a particular user are void upon the issuance of a new wastewater discharge permit to that user.

5.7 Wastewater Discharge Permit Reissuance

A user with an expiring wastewater discharge permit shall apply for wastewater discharge permit reissuance by submitting a complete permit application, in accordance with Section 4.5 of this Ordinance, a minimum of one hundred eighty (120) days prior to the expiration of the user's existing wastewater discharge permit.

5.8 Regulation of Waste Received from Other Jurisdictions

A. If another municipality, or user located within another municipality, contributes wastewater to the POTW, the City shall enter into an intermunicipal agreement with the contributing municipality.

B. Prior to entering into an agreement required by paragraph A, above, the Director of Public Works shall request the following information from the contributing municipality:

- (1) A description of the quality and volume of wastewater discharged to the POTW by the contributing municipality;
- (2) An inventory of all users located within the contributing municipality that are discharging to the POTW; and
- (3) Such other information as the Director of Public Works may deem necessary.

C. An intermunicipal agreement, as required by Paragraph A, above, shall contain the following conditions:

- (1) A requirement for the contributing municipality to adopt a sewer use Ordinance which is at least as stringent as this Ordinance and local limits, including required Baseline Monitoring Reports (BMRs) which are at least as stringent as those set out in Section 2.4 of this Ordinance. The requirement shall specify that such Ordinance and limits must be revised as necessary to reflect changes made to the City's Ordinance or local limits;
- (2) A requirement for the contributing municipality to submit a revised user inventory on at least an annual basis;
- (3) A provision specifying which pretreatment implementation activities, including wastewater discharge permit issuance, inspection and sampling, and enforcement, will be conducted by the contributing municipality; which of these activities will be conducted by the Director of Public Works; and which of these activities will be conducted jointly by the contributing municipality and the Director of Public Works;
- (4) A requirement for the contributing municipality to provide the Director of Public Works with access to all information that the contributing municipality obtains as part of its pretreatment activities;
- (5) Requirements for monitoring the contributing municipality's discharge;
- (6) A provision ensuring the Director of Public Works access to the facilities of users located within the contributing municipality's jurisdictional boundaries for the purpose of inspection, sampling, and any other duties deemed necessary by the Director of Public Works; and

(7) A provision specifying remedies available for breach of the terms of the intermunicipal agreement.

Article 941.6.0 Reporting Requirements

6.1 Baseline Monitoring Reports

6.2 Compliance Schedule Progress Reports

6.3 Reports on Compliance with Categorical Pretreatment Standard Deadline

6.4 Periodic Compliance Reports

6.5 Reports of Changed Conditions

6.6 Reports of Potential Problems

6.7 Reports from Unpermitted Users

6.8 Notice of Violation/Repeat Sampling and Reporting

6.9 Analytical Requirements

6.10 Sample Collection

6.11 Date of Receipt of Reports

6.12 Record Keeping

6.13 Certification Statements

6.14 Hazardous Waste Reporting

6.1 Baseline Monitoring Reports

A. Within either one hundred eighty (180) days after the effective date of a categorical pretreatment standard, or the final administrative decision on a category determination under 40 CFR 403.6(a) (4), whichever is later, existing categorical industrial users currently discharging to or scheduled to discharge to the POTW shall submit to the Director of Public Works a report which contains the information listed in Paragraph B, below. At least ninety (90) days prior to commencement of their discharge, new sources, and sources that become categorical users subsequent to the promulgation of an applicable categorical standard, shall submit to the Director of Public Works a report which contains the information listed in Paragraph B, below. A new source shall report the method of pretreatment it intends to use to meet applicable categorical standards. A new source also shall give estimates of its anticipated flow and quantity of pollutants to be discharged.

B. Users described above shall submit the information set forth below.

(1) All information required in Section 4.5A (1) (a), Section 4.5A (2), Section 4.5A (3) (a), and Section 4.5A (6).

(2) Measurement of pollutants.

- a. The User shall provide the information required in Section 4.5 A (7) (a) through (d).
- b. The User shall take a minimum of one representative sample to compile that data necessary to comply with the requirements of this paragraph.
- c. Samples should be taken immediately downstream from pretreatment facilities if such exist or immediately downstream from the regulated process if no pretreatment exists. If other wastewaters are mixed with the regulated wastewater prior to pretreatment the User should measure the flows and concentrations necessary to allow use of the combined wastestream formula in 40 CFR 403.6(e) to evaluate compliance with the Pretreatment Standards. Where an alternate concentration

- or mass limit has been calculated in accordance with 40 CFR 403.6(e) this adjusted limit along with supporting data shall be submitted to the Control Authority;
- d. Sampling and analysis shall be performed in accordance with Section 6.10;
 - e. The Director of Public Works may allow the submission of a baseline report which utilizes only historical data so long as the data provides information sufficient to determine the need for industrial pretreatment measures;
 - f. The baseline report shall indicate the time, date and place of sampling and methods of analysis, and shall certify that such sampling and analysis is representative of normal work cycles and expected pollutant Discharges to the POTW.

(3) Compliance Certification. A statement, reviewed by the user's authorized representative as defined in Section 1.4 C and certified by a qualified professional, indicating whether pretreatment standards are being met on a consistent basis, and, if not, whether additional operation and maintenance (O&M) and/or additional pretreatment is required to meet the pretreatment standards and requirements.

(4) Compliance Schedule. If additional pretreatment and/or O&M will be required to meet the pretreatment standards, the shortest schedule by which the user will provide such additional pretreatment and/or O&M must be provided. The completion date in this schedule shall not be later than the compliance date established for the applicable pretreatment standard. A compliance schedule pursuant to this section must meet the requirements set out in Section 6.2 of this Ordinance.

(5) Signature and Report Certification. All baseline monitoring reports must be certified in accordance with Section 6.13 of this ordinance and signed by an Authorized Representative as defined in Section 1.4C.

6.2 Compliance Schedule Progress Reports

The following conditions shall apply to the compliance schedule required by Section 6.1(B) (4) of this Ordinance.

A. The schedule shall contain progress increments in the form of dates for the commencement and completion of major events leading to the construction and operation of additional pretreatment required for the user to meet the applicable pretreatment standards (such events include, but are not limited to, hiring an engineer, completing preliminary and final plans, executing contracts for major components, commencing and completing construction, and beginning and conducting routine operation) ;

B. No increment referred to above shall exceed nine (9) months;

C. The user shall submit a progress report to the Director of Public Works no later than fourteen (14) days following each date in the schedule and the final date of compliance including, as a minimum, whether or not it complied with the increment of progress, the reason for any delay, and, if appropriate, the steps being taken by the user to return to the established scheduled; and

D. In no event shall more than nine (9) months elapse between such progress reports to the Director of Public Works.

6.3 Reports on Compliance with Categorical Pretreatment Standard Deadline

Within ninety (90) days following the date for final compliance with applicable categorical pretreatment standards, or in the case of a new source following commencement of the introduction of wastewater into the POTW, any user subject to such pretreatment

standards and requirements shall submit to the Director of Public Works a report containing the information described in Section 4.5(A) (6) and (7) and 6.1(B)(2) of this Ordinance. For users subject to equivalent mass or concentration limits established in accordance with the procedures in Section 2.3, this report shall contain a reasonable measure of the user's long-term production rate. For all other users subject to categorical pretreatment standards expressed in terms of allowable pollutant discharge per unit of production (or other measure of operation), this report shall include the user's actual production during the appropriate sampling period. All compliance reports must be signed and certified in accordance with Section 4.6 of this Ordinance. All sampling will be done in conformance with Section 6.10.

6.4 Periodic Compliance Reports

A. All Significant Industrial Users must, at a frequency determined by the Director of Public Works submit no less than twice per year (June and December), or on dates specified, reports indicating the nature, concentration of pollutants in the discharge which are limited by Pretreatment Standards and the measured or estimated average and maximum daily flows for the reporting period. In cases where the Pretreatment Standard requires compliance with a Best Management Practice (BMP) or pollution prevention alternative, the User must submit documentation required by the Director of Public Works or the Pretreatment Standard necessary to determine the compliance status of the User

B. All periodic compliance reports must be signed and certified in accordance with Section 6.13 of this ordinance.

C. All wastewater samples must be representative of the user's discharge. Wastewater monitoring and flow measurement facilities shall be properly operated, kept clean, and maintained in good working order at all times. The failure of a user to keep its monitoring facility in good working order shall not be grounds for the user to claim that sample results are unrepresentative of its discharge.

D. If a user subject to the reporting requirement in this section monitors any pollutant more frequently than required by the Director of Public Works, using the procedures prescribed in Sections 6.9 and 6.10 of this Ordinance, the results of this monitoring shall be included in the report.

E. All wastewater samples must be representative of the User's discharge. Wastewater monitoring and flow measurement facilities shall be properly operated, kept clean, and maintained in good working order at all times. The failure of a User to keep its monitoring facility in good working order shall not be grounds for the User to claim that sample results are unrepresentative of its discharge.

F. If a User subject to the reporting requirement in this section monitors any regulated pollutant at the appropriate sampling location more frequently than required by the Director of Public Works, using the procedures prescribed in Section 6.10 of this ordinance, the results of this monitoring shall be included in the report.

6.5 Reports of Changed Conditions

Each user must notify the Director of Public Works of any planned significant changes to the user's operations or system which might alter the nature, quality, or volume of its wastewater at least ninety (90) days before the change.

A. The Director of Public Works may require the user to submit such information as may be deemed necessary to evaluate the changed condition, including the submission of a wastewater discharge permit application under Section 4.5 of this Ordinance.

B. The Director of Public Works may issue a wastewater discharge permit under Section 5.7 of this Ordinance or modify an existing wastewater discharge permit under Section 5.4 of this Ordinance in response to changed conditions or anticipated changed conditions.

For purposes of this requirement, significant changes include, but are not limited to, flow increases of twenty (20%) percent or greater, loading increases of 20% or more for pollutants, and the discharge of any previously unreported pollutants.

6.6 Reports of Potential Problems

A. In the case of any discharge, including, but not limited to, accidental discharges, discharges of a nonroutine, episodic nature, a noncustomary batch discharge, or a slug load, that may cause potential problems for the POTW, the user shall immediately telephone and notify the Director of Public Works of the incident. This notification shall include the location of the discharge, type of waste, concentration and volume, if known, and corrective actions taken by the user.

B. Within five (5) days following such discharge, the user shall, unless waived by the Director of Public Works, submit a detailed written report describing the cause(s) of the discharge and the measures to be taken by the user to prevent similar future occurrences. Such notification shall not relieve the user of any expense, loss, damage, or other liability which may be incurred as a result of damage to the POTW, natural resources, or any other damage to person or property; nor shall such notification relieve the user of any fines, penalties, or other liability which may be imposed pursuant to this Ordinance.

C. A notice shall be permanently posted on the user's bulletin board or other prominent place advising employees who to call in the event of a discharge described in Paragraph A, above. Employers shall ensure that all employees, who may cause such a discharge to occur, are advised of the emergency notification procedure.

D. Significant Industrial Users are required to notify the Director of Public Works immediately of any changes at its facility affecting the potential for a Slug Discharge.

6.7 Reports from Unpermitted Users

All users not required to obtain a wastewater discharge permit shall provide appropriate reports to the Director of Public Works as the Director of Public Works may require.

6.8 Notice of Violation/Repeat Sampling and Reporting

If sampling performed by a user indicates a violation, the user must notify the Director of Public Works within twenty-four (24) hours of becoming aware of the violation. The user shall also repeat the sampling and analysis and submit the results of the repeat analysis to the Director of Public Works within thirty (30) days after becoming aware of the violation. Resampling by the Industrial User is not required if the City performs sampling at the User's facility at least once a month, or if the City performs sampling at the User between the time when the initial sampling was conducted and the time when the User or the City receives the results of this sampling, or if the City has performed the sampling and analysis in lieu of the Industrial User.

6.9 Analytical Requirements

All pollutant analyses, including sampling techniques, to be submitted as part of a wastewater discharge permit application or report shall be performed in accordance with the techniques prescribed in 40 CFR Part 136 and amendments thereto, unless otherwise specified in an applicable categorical Pretreatment Standard. If 40 CFR Part 136 does not contain sampling or analytical techniques for the pollutant in question, or where the EPA determines that the Part 136 sampling and analytical techniques are inappropriate for the pollutant in question, sampling and analyses shall be performed by using validated analytical methods or any other applicable sampling and analytical procedures, including procedures suggested by the Director of Public Works or other parties approved by EPA.

6.10 Sample Collection

Samples collected to satisfy reporting requirements must be based on data obtained through appropriate sampling and analysis performed during the period covered by the report, based on data that is representative of conditions occurring during the reporting period.

A. Except as indicated in Section B and C below, the User must collect wastewater samples using 24-hour flow-proportional

composite sampling techniques, unless time-proportional composite sampling or grab sampling is authorized by the Director of Public Works. Where time-proportional composite sampling or grab sampling is authorized by the City, the samples must be representative of the discharge. Using protocols (including appropriate preservation) specified in 40 CFR Part 136 and appropriate EPA guidance, multiple grab samples collected during a 24-hour period may be composited prior to the analysis as follows: for cyanide, total phenols, and sulfides the samples may be composited in the laboratory or in the field; for volatile organics and oil and grease, the samples may be composited in the laboratory. Composite samples for other parameters unaffected by the compositing procedures as documented in approved EPA methodologies may be authorized by the City, as appropriate. In addition, grab samples may be required to show compliance with Instantaneous Limits.

B. Samples for oil and grease, temperature, pH, cyanide, total phenols, sulfides, and volatile organic compounds must be obtained using grab collection techniques.

C. For sampling required in support of baseline monitoring and 90-day compliance reports required in Section 6.1 and 6.3 [40 CFR 403.12(b) and (d)], a minimum of four (4) grab samples must be used for pH, cyanide, total phenols, oil and grease, sulfide and volatile organic compounds for facilities for which historical sampling data do not exist; for facilities for which historical sampling data are available, the Director of Public Works may authorize a lower minimum. For the reports required by Section 6.4 (40 CFR 403.12(e) and 403.12(h)), the Industrial User is required to collect the number of grab samples necessary to assess and assure compliance by with applicable Pretreatment Standards and Requirements.

6.11 Date of Receipt of Reports

Written reports will be deemed to have been submitted on the date postmarked. For reports which are not mailed, postage prepaid, into a mail facility serviced by the United States Postal Service, the date of receipt of the report shall govern.

6.12 Record Keeping

Users subject to the reporting requirements of this Ordinance shall retain, and make available for inspection and copying, all records of information obtained pursuant to any monitoring activities required by this Ordinance and any additional records of information obtained pursuant to monitoring activities undertaken by the user independent of such requirements, and documentation associated with Best Management Practices established under Section 2.4 C. Records shall include the date, exact place, method, and time of sampling, and the name of the person(s) taking the samples; the dates analyses were performed; who performed the analyses; the analytical techniques or methods used; and the results of such analyses. These records shall remain available for a period of at least three (3) years. This period shall be automatically extended for the duration of any litigation concerning the user or the City, or where the user has been specifically notified of a longer retention period by the Director of Public Works.

6.13 Certification Statements

A. Certification of Permit Applications, User Reports—The following certification statement is required to be signed and submitted by Users submitting permit applications in accordance with Section 4.6; Users submitting baseline monitoring reports under Section 6.1 B (5); Users submitting reports on compliance with the categorical Pretreatment Standard deadlines under Section 6.3; Users submitting periodic compliance reports required by Section 6.4. The following certification statement must be signed by an Authorized Representative as defined in Section 1.4 C:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system,

or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

B. Annual Certification for Non-Significant Categorical Industrial Users—A facility determined to be a Non-Significant Categorical Industrial User by the Director of Public Works pursuant to 1.4 JJ(3) and 4.6 C must annually submit the following certification statement signed in accordance with the signatory requirements in 1.4 C. This certification must accompany an alternative report required by the Director of Public Works:

Based on my inquiry of the person or persons directly responsible for managing compliance with the categorical Pretreatment Standards under 40 CFR _____, I certify that, to the best of my knowledge and belief that during the period from _____, _____ to _____, _____ [months, days, year]:

(a) The facility described as _____ [facility name] met the definition of a Non-Significant Categorical Industrial User as described in 1.4 II (3);

(b) The facility complied with all applicable Pretreatment Standards and requirements during this reporting period; and (c) the facility never discharged more than 100 gallons of total categorical wastewater on any given day during this reporting period.

This compliance certification is based on the following information.

6.14 Hazardous Waste Reporting

Although hazardous wastes are specifically prohibited in Section 2.1 (18), if any user accidentally discharges a hazardous waste the reporting requirements at 40 CFR 403.12(p) (1) shall be adhered to.

Article 941.7.0 Compliance Monitoring
7.1 Right of Entry: Inspection and Sampling
7.2 Search Warrants

7.1 Right of Entry: Inspection and Sampling

The Director of Public Works shall have the right to enter the premises of any user to determine whether the user is complying with all requirements of this Ordinance and any wastewater discharge permit or order issued hereunder. Users shall allow the Director of Public Works ready access to all parts of the premises for the purposes of inspection, sampling, records examination and copying, and the performance of any additional duties.

A. Where a user has security measures in force which require proper identification and clearance before entry into its premises, the user shall make necessary arrangements with its security guards so that, upon presentation of suitable identification, the Director of Public Works will be permitted to enter without delay for the purposes of performing specific responsibilities.

B. The Director of Public Works shall have the right to set up on the user's property, or require installation of, such devices as are

necessary to conduct sampling and/or metering of the user's operations.

C. The Director of Public Works may require the user to install monitoring equipment as necessary. The facility's sampling and monitoring equipment shall be maintained at all times in a safe and proper operating condition by the user at its own expense. All devices used to measure wastewater flow and quality shall be calibrated annually to ensure their accuracy.

D. Any temporary or permanent obstruction to safe and easy access to the facility to be inspected and/or sampled shall be promptly removed by the user at the written or verbal request of the Director of Public Works and shall not be replaced. The costs of clearing such access shall be born by the user.

E. Unreasonable delays in allowing the Director of Public Works access to the user's premises shall be a violation of this Ordinance.

7.2 Search Warrants

If the Director of Public Works has been refused access to a building, structure, or property, or any part thereof, and is able to demonstrate probable cause to believe that there may be a violation of this Ordinance, or that there is a need to inspect and/or sample as part of a routine inspection and sampling program of the City designed to verify compliance with this Ordinance or any permit or order issued hereunder, or to protect the overall public health, safety and welfare of the community, then the Director of Public Works may seek issuance of a search warrant from the appropriate issuing authority.

Article 941.8.0 Confidential Information

Information and data on a user obtained from reports, surveys, wastewater discharge permit applications, wastewater discharge permits, and monitoring programs, and from the Director of Public Works inspection and sampling activities, shall be available to the public without restriction, unless the user specifically requests, and is able to demonstrate to the satisfaction of the Director of Public Works, that the release of such information would divulge information, processes, or methods of production entitled to protection as trade secrets under applicable State law. Any such request must be asserted at the time of submission of the information or data. When requested and demonstrated by the user furnishing a report that such information should be held confidential, the portions of a report which might disclose trade secrets or secret processes shall not be made available for inspection by the public, but shall be made available immediately upon request to governmental agencies for uses related to the NPDES program or pretreatment program, and in enforcement proceedings involving the person furnishing the report. Wastewater constituents and characteristics and other "effluent data" as defined by 40 CFR 2.302 will not be recognized as confidential information and will be available to the public without restriction.

Article 941.9.0 Publication of Users in Significant Noncompliance

The Director of Public Works shall publish annually, in a newspaper of general circulation that provides meaningful public notice within the jurisdictions served by the POTW, a list of the users which, during the previous twelve (12) months, were in significant noncompliance with applicable pretreatment standards and requirements. The term Significant Noncompliance shall be applicable to all Significant Industrial Users (or any other Industrial User that violates paragraphs (C), (D) or (H) of this Section) and shall mean:

A. Chronic violations of wastewater discharge limits, defined here as those in which sixty-six percent (66%) or more of all the measurements taken for the same pollutant parameter taken during a six- (6-) month period exceed (by any magnitude) a numeric Pretreatment Standard or Requirement, including Instantaneous Limits as defined in Section 2;

B. Technical Review Criteria (TRC) violations, defined here as those in which thirty-three percent (33%) or more of wastewater measurements taken for each pollutant parameter during a six (6) month period equals or exceeds the product of the numeric Pretreatment Standard or Requirement including Instantaneous Limits, as defined by Section 2 multiplied by the applicable criteria (1.4 for BOD, TSS, fats, oils and grease, and 1.2 for all other pollutants except pH);

C. Any other violation of a Pretreatment Standard or Requirement as defined by Section 2 (Daily Maximum, long-term average, Instantaneous Limit, or narrative standard) that the Director of Public Works determines has caused, alone or in combination with other discharges, Interference or Pass Through, including endangering the health of POTW personnel or the general public;

D. Any discharge of a pollutant that has caused imminent endangerment to the public or to the environment, or has resulted in the Director of Public Works exercising his emergency authority to halt or prevent such a discharge;

E. Failure to meet, within ninety (90) days of the scheduled date, a compliance schedule milestone contained in an wastewater discharge permit or enforcement order for starting construction, completing construction, or attaining final compliance;

F. Failure to provide within forty-five (45) days after the due date, any required reports, including baseline monitoring reports, reports on compliance with categorical Pretreatment Standard deadlines, periodic self-monitoring reports, and reports on compliance with compliance schedules;

G. Failure to accurately report noncompliance; or

H. Any other violation(s), which may include a violation of Best Management Practices, which the Director of Public Works determines will adversely affect the operation or implementation of the local pretreatment program.

Article 941.10.0 Administrative Enforcement Remedies

10.1 Notification of Violation

10.2 Consent Order

10.3 Show Cause Hearing

10.4 Compliance Orders

10.5 Cease and Desist Orders

10.6 Administrative Fines

10.7 Emergency Suspensions

10.8 Termination of Discharge

10.1 Notification of Violation

When the Director of Public Works finds that a user has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit or order issued hereunder, or any other pretreatment standard or requirement, the Director of Public Works may serve upon that user a written Notice of Violation. Within twenty (20) days of the receipt of this notice, an explanation of the violation and a plan for the satisfactory correction and prevention thereof, to include specific required actions, shall be submitted by the user to the Director of Public Works. Submission of this plan in no way relieves the user of liability for any violations occurring before or after receipt of the Notice of Violation. Nothing in this section shall limit the authority of the Director of Public Works to take any action, including emergency actions or any other enforcement action, without first issuing a Notice of Violation.

10.2 Consent Order

The Director of Public Works may enter into Consent Orders, assurances of voluntary compliance, or other similar documents establishing an agreement with any user responsible for noncompliance. Such documents will include specific action to be taken by the user to correct the noncompliance within a time period specified by the document. Such documents shall have the same force and effect as the administrative orders issued pursuant to Sections 10.4 and 10.5 of this ordinance and shall be judicially enforceable.

10.3 Show Cause Hearing

The Director of Public Works may order a user which has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit or order issued hereunder, or any other pretreatment standard or requirement, to appear before the Director of Public Works and show cause why the proposed enforcement action should not be taken. Notice shall be served on the user specifying the time and place for the meeting, the proposed enforcement action, the reasons for such action, and a request that the user show cause why the proposed enforcement action should not be taken. The notice of the meeting shall be served personally or by registered or certified mail (return receipt requested) at least ten (10) days prior to the hearing. Such notice may be served on any authorized representative of the user. A show cause hearing shall not be a bar against, or prerequisite for, taking any other action against the user.

10.4 Compliance Orders

When the Director of Public Works finds that a User has violated, or continues to violate, any provision of this ordinance, a wastewater discharge permit, or order issued hereunder, or any other Pretreatment Standard or Requirement, the Director of Public Works may issue an order to the User responsible for the discharge directing that the User come into compliance within a specified time. If the User does not come into compliance within the time provided, sewer service may be discontinued unless adequate treatment facilities, devices, or other related appurtenances are installed and properly operated. Compliance orders also may contain other requirements to address the noncompliance, including additional self monitoring and management practices designed to minimize the amount of pollutants discharged to the sewer. A compliance order may not extend the deadline for compliance established for a Pretreatment Standard or Requirement, nor does a compliance order relieve the User of liability for any violation, including any continuing violation. Issuance of a compliance order shall not be a bar against, or a prerequisite for, taking any other action against the User.

10.5 Cease and Desist Orders

When the Director of Public Works finds that a user has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit or order issued hereunder, or any other pretreatment standard or requirement, or that the user's past violations are likely to recur, the Director of Public Works may issue an order to the user directing it to cease and desist all such violations and directing the user to:

A. Immediately comply with all requirements; and

B. Take such appropriate remedial or preventive action as may be needed to properly address a continuing or threatened violation, including halting operations and/or terminating the discharge. Issuance of a cease and desist order shall not be a bar against, or a prerequisite for, taking any other action against the User.

10.6 Administrative Fines

A. When the Director of Public Works finds that a user has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit or order issued hereunder, or any other pretreatment standard or requirement, the Director of Public Works may fine such user in an amount not to exceed \$25,000 regardless of jurisdictional boundaries. Such penalties shall be assessed on a per violation, per day basis. In the case of monthly or other long term average discharge limits, penalty shall be

assessed for each day during the period of violation. The penalties may be assessed whether or not the violation was willful or negligent.

B. Notice of assessment of penalty shall state the appeal process to be followed including the name, address and telephone number of the person responsible for accepting such appeal. Said notice shall also contain the date or dates of violation the permit requirement that was violated and the amount of penalty assessed. The notice shall state the time frame for appeal. It shall be served personally on the violator or shall be sent by certified mail to the address of the permit holder as noted on the permit.

The penalty shall be assessed in accordance with Chart for Assessment, below, which sets forth the City of Allentown's assessment policy considering damage to air, water, land or other natural resources, cost of restoration and abatement, savings resulting to the person for the violation, history of past violations, deterrence of future violations and other relevant factors.

Chart for Assessment

<u>Damage to Environment</u>	<u>Points</u>	<u>Cost of Restoration/Abatement</u>	<u>Points</u>
Extreme	5	Over 10,000	5
Severe	4	7,000	4
Moderate	3	5,000	3
Slight	2	2,500	2
None	1	0	

Past Violations

<u>Savings to Violator</u>	<u>Points</u>	<u>No. of Violations in Last 365 Days</u>	<u>Points</u>
10,000	5	5	5
7,500	4	4	4
5,000	3	3	3
2,500	2	2	2
0	1	1	1

Other Factors will be Considered

Other factors which may be considered include, but are not limited to; damage to POTW, willfulness or concealment, endangerment to the public and/or POTW personnel.

Points shall be assessed for a violation in accordance with the above chart which constitutes the City of Allentown assessment policy.

Points shall be totaled and the fine shall be assessed as follows:

<u>Number of Points</u>	<u>Penalty</u>
25	\$25,000
20	20,000
15	15,000
10	10,000
5	5,000

The assessment of penalties may include numbers which are not whole, such as 1.5, to allow flexibility and discretion by the Director of Public Works in arriving at a fair and appropriate penalty. The above listed fine shall be then pro-rated to reflect the less than whole number of points assessed.

Example: Total Points = 12.5
Civil Penalty = \$12,500.00

All fines collected shall be placed in a restricted account and shall only be used by the City of Allentown to repair damage and provide for additional maintenance and costs as a result of violations, to pay penalties imposed by State or Federal Government for violation of pretreatment standards, for the costs of investigation and enforcement action, for monitoring of discharge in the pretreatment program and for capital improvement to the POTW.

Any party seeking to appeal the assessment of a fine shall do so by filing a notice of appeal with the Director of Public Works within thirty (30) days after receipt or service of said notice.

The Appeal Board shall hear all such appeals. A transcript shall be made of said hearing at the sole expense of the appellant.

Appellant shall pay the cost of appeal and the sum for estimate of stenographer bills at the time of filing said appeal. Failure to pay said sums at the time of filing shall make the appeal void. Such fees shall be established as required by the Charter.

After the hearing, any additional stenographer charges shall be billed to appellant and shall be paid in full within ten (10) days of receipt or appeal shall be null and void ab initio.

The Appeals Board shall either affirm the decision of the Director of Public Works or reverse or modify the same as the substantial evidence indicates in accordance with the assessment policy adopted by the City. Appeals from the decision of the Appeals Board shall be in accordance with State law. Each permit holder shall keep the City apprised in writing of any change in mailing address. The address on the permit shall be used to send all correspondence and notice of civil assessment to permit holders. The sending of a notice of civil assessment to a permit holder's address on permit shall conclusively be presumed to be valid service; thus, if the certified mail sent to such address is not accepted or picked up by permit holder, the date of service shall be the date that the certified mail was rejected or returned unclaimed.

The City shall charge all costs for re-establishing the operation of the publicly owned treatment works after a user has violated, or continues to violate any provision of this Ordinance, a wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement. These costs shall be paid by user within ten (10) days after notice of assessment of the same. Notice and appeal rights shall be the same as in the case of assessment of civil penalties. Any user not paying said assessment shall pay an additional penalty of five (5%) percent of the penalty per month or any part thereof.

Issuance of an administrative fine shall not be a bar against, or a prerequisite for, taking any other action against the user.

10.7 Emergency Suspensions

The Director of Public Works may immediately suspend a User's discharge, after informal notice to the User, whenever such suspension is necessary to stop an actual or threatened discharge, which reasonably appears to present, or cause an imminent or substantial endangerment to the health or welfare of persons. the Director of Public Works may also immediately suspend a User's

discharge, after notice and opportunity to respond, that threatens to interfere with the operation of the POTW, or which presents, or may present, an endangerment to the environment.

A. Any User notified of a suspension of its discharge shall immediately stop or eliminate its contribution. In the event of a User's failure to immediately comply voluntarily with the suspension order, the Director of Public Works may take such steps as deemed necessary, including immediate severance of the sewer connection, to prevent or minimize damage to the POTW, its receiving stream, or endangerment to any individuals. the Director of Public Works may allow the User to recommence its discharge when the User has demonstrated to the satisfaction of the Director of Public Works that the period of endangerment has passed, unless the termination proceedings in Section 10.8 of this ordinance are initiated against the User.

C. A User that is responsible, in whole or in part, for any discharge presenting imminent endangerment shall submit a detailed written statement, describing the causes of the harmful contribution and the measures taken to prevent any future occurrence, to the Director of Public Works prior to the date of any show cause or termination hearing under Sections 10.3 or 10.8 of this ordinance.

Nothing in this Section shall be interpreted as requiring a hearing prior to any Emergency Suspension under this Section.

10.8 Termination of Discharge

In addition to the provisions in Section 5.6 of this ordinance, any User who violates the following conditions is subject to discharge termination:

- A. Violation of wastewater discharge permit conditions;
- B. Failure to accurately report the wastewater constituents and characteristics of its discharge;
- C. Failure to report significant changes in operations or wastewater volume, constituents, and characteristics prior to discharge;
- D. Refusal of reasonable access to the User's premises for the purpose of inspection, monitoring, or sampling; or
- E. Violation of the Pretreatment Standards in Section 2 of this ordinance.

Such User will be notified of the proposed termination of its discharge and be offered an opportunity to show cause under Section 10.3 of this ordinance why the proposed action should not be taken. Exercise of this option by the Director of Public Works shall not be a bar to, or a prerequisite for, taking any other action against the User.

Article 941.11.0 Judicial Enforcement Remedies

11.1 Injunctive Relief

11.2 Civil Penalties

11.3 Criminal Prosecution

11.4 Remedies Nonexclusive

11.1 Injunctive Relief

When the Director of Public Works finds that a user has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement, the Director of Public Works may petition the Lehigh County Court of Common Pleas through the City Solicitor for the issuance of a temporary or permanent injunction,

as appropriate, which restrains or compels the specific performance of the wastewater discharge permit, order, or other requirement imposed by this Ordinance on activities of the user. The Director of Public Works may also seek such other action as is appropriate for legal and/or equitable relief, including a requirement for the user to conduct environmental remediation. A petition for injunctive relief shall not be a bar against, or a prerequisite for, taking any other action against a user.

11.2 Civil Penalties

A. A user who has violated, or continues to violate, any provision of this Ordinance, a wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement shall be liable to the City for a maximum civil penalty of \$25,000.00 per violation, per day. In the case of a monthly or other long-term average discharge limit, penalties shall accrue for each day during the period of the violation.

B. The Director of Public Works may recover reasonable attorneys' fees, court costs, and other expenses associated with enforcement activities, including sampling and monitoring expenses, and the cost of any actual damages incurred by the City.

C. In determining the amount of civil liability, the Court shall take into account all relevant circumstances, including, but not limited to, the extent of harm caused by the violation, the magnitude and duration of the violation, any economic benefit gained through the user's violation, corrective actions by the user, the compliance history of the user, and any other factor as justice requires.

Filing a suit for civil penalties shall not be a bar against, or a prerequisite for, taking any other action against a user.

11.3 Criminal Prosecution

A. A user who willfully or negligently violates any provision of this Ordinance, a wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement shall, upon conviction, be guilty of a summary offense, punishable by a fine of not more than \$1,000 per violation, per day, or imprisonment for not more than ninety (90) days, or both.

B. A user who willfully or negligently introduces any substance into the POTW which causes personal injury or property damage shall, upon conviction, be guilty of a misdemeanor and be subject to a penalty of at least \$1,000, or be subject to imprisonment for not more than ninety (90) days, or both. This penalty shall be in addition to any other cause of action for personal injury or property damage available under State law.

C. A user who knowingly makes any false statements, representations, or certifications in any application, record, report, plan, or other documentation filed, or required to be maintained, pursuant to this Ordinance, wastewater discharge permit, or order issued hereunder, or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required under this Ordinance shall, upon conviction, be punished by a fine of not more than \$1,000 per violation, per day, or imprisonment for not more than ninety (90) days, or both.

D. In the event of a second conviction, a User shall be punished by a fine of not more than \$1,000 per violation, per day, or imprisonment for not more than one (1) years, or both.

11.4 Remedies Nonexclusive

The remedies provided for in this Ordinance are not exclusive. The Director of Public Works may take any, all, or any combination of these actions against a noncompliant user. Enforcement of pretreatment violations will generally be in accordance with the City's enforcement response plan. However, the Director of Public Works may take other action against any user when the circumstances

warrant. Further, the Director of Public Works is empowered to take more than one enforcement action against any noncompliant user.

Article 941.12.0 Supplemental Enforcement Action

12.1 Performance Bonds

12.2 Liability Insurance

12.3 Water Supply Severance

12.4 Contractor Listing

12.1 Performance Bonds

The Director of Public Works may decline to issue or reissue a wastewater discharge permit to any user who has failed to comply with any provision of this Ordinance, a previous wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement, unless such user first files a satisfactory bond, payable to the City, in a sum not to exceed a value determined by the Director of Public Works to be necessary to achieve consistent compliance.

12.2 Liability Insurance

The Director of Public Works may decline to issue or reissue a wastewater discharge permit to any user who has failed to comply with any provision of this Ordinance, a previous wastewater discharge permit, or order issued hereunder, or any other pretreatment standard or requirement, unless the user first submits proof that it has obtained financial assurances sufficient to restore or repair damage to the POTW caused by its discharge.

12.3 Water Supply Severance

Whenever a User has violated or continues to violate any provision of this ordinance, a wastewater discharge permit, or order issued hereunder, or any other Pretreatment Standard or Requirement, water service to the User may be severed. Service will recommence, at the User's expense, only after the User has satisfactorily demonstrated its ability to comply.

12.4 Contractor Listing

Users which have not achieved compliance with applicable pretreatment standards and requirements are not eligible to receive a contractual award for the sale of goods or services to the City. Existing contracts for the sale of goods or services to the City held by a user found to be in significant noncompliance with pretreatment standards or requirements may be terminated at the discretion of the Director of Public Works.

Article 941.13.0 Affirmative Defenses to Discharge Violations

13.1 Upset

13.2 Prohibited Discharge Standards

13.3 Bypass

13.1 Upset

A. For the purpose of this section, "upset" means an exceptional incident in which there is unintentional and temporary noncompliance with categorical pretreatment standards because of factors beyond the reasonable control of the user. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.

B. An upset shall constitute an affirmative defense to an action brought for noncompliance with categorical pretreatment standards if the requirements of paragraph (C), below, are met.

C. A user who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:

(1) An upset occurred and the user can identify the cause(s) of the upset;

(2) The facility was at the time being operated in a prudent and workman-like manner and in compliance with applicable operation and maintenance procedures; and

(3) The user has submitted the following information to the Director of Public Works within twenty-four (24) hours of becoming aware of the upset [if this information is provided orally, a written submission must be provided within five (5) days] ;

(a) A description of the indirect discharge and cause of noncompliance;

(b) The period of noncompliance, including exact dates and times or, if not corrected, the anticipated time the noncompliance is expected to continue; and

(c) Steps being taken and/or planned to reduce, eliminate, and prevent recurrence of the noncompliance.

D. In any enforcement proceeding, the user seeking to establish the occurrence of an upset shall have the burden of proof.

E. Users will have the opportunity for a judicial determination on any claim of upset only in an enforcement action brought for noncompliance with categorical pretreatment standards.

F. Users shall control production of all discharges to the extent necessary to maintain compliance with categorical pretreatment standards upon reduction, loss, or failure of its treatment facility until the facility is restored or an alternative method of treatment is provided. This requirement applies in the situation where, among other things, the primary source of power of the treatment facility is reduced, lost, or fails.

13.2 Prohibited Discharge Standards

A user shall have an affirmative defense to an enforcement action brought against it for noncompliance with the general prohibitions in Section 2.1(A) of this Ordinance or the specific prohibitions in Sections 2.1(B) (3) through (17) of this Ordinance if it can prove that it did not know, or have reason to know, that its discharge, alone or in conjunction with discharges from other sources, would cause pass through or interference and that either:

A. A local limit exists for each pollutant discharged and the user was in compliance with each limit directly prior to, and during, the pass through or interference; or

B. No local limit exists, but the discharge did not change substantially in nature or constituents from the user's prior discharge

when the City was regularly in compliance with its NPDES permit, and in the case of interference, was in compliance with applicable biosolids use or disposal requirements.

13.3 Bypass

A. For the purpose of this section:

(1) "**Bypass**" means the intentional diversion of wastestreams from any portion of a user's treatment facility.

(2) "**Severe property damage**" means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.

B. A user may allow any bypass to occur which does not cause pretreatment standards or requirements to be violated, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provision of paragraphs (C) and (D) of this section.

C. Bypass Notifications

(1) If a user knows in advance of the need for a bypass, it shall submit prior notice to the Director of Public Works, at least ten (10) days before the date of the bypass, if possible.

(2) A user shall submit oral notice to the Director of Public Works of an unanticipated bypass that exceeds applicable pretreatment standards within twenty-four (24) hours from the time it becomes aware of the bypass. A written submission shall also be provided within five (5) days of the time the user becomes aware of the bypass. The written submission shall contain a description of the bypass and its cause; the duration of the bypass, including exact dates and times, and if the bypass has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the bypass. The Director of Public Works may waive the written report on a case-by-case basis if the oral report has been received within twenty-four (24) hours.

D. Bypass

(1) Bypass is prohibited, and the Director of Public Works may take an enforcement action against a user for a bypass, unless

(a) Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;

(b) There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and

(c) The user submitted notices as required under paragraph (C) of this section.

(2) The Director of Public Works may approve an anticipated bypass, after considering its adverse effects, if the Director of Public Works determines that it will meet the three (3) conditions listed in paragraph (D) (1) of this section.

Article 941.14.0 Hearing Board

An Industrial Hearing Board, with the exception of the Council appointment which shall be made by the Council President, shall be appointed by the Mayor with the advice and consent of Council, for resolution of differences between the Industrial Waste Manager and owners of any improved property on matters concerning interpretation and execution of the provisions of this Article by the Industrial Waste Manager. If possible, appointments shall be City residents and the City Council designee shall be a City resident.

A. One (1) member of the Board shall be a member of the Public Works Department; one (1) member shall be a professional engineer skilled in practice of sanitary engineering; one (1) member shall be a representative of industry or manufacturing enterprise; one (1) member shall be a lawyer; and one (1) member shall be from City Council or their designee.

(1) The initial appointments to the Board shall be for the following terms:

Public Works Department Representative – five (5) years
Professional Engineer (Sanitary Engineer) – four (4) years
Industrial Representative – three (3) years
Legal Representative – two (2) years
City Council Member or Designee – one (1) year

(2) All succeeding terms shall be for a period of five (5) years. The Mayor, with the consent of Council, shall appoint representatives to fill vacancies on the Board to complete unexpired terms. Interim appointments may be permitted to serve an additional full term on the Board.

B. The Hearing Board shall have the following powers:

- (1) To hear appeals from any person aggrieved by the application of this Article;
- (2) To make rules with regard to conducting its hearings, such rules to be submitted to Council for their advice and consent;
- (3) To make such findings of fact as may be required by the application of this Article;
- (4) To decide questions presented.

Aggrieved parties seeking judicial review of the decision of the Industrial Waste Hearing Board must file an appeal pursuant to State law.

Article 941.15.0 Miscellaneous Provisions

15.1 Pretreatment Charges and Fees

15.2 Severability

15.1 Pretreatment Charges and Fees

The City may adopt reasonable fees for reimbursement of costs of setting up and operating the City's Pretreatment Program which may include:

- A. Fees for wastewater discharge permit applications including the cost of processing such applications;
- B. Fees for monitoring, inspection, and surveillance procedures including the cost of collection and analyzing a user's discharge, and reviewing monitoring reports and certifications submitted by users;
- C. Fees for reviewing and responding to accidental discharge procedures and construction;
- D. Fees for filing appeals;
- E. Fees to recover administrative and legal costs associated with the enforcement activity taken by the Director of Public Works to address IU noncompliance; and
- F. Other fees as the City may deem necessary to carry out the requirements contained herein. These fees relate solely to the matters covered by this Ordinance and are separate from all other fees, fines and penalties chargeable by the City.

Such fees shall be established as required by the Charter.

15.2 Severability

If any provision of this Ordinance is invalidated by any court of competent jurisdiction, the remaining provisions shall not be effected and shall continue in full force and effect.

Article 941.16.0 Surcharge

16.1 Surcharge

16.1 Surcharge

A. In the event that any user is discharging waste having average Biochemical Oxygen Demand, Suspended Solids, or Total Kjeldahl Nitrogen exceeding 300, 360, or 85 respectively, such waste will be subject to, payment of a surcharge by such user, or by proper and continuous pretreatment before discharge into the sewerage system. However, no such waste of unusual strength or character shall allow violation of federal pretreatment requirements. The surcharge shall be reviewed annually, and shall be initially determined by the following formula:

$$\text{QUARTERLY SURCHARGE} = 8.34 Q [(BOD - 300) \$0.085 + (SS - 360) \$0.076 + (TKN - 85) \$0.184]$$

Where: 8.34 is a constant used to convert waste strength expressed in mg/l of BOD and/or SS and/or TKN into pounds of BOD and/or SS and/or TKN per million gallons of waste.

Q is the quarterly waste flow from an improved property expressed in millions of gallons.

BOD is the biochemical oxygen demand of the waste in mg/l.

SS is the suspended solids of the waste in mg/l.

TKN is the total Kjeldahl nitrogen of the waste in mg/l.

B. To determine the strength of every waste requiring a surcharge, the City shall sample and analyze four (4) times each year.

For users discharging more than one million (1,000,000) gallons per day, sampling shall consist of seven (7) twenty-four (24) hour composite samples taken every day for seven (7) consecutive days. For users discharging less than one million (1,000,000) gallons per day, the City will determine appropriate sampling and analyses periods. The City will consider any relevant factors an industry brings forth in deciding the sampling period. The average of said analysis shall be used to establish the surcharge for the quarter during which the samples are taken and quarterly billings shall be made by the City.

C. Whenever the Director of Public Works shall deem it necessary for the protection and safe, economical and efficient management of the POTW a user shall provide at their expense such facilities for preliminary treatment and processing of industrial waste as may be necessary to:

Reduce BOD to three hundred (300) mg/l and suspended solids to three hundred sixty (360) mg/l and total Kjeldahl nitrogen to eighty-five (85) mg/l;

**ARTICLE 942
STORM SEWER ORDINANCE**

942.1 General Provisions
942.2 General Municipal Separate Storm Water System Use Requirements
942.3 Treatment of Storm Water
942.4 Reporting
942.5 Compliance Monitoring
942.6 Confidential Information
942.7 Regulation of Storm Water Received from Other Jurisdictions
942.8 Administrative Enforcement Remedies
942.9 Judicial Enforcement Remedies
942.10 Hearing Board
942.11 Miscellaneous Provisions
942.12 Effective Date

1.1 Purpose and Policy

The City Council hereby finds and determines that there is a public need to control the quality of storm water drainage flowing through the municipal storm sewer and into the waters of the Commonwealth and of the United States and, further, that this is a matter that affects the public health, safety, welfare, and recreational opportunities of the inhabitants of the City. Therefore, it is necessary for the City to provide a comprehensive system of regulation and enforcement for the control of the quality of storm water drainage through the enactment of this article.

This ordinance sets forth uniform requirements for users of the municipal separate storm sewer system of the City of Allentown and enables the City to comply with all applicable State and Federal laws, including the Water Quality Act and the Clean Water Act (33 United States Code §1251 et seq.) and Regulations (40 Code of Federal Regulations Part 122). The objectives of this ordinance are:

- A. To maintain and improve the quality of receiving waters by improving the quality of stormwater discharges.
- B. To control and prevent the introduction of pollutants into the municipal separate storm sewer system that will pass into receiving waters.
- C. To enable the City to comply with its National Pollutant Discharge Elimination System permit conditions, and any Federal or State laws to which the municipal separate storm sewer is subject.

This ordinance shall apply to all users of the municipal separate storm sewer. The ordinance authorizes the issuance of stormwater discharge permits; provides for monitoring, compliance, and enforcement activities; establishes administrative review procedures; requires user reporting; and provides for the setting of fees for the equitable distribution of costs resulting from the program established herein.

1.2 Administration

Except as otherwise provided herein, the Manager of Water Resources shall administer, implement, and enforce the provisions of this ordinance. Any powers granted to or duties imposed upon the Manager of Water Resources may be delegated by the Manager of Water Resources to other City personnel.

1.3 Abbreviations

The following abbreviations, when used in this ordinance, shall have the designated meanings:

BMP - Best Management Practices

CMP - Corrugated Metal Pipe.

DEP - The Pennsylvania Department of Environmental Protection

EPA - Environmental Protection Agency.

FIFRA - Federal Insecticide, Fungicide, and Rodenticide Act (7 U.S.C. 136 et seq.).

HSWA - Hazardous and Solid Waste Act of 1984 (P.L. 98-616).

MBAS - Methylene blue active substances.

MEP - Maximum extent practicable (treatment standards for municipal separate storm sewer point sources).

NPDES - National Pollutant Discharge Elimination System

NRC - National Response Center (800) 424-8802

OWEP - Office of Water Enforcement and Permits, EPA Headquarters, Washington, D.C.

pH - The negative log of a hydrogen ion concentration, commonly used parameter to measure acidity.

RCRA - Resource Conservation and Recovery Act (42 U.S.C. 6901 et seq).

SCS - Soil Conservation Service.

SPCC - Spill Prevention Control and Countermeasure plan under section 311 of the Clean Water Act.

TOC - Total organic carbon.

TSS - Total suspended solids.

USGS - United States Geological Survey.

1.4 Definitions

Unless a provision explicitly states otherwise, the following terms and phrases, as used in this ordinance, shall have the meanings hereinafter designated.

Act - Clean Water Act (33 U.S.C. 1251 et seq.), including amendments resulting from the Water Quality Act of 1987.

Agency - U.S. Environmental Protection Agency and/or PA Department of Environmental Protection.

Applicable Standards and Limitations - All State, interstate, and Federal standards and limitations to which a "discharge" a "sewage sludge use or disposal practice", or a related activity is subject under the Clean Water Act (CWA), including "effluent limitations", water quality standards, standards of performance, toxic effluent standards or prohibitions, "best management practices", pretreatment standards, and "standards for sewage sludge use or disposal" under sections 301, 302, 303, 304, 306, 307, 308, 403 and 405 of CWA.

Authorized Representative of the User -

(1) If the user is a corporation:

(a) The president, secretary, treasurer, or a vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or

(b) The manager of one or more manufacturing, production, or operation facilities employing more than two hundred fifty (250) persons or having gross annual sales or expenditures exceeding twenty-five (25) million dollars (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.

(2) If the user is a partnership or sole proprietorship: a general partner or proprietor, respectively.

(3) If the user is a Federal, State, or local governmental facility: a director or highest official appointed or designated to oversee the operation and performance of the activities of the government facility, or their designee.

(4) The individuals described in paragraphs 1 through 3, above, may designate another authorized representative if the authorization is in writing, the authorization specifies the individual or position responsible for the overall operation of the facility from which the discharge originates or having overall responsibility for environmental matters for the company, and the written authorization is submitted to the City.

Best Management Practice (BMP) - Stormwater quality control measures including schedules of activities, prohibitions of practices, maintenance procedures, capital improvements and other management practices to prevent or reduce the pollution of "waters of the United States". BMPs also include treatment requirements, operating procedures, training/educational programs, and practices to control site runoff, spillage or leaks, or drainage from raw material storage.

Biochemical Oxygen Demand (BOD) - The oxygen utilized during a specified incubation period for the biochemical degradation of organic material, and inorganic material such as sulfides, in a sample.

Chemical Oxygen Demand (COD) - The oxygen equivalent of the organic matter content in a sample that is susceptible to oxidation by a strong chemical oxidant.

City - The City of Allentown or the City Council of Allentown.

Code of Federal Regulations (CFR) - A compilation of all Federal regulations implementing the various Federal acts.

Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) (42 U.S.C. 9601 et seq.) - Also known as Superfund. Amended by the Superfund Amendments and Reauthorization Act of 1986 (SARA).

Effluent Limitation - Any restriction imposed by the EPA on quantities, discharge rates, and concentrations of "pollutants" which are "discharged" from "point sources" into "waters of the United States", the waters of the "contiguous zone", or the ocean.

Effluent Limitations Guidelines - A regulation published by the EPA under section 304(b) of CWA to adopt or revise "effluent limitations".

Federal Register - A daily publication of the U.S. Government that provides a uniform system for making available to the public regulations and legal notices issued by Federal Agencies.

Illicit Discharge - Any discharge to a municipal separate storm sewer that is not composed entirely of storm water, except discharges pursuant to a National Pollutant Discharge Elimination System (NPDES) permit.

Limited Co-Permittee - A permittee to a National Pollutant Discharge Elimination System (NPDES) permit that is only responsible for permit conditions relating to the discharge for which it is owner or operator.

Major Municipal Separate Storm Sewer Outfall - (or "major outfall") Municipal separate storm sewer outfall that discharges from a circular pipe with a diameter of more than 36 inches or its equivalent. Equivalency is based on a drainage area of 50 or more acres associated with a discharge from other than a circular pipe or the trapezoidal, rectangular, and triangular equivalent size open channels. For municipal separate storm sewers that receive storm water from lands zoned for industrial activity (based on comprehensive zoning plans or the equivalent), an outfall that discharges from a pipe with a diameter of greater than 12 inches or its equivalent is a major outfall. Equivalency may be based on drainage area of 2 or more acres or trapezoidal, rectangular, and triangular equivalent size open channel.

Manager of Water Resources - The person who is charged by the City with certain duties and responsibilities by this ordinance, or a duly authorized representative.

Municipal Separate Storm Sewer - Conveyance or system of conveyances (including public conveyances and public roads with drainage systems) that is owned or operated by a city, town, borough, county, parish, district, association, or other public body created by or pursuant to State law and having jurisdiction over disposal of sewage, industrial wastes, or other wastes, or a designated and approved management agency under Section 208 of the Clean Water Act (CWA) that discharges to waters of the United States and that is designed solely for collecting or conveying storm water that is not part of a publicly owned treatment works (POTW) as defined by 40 CFR 122.2.

National Pollutant Discharge Elimination System (NPDES) - The national program for controlling discharges from point source discharges directly into waters of the U.S. under the Clean Water Act.

National Urban Runoff Program (NURP) - A research and development/pilot program conducted between 1978 and 1983 by approximately 28 communities that characterized the composition of urban runoff and potential solutions and control techniques.

Outfall - A "point source" as defined by 40 CFR 122.2 as the point where a municipal separate storm sewer discharges to waters of the United States and does not include any open conveyances connecting two municipal separate storm sewers, or

pipes, tunnels, or other conveyances which are in the middle of a stream or other waters of the United States and are used to convey waters of the United States.

Operator - The operator of any facility or activity subject to regulation under the National Pollutant Discharge Elimination System (NPDES) program.

Person - Any individual, partnership, copartnership, firm, company, corporation, association, joint stock company, trust, estate, governmental entity, or any other legal entity; or their legal representatives, agents, or assigns. This definition includes all Federal, State, and local governmental entities.

Point Source - Any discernible, confined and discrete conveyance, including but not limited to any pipe, ditch, channel, tunnel, conduit, well, discrete fissure, container, rolling stock, concentrated animal feeding operation, landfill leachate collection system, vessel or other floating craft from which pollutants are or may be discharged. This term does not include return flows from irrigated agricultural storm water runoff.

Pollutant - Dredged spoil, solid waste, incinerator residue, sewage, garbage, sewage sludge, munitions, chemical wastes, biological materials, radioactive materials, heat, wrecked or discarded equipment, rock, sand, cellar dirt and industrial, municipal, and agricultural waste discharged into water.

Process Wastewater - Any water which, during manufacturing or processing, comes into direct contact with or results from the production or use of any raw material, intermediate product, finished product, byproduct, or waste product.

Runoff Coefficient - The fraction of total rainfall that will appear at a conveyance as runoff.

Significant Materials - Includes, but is not limited to: raw materials, fuels; materials such as solvents, detergents, and plastic pellets; finished materials such as metallic products; raw materials used in food processing or production; hazardous substances designated under section 101[14] of CERCLA; any chemical the facility is required to report pursuant to section 313 of title III of SARA; fertilizers; pesticides; and waste products such as ashes, slag and sludge that have the potential to be released with storm water discharges.

Standard Industrial Classification (SIC) - A method used by the Office of Management and Budget to classify industries according to type and method of production. Each industry is assigned a 4-digit code. The major industrial categories are indicated by the first two digits.

Storm Water - Storm water runoff, snow melt runoff, and surface runoff and drainage.

Storm Water Discharge Associated with Industrial Activity - The discharge from any conveyance which is used for collecting and conveying storm water and which is directly related to manufacturing, processing or raw materials storage areas at an industrial plant. The term includes, but is not limited to, storm water discharges from industrial plant yards; immediate access roads and rail lines used or traveled by carriers of raw materials, manufactured products, waste material, or by-products used or created by the facility; material handling sites; refuse sites; sites used for the application or disposal of process waste by the facility; material handling sites; refuse sites; sites used for the application or disposal of process waste waters (as defined at 40 CFR 401); sites used for the storage and maintenance of material handling equipment; sites used for residual treatment, storage, or disposal; shipping and receiving areas; manufacturing buildings; storage areas (including tank farms) for raw materials, and intermediate and finished products; and areas where industrial activity has taken place in the past and significant materials remain and are exposed to storm water. For the purposes of this paragraph, material handling activities include the: storage, loading and unloading, transportation, or conveyance of any raw material, intermediate product, finished product, by-product or waste product. The term excludes areas located on plant lands separate from the plant's industrial activities, such as office buildings and accompanying parking lots as long as the drainage from the excluded areas is not mixed with storm water drained from the above described areas. Industrial facilities (including industrial facilities that are Federally, State, or municipally owned or operated) that meet the description of the facilities listed in this paragraph (i)-(xi) include those facilities designated under the provisions of 122.26(a)(1)(v).

User - Any person who drains any storm water or other discharges into any drainage ditch or basin which ultimately, by natural flow or otherwise, enter into the storm water system; a source of discharge to the municipal separate storm sewer system.

Waters of the United States or water of the U.S. -

(a) All waters which are currently used, were used in the past, or may be susceptible to use in interstate or foreign commerce, including all waters which are subject to the ebb and flow of the tide;

(b) All interstate waters, including interstate "wetlands";

(c) All other waters such as intrastate lakes, rivers, streams (including intermittent streams), mudflats, sandflats, "wetlands", sloughs, prairie potholes, wet meadows, playa lakes, or natural ponds, the use, degradation, or destruction of which would affect interstate or foreign commerce, including any such waters:

- (1) Which are or could be used by interstate or foreign travelers for recreational or other purposes;
- (2) From which fish or shellfish are or could be taken and sold in interstate or foreign commerce; or
- (3) Which are used or could be used for industrial purposes by industries in interstate commerce;

(d) All impoundments of waters otherwise defined as waters of the United States under this definition;

(e) Tributaries of waters identified in paragraphs (a) through (f) of this definition;

(f) The territorial sea; and

(g) "Wetlands" adjacent to waters (other than waters that are themselves wetlands) identified in paragraphs (a) through (f) of this definition.

Waste treatment systems, including treatment ponds or lagoons designed to meet the requirements of the Clean Water Act (other than cooling ponds as defined in 40 CFR 423.11(m) which also meet the criteria of this definition) are not waters of the United States.

942.2 GENERAL MUNICIPAL SEPARATE STORM WATER SYSTEM USE REQUIREMENTS

2.1 Standards for Admission of Waste into Storm Sewer

A. Residential, commercial or industrial property may be connected to the storm sewer system or may continue the discharge of waste to the storm sewer system providing the waste to be discharged thereto conforms to the following:

(1) All discharge of waste to storm sewers shall be in compliance with the laws or regulations of the Commonwealth of Pennsylvania or the Federal government or any agency thereof having jurisdiction over streams, rivers, waterways or water resources.

(2) No waste other than:

1. potable water
2. potable water line flushing
3. natural uncontaminated surface or ground water
4. runoff from lawn watering provided such runoff is not polluted with pesticides or herbicides or other lawn maintenance materials
5. runoff from residential car washing
6. swimming pool drainage free of residual chlorine
7. unadulterated rain, roof or surface drainage water
8. runoff from fire fighting activities
9. air conditioning condensate
10. uncontaminated non-contact cooling water shall be discharged into a storm sewer and the City may regulate the rate of discharge of such waste into a storm sewer.

B. No person shall drain any water except storm water or authorized discharges into any drainage ditch or basin which will ultimately, by natural flow or otherwise, enter into the storm sewer system, or into a stream, river or watercourse. No user shall introduce or cause to be introduced into the municipal separate storm sewer any illicit discharge, spills or materials other than stormwater or authorized discharges. No person shall drain any water, except storm water or authorized discharges, into any gutter, street or pavement. These general prohibitions apply to all users of the municipal separate storm sewer.

C. All present connections to the storm sewer system that are in violation of any provision of this Article, and that the owner has knowledge of, shall be abated within 180 days of the passage of this ordinance and application to connect to the storm sewer system under the provisions of this Article shall be submitted to the Manager of Water Resources, 112 Union Street, Allentown, PA 18102

D. Upon discovery by the City of a connection to the storm sewer that is in violation of this article, notice shall be sent to the owner of such connection and the owner shall reconnect as directed.

2.2 City's Right of Revision

The City reserves the right to establish, by ordinance, more stringent standards or requirements on discharges to the municipal separate storm sewer.

2.3 Responsibilities of Users and Developers

Any user of the municipal separate storm sewer or any person who undertakes or is responsible for an undertaking which involves earth disturbance is ultimately responsible to see that the water quality, erosion, sedimentation or changed water flow characteristics resulting therefrom are controlled to the extent necessary to avoid damage to property and pollution of receiving waters. Nothing in this ordinance shall be taken or construed as lessening or modifying the ultimate responsibility of such persons. The requirements of this ordinance shall not imply the assumption of any liability therefor on the part of the City. The standards, criteria and requirements of the ordinance are to be seen as minimum standards which are not necessarily adequate to meet the highly variable conditions which must be covered by effective control measures. Compliance with the requirements of this ordinance and the Land Development and Subdivision Ordinance, the Land Development Controls Ordinance, the Flood Control Ordinance and the Storm Water Management Ordinance may not, therefore, of itself discharge such person's responsibility to provide effective control measures.

2.4 Best Management Practices

During the development of any property within the City, a subdivider or person responsible or in control of said development must use best management practices for the control of the quality of storm water drainage originating from the subject property. Additionally, best management practices in combination with any necessary long-term water quality facilities are required to ensure continuing compliance with the provisions of the Land Development and Subdivision Ordinance, the Land Development Controls Ordinance, the Flood Control Ordinance and the Storm Water Management Ordinance.

2.5 Violation of the City's NPDES Permit

A. It shall be unlawful for any person to cause or contribute to any deleterious effect on any receiving stream, or to contribute to a violation of the City's NPDES storm water discharge permit.

B. A substantial contribution to a violation of the City's NPDES storm water discharge permit may be found when the nature of a user's discharge, either individually or cumulatively with the discharges of other users, causes the discharge at one of the City's discrete outfalls to require remediation under the terms of the NPDES permit.

C. Notwithstanding any provision of this article to the contrary, if the City is required by the EPA, DEP or other regulatory agency to prepare and submit any type of remediation plan to ensure the City's compliance with Federal and State laws, regulations or permits, any user who causes or substantially contributes to the situation requiring remediation shall provide such financial and technical assistance required by the City to develop the required plan in a proportion appropriate to the impact of that user's discharge upon the situation requiring remediation.

2.6 Notice of Violation

Whenever the City finds that any user has violated, or is violating this ordinance, or has caused or substantially contributed to or is causing or substantially contributing to a violation by the City of Allentown of the terms of its National Pollutant Discharge Elimination System (NPDES) permit conditions or of any other Federal or State laws to which the municipal separate storm sewer is subject, the Manager of Water Resources or his designated agent, may serve upon such person written notice stating the nature of the violation. The Manager of Water Resources or his designated agent, may require any such person to comply with the analysis, monitoring, treatment or reporting requirements of sections 3, 4 and 5 of this ordinance as he deems necessary to bring about compliance. Within thirty (30) days of the date of the notice, a plan for the satisfactory correction of all violations shall be submitted to the Manager of Water Resources by such person. Submission of this plan in no way relieves the user of liability for violations occurring before or after receipt of the Notice of Violation. Nothing in this section shall limit the authority of the Manager of Water Resources to take any action, including emergency actions or any other enforcement action, without first issuing a Notice of Violation.

2.7 Imminent or Substantial Endangerment of Persons or the Environment

When, in the opinion of the Manager of Water Resources or his designated agent, it is necessary to stop discharge originating from a property to the municipal separate storm sewer which represents an actual or threatened reduction of the quality of storm water drainage which presents or may present an imminent or substantial endangerment to the health, safety or welfare of persons or the environment, he may suspend the provision of storm water drainage utility services to any such property and/or order the owner of such property to take immediate action to stop or eliminate the offending discharge or discharges.

In the event of a failure of the responsible user to take immediate, voluntary action to comply with the order, the Manager of Water Resources shall take such steps as deemed necessary, including but not limited to, the immediate

When the Manager of Water Resources finds that a user has violated, or continues to violate, any provision of this ordinance, or order issued hereunder, the Manager of Water Resources may petition the Lehigh County Court of Common Pleas for the issuance of a temporary or permanent injunction, as appropriate, which restrains or compels the specific performance of the order, or other requirement imposed by this ordinance on activities of the user. The Manager of Water Resources may also seek such other action as is appropriate for legal and/or equitable relief, including a requirement for the user to conduct environmental remediation. A petition for injunctive relief shall not be a bar against, or a prerequisite for, taking any other action against a violator.

9.2 Criminal Prosecution

A. A person who willfully or negligently violates any provision of this ordinance, or order issued hereunder, upon conviction, be guilty of a summary offense, punishable by a fine of not more than \$1,000.00 per violation, for each day the violation exists, or imprisonment for not more than ninety (90) days, or both.

B. A person who willfully or negligently introduces any substance into the municipal separate storm sewer which causes personal injury or property damage shall, upon conviction, be guilty of a summary offense and be subject to a penalty of not more than \$1,000.00, or be subject to imprisonment for not more than ninety (90) days, or both. This penalty shall be in addition to any other cause of action for personal injury or property damage available under State law.

C. A person who knowingly makes any false statements, representations, or certifications in any application, record, report, plan, or other documentation filed, or required to be maintained, pursuant to this ordinance, or order issued hereunder, or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required under this ordinance shall, upon conviction, be punished by a fine of not more than \$1,000.00 per violation, for each day the violation exists, or imprisonment for not more than ninety (90) days, or both.

9.3 Remedies Nonexclusive

The remedies provided for in this ordinance are not exclusive. The Manager of Water Resources may take any, all, or any combination of these actions against a noncompliant user. Further, the Manager of Water Resources is empowered to take more than one enforcement action against any noncompliant user.

942.10 - HEARING BOARD

A. A Storm Sewer Hearing Board shall be appointed by the Mayor with the advice and consent of Council, for resolution of differences between the Manager of Water Resources and owners of any improved property on matters concerning interpretation and execution of the provisions of this Article by the Manager of Water Resources. The intent of this Board is to create a single Hearing Board for all appeals related to the Storm Water Program, including those appeals from neighboring or contributing municipalities.

B. One (1) member of the Board shall be a member of the Public Works Department; one (1) member shall be a professional civil engineer; one (1) member shall be a representative of industry or manufacturing enterprise; one (1) member shall be a lawyer; and one (1) member shall be selected at large for his interest in accomplishing the objectives of this Article.

C. The initial appointments to the Board shall be for the following terms:

Public Works Department Representative -	(5) five years
Professional Engineer -	(4) four years
Industrial Representative -	(3) three years
Legal Representative -	(2) two years
Representative at Large -	(1) one year

All succeeding terms shall be for a period of five (5) years. The Mayor, with the consent of Council, shall appoint representatives to fill vacancies on the Board to complete unexpired terms. Interim appointments may be permitted to serve an additional full term on the Board.

D. The Hearing Board shall have the following powers:

- (1) To hear appeals from any person aggrieved by the application of this Article.
- (2) To make rules with regard to conducting its hearings, such rules to be submitted to Council for their advice and consent.
- (3) To make such findings of fact as may be required by the application of this Article.

(4) To decide questions presented.

Aggrieved parties seeking judicial review of the decision of the Storm Sewer Hearing Board must file an appeal pursuant to state law.

942. 11 - MISCELLANEOUS PROVISIONS

11.1 Charges and Fees

The City may adopt reasonable fees for reimbursement of costs of setting up and operating the City's Stormwater Management Program which may include:

A. Fees for monitoring, inspection, and surveillance procedures including the cost of collection and analyzing a user's discharge, and reviewing monitoring reports submitted by users;

B. Fees for reviewing and responding to accidental discharge procedures and construction;

C. Other fees as the City may deem necessary to carry out the requirements contained herein. These fees relate solely to the matters covered by this ordinance and are separate from all other fees, fines, and penalties chargeable by the City.

D. Such fees will be listed in the Administrative Information Manual (AIM).

11.2 Severability

If any provision of this ordinance is invalidated by any court of competent jurisdiction, the remaining provisions shall not be effected and shall continue in full force and effect.

942.12 - EFFECTIVE DATE

This ordinance shall be in full force and effect following its passage and approval, as provided by law. (13812 §1 2/3/2000)

ARTICLE 945 SEWER RATES

- 945.01 Imposition of charge
- 945.02 Use of funds
- 945.03 Charge for sewer service
- 945.04 Penalty charge
- 945.05 Special charges
- 945.06 Administration
- 945.07 Rebates
- 945.08 Sewer Service Charge Reviewed by Council

CROSS REFERENCES

Power to Impose and Collect Rentals - See 3rd Class §3211 et seq. (53 P.S. §38211 et seq.)

945.01 IMPOSITION OF CHARGE

On and after April 1, 1970, a sewer service rental is hereby imposed upon the owners of all properties within the City which are drained directly by the sanitary sewage system or from which sewage is transported to and treated at the sewage treatment works of the City. (11800 §1 3/24/70)

945.02 USE OF FUNDS

The funds received from the collection of sewer service rentals shall be collected and deposited by the City Treasurer in the General Sewer Fund of the City, and shall be used for the purpose of defraying the expenses of the City in the operation, maintenance, repairing, alteration, design and inspection, depreciation, amortization of indebtedness and interest thereon, arising out of or connected with the sanitary sewerage and sanitary sewage disposal system of the City, in accordance with the provisions of the Act of 1935, P.L. 1286, its amendments and supplements. (11800 §2 3/24/70)

945.03 CHARGES FOR SEWER SERVICE

A. All flow discharged into the sanitary sewer system shall be subject to the following two charges:

1. Minimum charge

Daily Charges

Meter Size	Quarterly Bills	Monthly Bills
5/8"	0.096118	0.199453
3/4"	0.117767	0.221055
1"	0.160990	0.264329
1-1/2"	0.269122	0.372490
2"	0.398871	0.502189
3"	0.744905	0.850669
4"	1.136619	1.239922
6"	2.220347	2.323694
8"	3.520369	4.262838

2. Quantity charges shall be assessed at the rate of \$2.237638 per 1,000 gallons discharged.

Thus, the total charge will be the sum of the minimum charge plus the sum of the quantity charge.

B. These charges assume that the actual discharge is Eighty-five (85%) of the metered water consumption. If the Director of Finance shall find that a particular user's discharge is more than Ninety (90%) percent or less than Eighty (80%) percent of the metered water consumption, he/she may establish a special rate for that user, which rate shall be proportional to \$2.237638 per thousand gallons of metered water with Eighty-five (85%) percent discharged to the sanitary sewer system, and the applicable minimum charge, or may require such user to install a discharge meter.

C. Where the user discharges water obtained from sources other than the City's metered water supply, the Director of Finance may require such user to install a discharge meter.

D. Additional charges may be levied based upon the composition of discharge pursuant to Article 941 or other City Ordinance(s).

E. The penalty assessed on delinquent accounts will be changed to 1-1/2% per month from the current penalty structure.

(13366 §1 12/28/95; 13430 §1 12/12/96; 13725 §1 2/15/98; 13958 §1 12/15/01; 14037 §1 12/10/02; 14137 §1 12/12/03; 14249 §1 12/15/04; 14444 §1 12/8/06; 14548 §1 12/7/07; 14851 12/3/2010; 14939 §1 12/3/2011)

945.04 PENALTY CHARGE

A. The penalty assessed on the delinquent accounts will be 1-1/2% per month. (13096 §1 12/3/91; 13169 §1 12/17/92; 13255 §1 4/21/94)

B. In addition thereto, any costs or fees incurred in conjunction with the collection of any such delinquencies shall be the responsibility of, and paid by the owner(s) of the subject property. (12129 §4 4/7/75; 12869 §2 9/21/88; 13255 §1 4/21/94)

945.05 SPECIAL CHARGES

In the event that the volume of water furnished to a property does not substantially reflect the volume of sewerage drained by that property into the sanitary sewer system, the Business Administrator is empowered to determine the actual sewerage flow of the property and to fix and collect a sewerage service rental from the owner(s) of the property which shall substantially reflect that amount of sewerage actually being drained by the property into the sanitary sewer system. (12129 §6 4/7/75)

945.06 ADMINISTRATION

The Director of Administration and Finance is hereby charged with the administration and enforcement of the provisions of this Article. He is empowered to prescribe, adopt, promulgate and enforce rules and regulations relating to any matter pertaining to the administration and enforcement of this Article, subject to the provisions of Section 121.05 of the Administrative Code, including provisions for the re-examination, correction and adjustment of bills and of payments alleged or

found to be incorrect, or as to which an overpayment is claimed or found to have occurred, reasonable extensions of time upon proper cause shown, and to prescribe forms necessary for the administration of this Article. (12129 §5 4/7/75)

945.07 REBATES

A. All bona fide residents of the City who are sixty-five (65) years of age or over or permanently disabled persons shall be entitled to rebates from the minimum sewer rental charge paid for their homesteads, in accordance with the schedule hereinafter set forth. Only one rebate shall be paid for each homestead; and in the case of co-ownership, a single rebate shall be paid to the co-owners jointly so long as any one of them is sixty-five (65) years of age or over or permanently disabled persons, provided that all co-owners are otherwise eligible for the rebate. (12317 §2 9/20/78)

B. Definitions for the purpose of determining rebates are as follows:

1. **Income** means all income from whatever source derived, including but not limited to salaries, wages, bonuses, commissions, income from self-employment, alimony, support money, cash, public assistance and relief, the gross amount of any pensions or annuities including railroad retirement benefits, all benefits received under the Federal Social Security Act (except Medicare benefits but including supplemental Social Security payments), all benefits received under State unemployment insurance laws and veteran's disability payments, all interest received from the Federal or any State government, or any instrumentality or political subdivision thereof, realized capital gains, rentals, workmen's compensation and the gross amount of loss of time insurance benefits, life insurance benefits and proceeds (except the first Five Thousand (\$5,000) Dollars of the total death benefit payments), and gifts of cash or property (other than transfers by gift between members of a household) in excess of a total value of Three Hundred (\$300.00) Dollars but shall not include surplus food or other relief in kind supplied by a governmental agency or those rebates offered by state and local government for services supplied.

2. **Household income** means the aggregate of all income received by the homestead owner (or owners, in case of co-ownership) and his or her spouse if a resident of the same household during a calendar year in which minimum sewer rental charges are due and payable.

3. **Homestead** means a dwelling, and so much of the land surrounding it as is reasonably necessary for use of the dwelling as a home, which is owned and occupied by a claimant. A "homestead" also includes premises occupied by reason of ownership or lease in a cooperative housing corporation, mobile homes which are assessed as realty for local property tax purposes and the land, if owned or rented by the claimant, upon which the mobile home is situated. An "owner" includes a person in possession under a contract of sale, deed of trust, life estate, joint tenancy or tenancy in common.

4. **Minimum sewer rental charge** means the minimum charge, per month, as defined in Section 945.04.

5. **Permanently disabled persons** means persons who are unable to engage in any substantial, gainful activity by reason of any medically determinable physical or mental impairment which can be expected to continue indefinitely. (12317 §2 9/20/78)

C. The amount of rebates for the minimum sewer rental charge paid during calendar year 1980 and thereafter shall be determined in accordance with the following schedule:

<u>Household Income</u>	<u>Percentage of Minimum Sewer Rental Charge to be Rebated</u>
\$ 0 to 5,999	100%
6,000 to 6,499	40%
6,500 to 6,999	30%
7,000 to 7,499	20%
7,500 to 7,999	10%
8,000 or over	No Rebate

(12433 §2 10/1/80)

D. A claim for rebate shall be filed with the Bureau of Finance of the City between May 1 and June 30 of each year. The rebate shall apply to the minimum charges for the fiscal year, January 1 to December 31 immediately preceding the claim filing period. Such claims shall be submitted on forms provided by the City. The Bureau of Finance may require such additional evidence as it deems necessary or appropriate in processing the claim and reserves the right to deny any claim that does not meet the requirements for rebate. The rebate shall be limited to the minimum service charges paid for the applicable calendar year. The Bureau of Finance shall review each claim and shall verify and confirm the amount of the rebate to the extent that the claim is valid and proper. (12317 §2 9/20/78)

E. Any information gained by the Director of Administration and Finance or any other official, agent or employee of the City, as a result of any claims, investigations or hearings required or authorized by this Article, shall be confidential and shall not be disclosed to any person except for official use in connection with the administration or enforcement of this Article or as otherwise provided by law. (12317 §2 9/20/78)

F. Any person who willfully makes any false or untrue statement on any claim for rebate under this Article shall upon conviction before any District Justice of the County of Lehigh, be fined not more than Three Hundred (\$300.00) Dollars for each offense and, in default of payment of fine or costs, shall be imprisoned for not more than ninety (90) days for each offense. (12317 §2 9/20/78)

945.08 SEWER SERVICE CHARGE REVIEWED BY COUNCIL

The sewer service charge provided by this Article and the surcharge provided by Article 941 shall be reviewed by the City at least every two (2) years and revised periodically as necessary by City Council to meet actual operational and maintenance expenses. Furthermore, records shall be maintained by the Business Administrator, such as are necessary to document compliance of this system of charges with Federal regulations. (12346 §2 3/21/79)

947 SEWER TAPPING FEES (14522 §1 8/16/07)

- 947.01 Definitions**
- 947.02 Tapping Fee Required**
- 947.03 Fees**
- 947.04 Improved Properties and Exceptions**
- 947.05 Fees Due**
- 947.06 Fees to be Paid Prior to Service**
- 947.07 Review of Fees**

Sewer Tapping fees were established by Ordinance 14522, passed and signed by the Mayor on August 16, 2007.

947.01 Definitions

- A. Cost of Existing Facilities - The historical cost of existing sewer system facilities trended forward to current costs using published cost indices, as set forth in the Engineering News Record, where such historical cost is available. In those cases where historical costs is not available, said cost shall be determined by a present construction cost estimate as prepared by the City's Engineer. In calculating the cost of existing facilities as set forth herein, outstanding debt principal relating to the facilities shall be subtracted from the trended cost, provided, however, that no debt shall be subtracted which is attributable to facilities exclusively serving new customers. Any grant monies contributed to the City for construction of existing facilities by any government or agency shall also be subtracted from the cost.
- B. Design Capacity - The total capacity of the Sewer System of the City, measured in gallons per day, which is established at 40,000,000 gallons per day.
- C. Developer - Any person who is an Owner or who is authorized by the Owner of real property who intends to improve said real property by the construction or addition of a structure or facility which will require the Public Sewer System of the City, disposal of sanitary sewage and other wastewater (other than storm water).
- D. Dwelling Unit - Any room, group of rooms, house, apartment unit, trailer or other single enclosure or part thereof, occupied or intended for human occupancy as separate living quarters by a family or other group of individuals living together or by individuals living alone.
- E. Engineering News Record (ENR) - Construction Cost Index - The published index used to measure the change in costs over a specified period of time as found in the Engineering News Record magazine.
- F. Equivalent Dwelling Unit (EDU) - The daily average amount of sewer estimated by the City to be drawn from the Sewer System of the City by a Dwelling Unit on a daily basis. For purposes of this Ordinance, an EDU shall be equivalent of one hundred seventy-five point five (175.5) gallons of sewer use per day.
- G. Improved Property - Any real property upon which there is erected, or upon which there will be erected, a structure intended for continuous or periodic habitation, storage, occupancy or use by human beings or animals and for which structure potable sewer shall be or may be drawn from the sewer system of the City.

H. Non-Residential Establishment - Any property used for commercial, industrial or institutional purposes including but not limited to the conduct of trade, commerce sale, distribution of goods and/or services, manufacturing, processing, cleaning, laundering or assembling any product or commodity, schools, churches, hospitals and libraries.

I. Owner - Any person vested with ownership, legal or equitable, sole or partial, of any real property.

J. That estimate, as approved by the City as hereinafter provided, of the number of gallons of sewage to be discharged to the Sewer System of the City on a daily basis of each improved property proposed to be connected to said Sewer System of the City.

K. Sewer System - All facilities, used for collecting, conveying, and treating sanitary sewage and other wastewater (other than storm water) owned and operated by the City of Allentown.

L. Tapping Fee - A fee charged by the City for capacity related facilities only of the Sewer System, including but not limited to: treatment, conveyance, collection and/or other general system facilities. Said fee shall not include charges for collection related facilities, which include sewers less than sixteen (18") inches in size.

Tapping Fee Required

No Developer or Owner of real property, nor any person or entity, shall connect real property with or use in any manner any part of the Sewer System of the City, without first making application in writing for and securing a

Tapping Fee Permit from this City. Such application shall be made on a Tapping Fee Permit form to be provided by the City, and shall be accompanied by the Tapping Fees as set forth in this Ordinance.

947.03 Fees

A. The Tapping Fee to be charge to the Developer or Owner of Dwelling Units shall be determined by taking the number of Dwelling Units, as determined by the provisions of this Ordinance and multiplying that number by one hundred seventy-five point five (175.5) gallons to arrive at the projected daily discharge of sewage to the Sewer System of the City. This projected daily sewage discharge shall then be multiplied by an amount not to exceed three dollars and eighty-seven cents (\$3.87) per gallon to arrive at the total tapping fee, which for one dwelling unit will be \$680. See Appendix AA attached for calculation of the cost per gallon.

B. The Tapping Fee to be charged to an Owner or Developer of a Non-Residential Establishment shall be determined by taking the number of Equivalent Dwelling Units as determined by the provisions of Sections 5C through 5P of this Ordinance and multiplying that number by one hundred seventy-five point five (175.5) gallons to arrive at the projected daily discharge of sewage to the Sewer System. This projected daily sewage discharge shall then be multiplied by an amount not to exceed three dollars and eighty-seven cents (\$3.87) per gallon to arrive at the total tapping fee.

C. The Tapping Fee to be charged to the Owner or Developer of a property which is connected to the Sewer System whenever the use of the property is to be changed or intensified to the extent that increased discharge to the Sewer System will result shall be determined by the projected increase in daily sewage discharge determined by the provisions of Section 5 of this Ordinance multiplied by an amount not to exceed three dollars and eighty-seven cents (\$3.87) per gallon.

947.04 Improved Properties and Exceptions

The number of Equivalent Dwelling Units for any given Improved Property served or to be served by the City shall be determined as follows:

A. Residential. Improved properties upon which residential uses (other than apartments, hotels and motels) are maintained shall be charged with one (1) Equivalent Dwelling Unit for each Dwelling Unit. Additional Equivalent Dwelling Units shall be charged for any retail, service or business use which is attached to or part of a Dwelling Unit, in accordance with the other subsections of this Section 5.

However, no additional Equivalent Dwelling Units shall be charged for laundry facilities provided on an Improved Property solely for the use of residents.

Apartment buildings shall be charged with eight-tenth, (0.8) of an Equivalent Dwelling Unit for each apartment unit.

B. Hotel & Motels. Improved Properties upon which hotels or motels are maintained shall be charged with 0.2857 Equivalent Dwelling Units for each room. If self-service laundry facilities or dining or food service areas are also provided on the Improved Property, additional Equivalent Dwelling Units shall be charged as provided in subsections (C.) and (F.). No additional

Equivalent Dwelling Units shall be charged for institutional laundry facilities associated with hotels or motels and which provide services solely for hotel or motel guests.

C. Restaurants/Food Service. Improved Properties upon which restaurants and other food services uses are maintained shall be charged as follows:

- (1) Full-Service Restaurant. If the use is a full-service restaurant (one in which the utensils will be washed and reused, and patrons will eat on the premises), 0.0048 Equivalent Dwelling Units shall be charged for each square foot of gross floor area in the dining areas of the restaurant (not counting any cocktail lounge or bar areas). If cocktail lounge or bar areas are also present, additional Equivalent Dwelling Units shall be charged as provided in paragraph (4) below.
- (2) Single-Service Utensil Restaurants. If the use is a single-service utility restaurant (one in which the utensils will not be washed and re-used, but in which the majority of patrons will eat on the premises), 0.0067 Equivalent Dwelling Units shall be charge for each square foot of gross floor area in the dining areas of the restaurant.
- (3) Take-Out Restaurants and Food Catering Facilities. If the use is a take-out restaurant or other food service establishment in which the majority of patrons will not eat on the premises, or a food catering facility in which food is prepared for consumption at another location, 0.0086 Equivalent Dwelling Units shall be charged for each square foot of gross floor area occupied by the use (other than gross floor area in any incidental dining area).
- (4) Cocktail Lounges and Bar Areas. If the use includes a cocktail lounge and/or bar, 0.0071 Equivalent Dwelling Units shall be charged for each square foot of floor area in the cocktail lounge and bar areas, including the floor area behind the bar.

D. Beauty Shops/Barbershops. Improved Properties upon which beauty shops or barbershops are maintained (except as described in subsection (A)) shall be charged with 0.2285 Equivalent Dwelling Units for each operator's chair. Any change in the number of operator chairs on an Improved Property shall constitute a change in use or a modification of the use of the Improved Property.

E. Movie or Live-Performance Theatres. Improved Properties upon which movie or live-performance theatres are maintained shall be charged with 0.0005 Equivalent Dwelling Units for each square foot of gross floor area in the performance-viewing areas of the Improved Properties. If food service areas are also provided on the Improved Property, additional Equivalent Dwelling Units shall be charged as provided in subsection (C.).

F. Self-Service Laundries. Improved Properties upon which self-service laundries are maintained shall be charged with 0.0286 Equivalent Dwelling Units for each square foot of gross floor area in the areas open to the public.

G. Offices. Improved Properties upon which offices are maintained shall be charged with 0.0002 Equivalent Dwelling Units for each square foot of gross floor area devoted to office and accessory uses (including e.g., storage, filing, and supply areas, waiting areas, conference areas, meeting rooms, halls, elevators, washrooms, etc.).

H. Retail Stores. Improved Properties upon which retail sales uses are maintained shall be charged with 0.0002 Equivalent Dwelling Units for each square foot of gross floor area devoted to retail sales and accessory uses (including e.g., storage and supply areas, aisles, store shelves, elevators, washrooms, etc.)

I. Industrial. Improved Properties upon which industrial uses are maintained shall be charged as follows:

- (1) In General. 0.0003 Equivalent Dwelling Units for each square foot of gross floor area devoted to industrial uses (including e.g., manufacturing, processing, fabrication, assembly, repair, maintenance, garage, printing, binding, and freight terminal uses) and uses accessory thereto, other than uses described in paragraph (2); plus
- (2) Warehouse & Storage. 0.0002 Equivalent Dwelling Units for each square foot of gross floor area devoted to warehouse or storage uses (including aisles, etc.); plus
- (3) Industrial Waste. The City Engineer shall establish the number of Equivalent Dwelling Units for such use as follows: the Engineer shall estimate the number of gallons of sewer which will be consumed by such use on an average day period of a year for which the total flow is greatest, and divide such estimate by one hundred seventy-five point five (175.5) gallons, to yield the number of Equivalent Dwelling Units.

J. Schools.

- (1) Day Schools. Improved Properties upon which schools are maintained (other than boarding schools) shall be charged with 0.0229 Equivalent Dwelling Units per person if the school includes showers, and 0.0109 Equivalent Dwelling Units per person if the school does not include showers.
- (2) Boarding Schools. Improved Properties upon which boarding schools are maintained shall be charged with 0.0023 Equivalent Dwelling Units for each square foot of gross floor area in any residence hall (including bedrooms, washrooms, lounge areas, halls, etc.), plus 0.0229 Equivalent Dwelling Units per person for all other areas.
- (3) A Person. For purposes of this subsection (j), the number of persons in a school shall be equal to the maximum number of students who may attend the school at any one time as established by the Pennsylvania Department of Education, plus the number of administrators, faculty, staff, and other employees reasonably expected to be assigned to work at the school building in the event the number of students at the school is equal to the maximum permitted number of students.

K. Churches. Improved Properties upon which churches are maintained shall be charged with 0.0002 Equivalent Dwelling Units for each square foot of gross floor area in any worship-assembly area (including, but not limited to, nave and sanctuary areas, but not including any vestibule areas). In addition, if schools, classrooms, offices, or food service uses are located on church property, such additional uses shall be charged with Equivalent Dwelling Units as prescribed in the other subsection of this Section E.

L. Hospitals. Improved Properties upon which hospitals are maintained shall be charged with:

- (1) In-Patients. 0.8571 Equivalent Dwelling Units for each in-patient bed the hospital is authorized to maintain. (Any change in the number of authorized in-patient beds shall be deemed a change in use or modification of use of the Improved Property; plus
- (2) Out-Patients. 0.0002 Equivalent Dwelling Units for each square foot of gross floor area in the hospital, except for in-patient rooms (rooms with beds primarily occupied by in-patients) and rooms primarily devoted to the performance of medical procedures on persons who are in-patients at the hospital. In addition, if food service uses are located at the hospital, such uses shall be charged with Equivalent Dwelling Units as prescribed in subsection (c), and the area occupied by such uses shall not be included in the calculations made under the first sentence of this paragraph (2).

M. Institutions Other Than Hospitals. Improved Properties upon which institutions (other than hospitals) are maintained (e.g. nursing homes) shall be charged with 0.3596 Equivalent Dwelling Units for each bed the institution is authorized to maintain. (Any change in the number of authorized beds shall be deemed a change in use or modification of use of the Improved Property for purposes of calculating EDU=s.)

N. Swimming Pools & Bathhouses.

- (1) Except as provided in paragraph (2), Improved Properties upon which swimming pools or bathhouses are maintained shall be charged with 0.0007 Equivalent Dwelling Units for each square foot of gross area in the building areas and/or outdoor enclosed areas devoted to the pool or bathhouse uses. In addition, any food service uses shall be charged with additional Equivalent Dwelling Units as provided in subsection (C.).
- (2) Paragraph (1) shall not apply to pools or bathhouses which are associated with residential properties and which may only be used by residents or guests of residents who are not charged an admission fee.

O. Other Uses. Whenever any use is proposed or exists on Improved Property which is not fairly described in the preceding subsections of this Section 6, the number of Equivalent Dwelling Units with respect to such use shall be determined, whenever practicable, by reference to that use (or those uses) described in the preceding subsections of this Section 6 which is most similar to the use which is proposed or exists on the Improved Property, or shall be based on patterns of sewage discharge for similar existing customers. Whenever it is not practicable to calculate Equivalent Dwelling Units by reference to one or more of the preceding provisions of this Section 6, the City Engineer shall establish the number of Equivalent Dwelling Units for such use as follows: the Engineer shall estimate the number of gallons of sewage which will be discharged by such use on an average day and divide such estimate by one hundred seventy-five point five (175.5) gallons, to yield the number of Equivalent Dwelling Units.

P. **Multiple Uses.** Whenever any Improved Property shall have more than one use established thereon, the number of Equivalent Dwelling Units for such Improved Property shall be equal to the sum of the number of Equivalent Dwelling Units for each individual use (as provided in the preceding subsections of this Section E).

Q. **SPECIAL EXCEPTIONS TO USE OF PRESUMED EDU=S**

- (1) **In General.** The City recognizes that the presumptions set forth in Section 5 may not properly reflect discharge rates from a given Improved Property for sewer. Therefore, the procedures set forth in this Section shall apply to any request to establish a different number of EDU=s for any given Improved Property, applicable to sewage discharge by special exception.
- (2) **Request for Special Exception.** Either the City or a person with an interest in the Improved Property may request a special exception to the presumptions of Section E. The City shall make such a request by mailing (certified mail, return receipt requested to last known address) or hand-delivering a notice of the request to the Owner of the Improved Property or his authorized agent. Any other interested person shall make such a request by filing a written notice with the City, on forms prescribed by the City.
- (3) **Agreement of Owner and City.** If the owner of the Improved Property and the City shall agree that the number of EDU=s which should be assigned to any Improved Property for purposes of sewer, should be higher or lower than the number of Presumed EDU=s under Section 5, and shall agree on the appropriate number of EDU=s the number so agreed shall be the number of EDU=s assigned to the Improved Property at that time. Any agreement under this subsection (c) with respect to any particular situation giving rise to an obligation to make a payment to the City shall be made at or prior to the time that the payment is due to the City.

947.05 Fees Due

A. Except as hereinafter set forth, the Tapping Fee charged pursuant to this Ordinance for each Improved Property which is to be newly connected to the Sewer System shall be due and payable at the time application is made to connect to the sewer system.

B. In the case of a Tapping Fee charged due to a change or intensification in the use of a property connected to the Sewer System, the tapping Fee shall be due and payable:

- (1) at or before the time the Owner or his agent obtains a building permit, if a building permit is required in connection with the circumstances under which the Tapping Fee is imposed;
- (2) at or before the time the Owner or his agent obtains a zoning permit, if a building permit is not required but a zoning permit is required in connection with the circumstances under which the Tapping Fee is imposed;
- (3) at or before the time the Owner or his agent obtains a business privilege license, if neither a building permit nor zoning permit is required, but a new business privilege license is required in connection with the circumstances under which the Tapping Fee is imposed;
- (4) at or before the time the Owner or his agent completes his improvements, alterations, extensions, or modifications, or establishes his new use, or intensifies his existing use, if neither a building permit, a zoning permit, nor a business privilege license is required in connection with the circumstances under which the Tapping Fee is imposed.

Fee to Paid Prior to Service

It is expressly understood that all fees charged pursuant to this Resolution shall be based upon the duly adopted fee schedule at the time of payment. It is expressly understood that no capacity shall be guaranteed for an Owner until such time as the Tapping Fees enumerated herein have been paid or secured by financial security as may be approved by the City.

All Fees as authorized to be charged pursuant to this Ordinance shall be in addition to any charges assessed against the property in the construction of a sewer main or appurtenances by the City as well as any other user charges, industrial waste fees and charges and connection fees imposed by the City.

947.07 Review of Fees

That the City reserves its right to review the fees set forth in this Ordinance as well as the methods of calculation thereof from time to time as it deems necessary.

ARTICLE 949
INDUSTRIAL COST RECOVERY SYSTEM

- 949.01 Purpose and Scope
- 949.02 Effective Date
- 949.03 Definitions
- 949.04 Application
- 949.05 Industrial User Classification and Monitoring
- 949.06 Computation of Industrial Cost Recovery Payments
- 949.07 Industrial Cost Recovery Charge Formula
- 949.08 Administration
- 949.09 Industrial Cost Recovery Billing
- 949.10 Appeals
- 949.11 Reserved Capacity Agreements
- 949.12 Disposition of Industrial Cost Recovery Revenue
- 949.13 Partial Invalidity

949.01 PURPOSE AND SCOPE

This ICRS implements the requirements of Section 204 (b) (1) (B) of Public Law 92-500, 33 U.S.C. Section 1284 (b) (1) (B), the Amendments of 1977 as well as the regulations and guidelines issued pursuant thereto, in order to maintain eligibility for Federal grants which provide necessary funds for the construction of wastewater treatment works.

It is the intent of this ICRS to provide for payment by each industrial user, in addition to the already established system of rates and charges currently in effect, of such user's appropriate share of Federal construction grant funds which are allocable to the treatment of industrial wastes by the City. (12347 §1 3/21/79)

949.02 EFFECTIVE DATE

The provisions of this ICRS shall become effective on the first day that any City treatment works assisted with a Federal grant awarded after March 1, 1973 shall become operational. For the purposes of ICRS, treatment works become operational on the day that the City officially accepts the works from the contractor responsible for their construction. (12347 §1 3/21/79)

949.03 DEFINITIONS

In addition to the terms defined in Section 941.02 of the Codified Ordinances of the City of Allentown, the following definitions apply herein:

1. **Expansion** An increase in collection and/or treatment capacity.
2. **Infiltration** The water entering a sewer system from the ground, through such means as, but not limited to, defective pipes, pipe joints, connections, or manhole walls. Infiltration does not include, and is distinguished from, inflow.
3. **Inflow** The water discharged into a sewer system, including service connections from such sources as, but not limited to, roof leaders, cellar, yard, and area drains, foundation drains, cooling water discharges, drains from springs and swampy areas, manhole covers, cross connections from storm sewers and combined sewers, catchbasins, storm waters, surface runoff, street wash waters, or drainage. Inflow does not include, and is distinguished from infiltration.
4. **Industrial Cost Recovery (ICR)** Recovery by the City from the industrial users of the treatment works of the grant amount allocable to the treatment of wastes from such users pursuant to Section 204 (b) of Public Law 92-500 as amended and subsequent regulations.
5. **Industrial Cost Recovery Period** That period during which the Federal grant amount allocable to the treatment of wastes from industrial users shall be recovered from industrial users of the City sewer system, a period of thirty (30) years from the first day that each such grant-assisted treatment works shall become operational (or, the useful life of the treatment works in the event that such useful life is less than thirty (30) years).
6. **Industrial User** (This definition is contingent on EPA's eventual finalization of ICR regulations pursuant to the 1977 Amendments to PL 92-500. As of September 27, 1978, the definition is as follows:
 - a. Any nongovernmental nonresidential user of treatment works owned by the City which discharges more than the equivalent of 25,000 gallons per day (gpd) of sanitary wastes and which is identified in the Standard Industrial Classification

Manual, 1972, United States Office of Management and Budget, as amended and supplemented, under one of the following divisions:

- i. Division A: Agricultural Forestry and Fishing;
- ii. Division B: Mining;
- iii. Division D: Manufacturing;
- iv. Division E: Transportation, Communications, Electric, Gas, and Sanitary Services; and
- v. Division I: Services. (For the purposes of Industrial Cost Recovery this definition of industrial user applied regardless of how a user is classified for other purposes; e.g., commercial or public.)

b. Any nongovernmental user of treatment works owned by the City, which discharges wastewater to the treatment works which contains toxic pollutants or poisonous solids, liquids, or gases in sufficient quantity either singly or by interaction with other wastes, to contaminate the sludge of any municipal systems, or to injure or to interfere with any sewage treatment process, or which constitutes a hazard to humans or animals, creates a public nuisance, or creates any hazard in or has an adverse effect on the waters receiving any discharge from the treatment works.

7. **Sanitary Wastes** Wastes of substantially such origin and strength as those typically produced in households, including wastes from sanitary conveniences. Also called Domestic Wastes and sometimes Primarily Segregated Domestic Wastes.

8. **Process Wastewater** Liquid wastes from industrial processes, such as cooling water or water which has come in contact with an end-product or with materials incorporated in an end-product; distinct from domestic or sanitary wastes.

9. **Substantial Change** For the purposes of ICR, any change in strength, volume or delivery flow rate, which the Business Administrator considers to be substantial. Changes in characteristics which cause a ten (10%) percent change in the annual ICR charge may be presumed to be substantial.

10. **Upgrading** An increase in the degree of treatment. (12347 §1 3/21/79)

949.04 APPLICATION

- A. ICR applies to all process wastewater introduced by industrial users to the City sewerage system.
- B. To the extent that an industrial user introduces sanitary or domestic wastes to the City sewerage system, such user shall be excluded from the operation of this ICRS.
- C. Throughout the implementation and operation of this ICRS, the City must determine which users are classified as industrial users for the purposes of ICR. This determination shall be based on actual knowledge of the type of industry, the wastewater volumes and characteristics and reasonable presumption of no discharges identified in Section 949.03 (f) (2).
- D. For the purposes of determining which of the users discharge more than 25,000 gpd of equivalent sanitary wastes, the City shall exclude domestic wastes or discharges from sanitary conveniences. The exclusion shall be computed in the same manner as the exclusion incorporated in the ICR charge formula set forth in Section 949.07 of this Article.

After applying the sanitary waste exclusion, discharges in the above divisions listed in Section 949.03 (f) that have a volume exceeding 25,000 gpd or the weight of biochemical oxygen demand (BOD) or suspended solids (SS) equivalent to that weight found in 25,000 gpd of sanitary waste are considered industrial users. Sanitary wastes, for purposes of this calculation of equivalency, are the wastes discharged by "normal" users as defined in Section 949.05 (c).

E. For the purposes of this ICRS, the following users are defined as discharging primarily segregated domestic wastes and are excluded from the operation of this ICRS:

1. Veterinary services (SIC: 0741, 0742)
2. Coin-operated laundromats (SIC: 7215)
3. Beauty and/or barber shops (SIC: 723, 724)

- 4. Hospitals and other health care centers or clinics, and offices associated with health services (SIC: 80, excluding 8071, 8072.)
- 5. Museums, botanical and zoological gardens (SIC: 84).
- 6. Office buildings. (12347 §1 3/21/79)

949.05 INDUSTRIAL USER CLASSIFICATION AND MONITORING

A. All industrial users subject to the operation of this ICRS shall be classified as "Exceptional" or "Normal". An "Exceptional" user is one who discharges waste stronger than any of the following:

- 1. 300 milligrams per liter of five-day bio-chemical oxygen demand (BOD5)
- 2. 360 milligrams per liter of suspended solids (SS)
- 3. 85 milligrams per liter of total Kjeldahl nitrogen (TKN)

B. All industrial users who are classified as "Exceptional" also are subject to Section 941.04 (e) of the Codified Ordinances of the City of Allentown, which provides for a surcharge for pollutant concentrations in excess of these limits. The monitoring under this ICR system and the sampling for waste surcharge shall be the same. For reference only, the following provision, which is set forth in Section 941.04 (e), is repeated here:

"In order to ascertain the strength of every industrial waste requiring a surcharge, the City shall cause appropriate sampling and analyses to be made four (4) times each year. Said appropriate sampling shall consist of seven (7) twenty-four (24) hour composite samples taken every day for seven (7) consecutive days. Results of each analysis shall be used to establish the surcharge for the particular quarter during which the particular sample is taken and quarterly billings shall be made by the City."

The ICR charge shall be computed based on the concentrations found in this sampling program.

C. All other industrial users, may be monitored on a random basis, as the City deems appropriate or at the user's request. The wastewater characteristics for "normal" users shall be assumed to be 150 milligrams per liter of five-day biochemical oxygen demand, 150 milligrams per liter of suspended solids, and 30 milligrams per liter of total Kjeldahl nitrogen, unless the City determines, based on actual monitoring, the specific concentrations of pollutants for a particular "normal" user. (12347 §1 3/21/79)

949.06 COMPUTATION OF INDUSTRIAL COST RECOVERY PAYMENTS

A. During the ICR 30 year recovery period, each industrial user shall pay for its share of the total amount of Federal grant funds, including amendments to grants, which are allocable to capacity used or reserved for use in the treatment of its process wastewater. The payment for each industrial user shall be computed in accordance with the formula set forth in Section 949.07 of this Article. The average daily poundage of BOD5, suspended solids and total Kjeldahl nitrogen, to be used in said formula, will be based on either the concentrations of pollutants found during actual monitoring or the assumed concentrations for "normal" users. Section 949.05 of the Article sets forth user classification and monitoring.

B. For any industrial user which discharges into the City system of wastewater treatment works subject to this ICRS, the ICR charges for such user shall accrue from the date of the user's initial discharge into the City system or the effective date of this ICRS, whichever occurs later, and shall continue to accrue for the unexpired portion of the ICR period or until the user ceases to use the City system, whichever occurs first.

C. If there is a substantial change in the strength, volume, or delivery flow rate of wastewater introduced into the treatment works by an industrial user, such user's share shall be adjusted accordingly, when the City has made such a determination. If any industrial user knows or has reason to believe that a substantial change has occurred in its waste characteristics, it shall report such knowledge to the City department responsible for assessing ICR charges.

D. If there is an expansion or upgrading of the treatment works, each existing industrial user's share shall be adjusted accordingly.

E. An industrial user's share shall not include any portion of the grant money allocable to capacity not used or not reserved by such user.

F. An industrial user's share shall not include an interest component. (12347 §1 3/21/79)

949.07 INDUSTRIAL COST RECOVERY CHARGE FORMULA

A. Each industrial user's share of the applicable Federal grant amount, is based on that proportion of the design capacity represented by such user's discharge. The annual ICR charge shall be computed by the following formula. For charges applicable to periods of less than one (1) year, all references to "annual" or "year" shall be understood to mean the appropriate period of time.

$ICRC = K(Q-QD) \times cq + (BOD5-BOD5D) \times cBOD5 + (SS-SSD) \times css + (N-ND) \times cn$ where,

ICRC = Cost to be recovered from an industrial user per year.

K = 1.0 or less depending on conditions defined in subsection d.

Q = Gallons of wastewater flow contributed by the user during the year, if K = 1.0. Or, gallons of metered water consumption if K is less than 1.0.

QD = Gallons of wastewater flow that is certified as domestic waste contributed by the user during the year.

cq = The charge for Federal grant costs allocable to hydraulic capacity in dollars per thousand gallons.

BOD5 = The pounds of five-day biochemical oxygen demand contributed by a user during the year.

BOD5D = The pounds of five-day biochemical oxygen demand contributed by the domestic waste component of a user's waste stream during the year.

cBOD5 = The charge for Federal grant costs allocable to BOD5 removal in dollars per pound.

SS = The pounds of suspended solids contributed by a user during the year.

SSD = The pounds of suspended solids contributed by the domestic waste component of a user's waste stream during the year.

css = The charge for Federal grant costs allocable to suspended solids removal in dollars per pound.

N = The pounds of total Kjeldahl nitrogen contributed by a user during the year.

ND = The pounds of total Kjeldahl nitrogen contributed by the domestic waste component of a user's waste stream during the year.

cn = The charge for Federal grant costs allocable to nitrification in dollars per pound of total Kjeldahl nitrogen.

B. The applicable charges are:

cq = \$0.00805 per thousand gallons

cBOD5 = \$0.00407 per pound

css = \$0.00356 per pound

cn = \$0.03590 per pound

C. The average daily wastewater flow and pollutant poundage due to the domestic wastes shall be computed for each industrial user by multiplying the average number of 40-hour per week employees times 35 gallons per day per employee and assuming the following concentrations:

BOD: 150 mg/l

SS: 150 mg/l

TKN: 30 mg/l

D. If wastewater discharge is actually measured by means of a sewage meter or other device acceptable to the City, then K = 1.0 and Q is the measured wastewater flow. If wastewater is not directly measured, then K shall be 0.95 and Q is the metered water consumption, except that the City may agree with a particular industrial user that K will be some other percentage, based on reasonable estimation of water discharged to other systems than the City sewerage system. (12347 §1 3/21/79)

949.08 ADMINISTRATION

The Business Administrator is hereby charged with the administration and enforcement of the provisions of this Article. He is empowered to prescribe, adopt, promulgate and enforce rules and regulations relating to any matter pertaining to the administration and enforcement of this Article, subject to the provisions of Article 121.05 Rules, Regulations; Approval, Publication and Record, of the Codified Ordinances of the City of Allentown, and to prescribe forms necessary for the administration of this Article. (12347 §1 3/21/79)

949.09 INDUSTRIAL COST RECOVERY BILLING

A. The payment of ICR charges shall be deemed a condition of discharge to the City sanitary sewer system. Industrial Waste Discharge Permits issued by the City pursuant to Section 941.07 of the Codified Ordinances of the City of Allentown, are hereby subjected to ICR. The continuation of existing and the issuance of new permits shall require the agreement by each industrial user to pay his share of ICR, as set forth in this Article.

B. Except as provided in paragraph (d) below the first ICR bills shall be issued to industrial users no later than ten (10) months from the effective date of this ICRS. Thereafter, all industrial users shall be billed on their normal wastewater user charge billing dates, or otherwise, but at least annually, as determined by the Business Administrator.

C. Except as provided in paragraph (d) below failure to pay ICR bills within thirty (30) days of billing shall be subject to the same penalty procedures as apply to the sewer rate charges, as set forth in Section 945.05 of the Codified Ordinances of the City of Allentown. Furthermore, the City may employ those lien procedures as are available for the collection of municipal claims. In addition, the City may institute any action at law or equity or employ any other legal remedy available to it for the collection of the ICR charges.

D. Industrial users shall not be required to pay ICR charges incurred during the period after December 31, 1977 and before July 1, 1970, nor for any period during which a federal moratorium pertaining to the Industrial Cost Recovery System exists pursuant to Federal Law. ICR charges accrued during this period or periods shall be payable by the industrial users in a lump sum by June 30, 1980, or at such time as the federal moratorium is lifted, whichever shall last occur. (12347 §1 3/21/79)

949.10 APPEALS

A. An industrial user or other aggrieved party may appeal to the Hearing Officer, who may be an employee of the City, on the issues of (1) exclusion from operation of this ICRS by reason of contract and/or (2) on the issue of the amount of the ICR assessment with particular regard to flow, five-day bio-chemical oxygen demand, and the concentrations of suspended solids and total Kjeldahl nitrogen.

B. Any existing industrial user may apply within one (1) year of the effective date of this ICRS for exclusion from participation in the ICRS on the basis provided above. New industrial users (those who connect to the City service system after the effective date of this ICRS) shall have one (1) year from the date of their initial connection in which to apply for exclusion. An Application for Exclusion shall include a schematic diagram of the user's production process, waste pretreatment and conveyance systems, and a series of waste strength tests in conformance with City accepted procedures and guidelines which shall be available on request, all such diagrams shall be certified as accurate by an engineer licensed in this Commonwealth. All such test results shall be certified as having been performed in accordance with City accepted procedures and their accuracy shall be certified by a qualified chemist or laboratory located within the Commonwealth of Pennsylvania.

C. Within thirty (30) days after the mailing date of each industrial cost recovery bill, an industrial user who is included within this ICRS may file an Application for Exclusion or an Application for Redetermination of Assessment with the Hearing Officer, but only in the event of a substantial change in quality or quantity of effluent discharge by such user arising subsequent to the last redetermination. Such changes shall be certified by a qualified chemist or laboratory as having occurred and such a chemist or laboratory shall also certify that test indicating the substantial changes aforesaid were conducted in accordance with City accepted procedures.

D. All applications shall set forth the industrial user's name, address, and its City account number along with a brief statement of the reasons it is petitioning and the factual basis for the Application. Applications shall set forth the names of the officers, attorneys, employees, and witnesses who will be appearing before the Hearing Officer. Applications shall be filed with three (3) copies and sent by registered mail to the Hearing Officer at the place for which payment of charges is specified in the industrial cost recovery bill from which the appeal is taken.

E. The Hearing Officer shall notify the Applicant by mail of the time and place for hearing, such notice to be given within thirty (30) days after receipt of any application. The hearing shall be conducted on the Application not less than ten (10) days after mailing of such notice. The hearing shall be held as an informal consultation and conference at which time the Applicant, in person or by counsel, shall present his argument, evidence, data, and proof in connection with the issues submitted. A representative from the City may then present its factual basis for the exclusion or assessment under consideration. The Hearing Officer shall not be bound by the usual rules of evidence but may conduct the hearing in such a manner as in his

judgment will expeditiously and accurately determine the substantial rights of the industrial user and the City. All hearings may be stenographically or electronically recorded. The Hearing Officer shall make findings of fact and recommendations which shall be submitted to the Business Administrator for his decision, the results of which shall be made known to the Applicant.

F. Rehearings may be allowed by the City for good cause shown and the procedure for rehearings shall be substantially the same as delineated in paragraphs 10 (a) through to (e), above.

G. No hearing shall be held and no decision shall be rendered by the City with respect to exclusions sought on the basis of reserved capacity contract executed prior to March 1, 1973. Upon receipt of an Application for Exclusion from industrial cost recovery on this ground, the City shall forward the request and appropriate documentation to the Regional Administrator of the United States Environmental Protection Agency within thirty (30) days. The Regional Administrator will make his determination and the Petitioner will be notified by the City. (12347 §1 3/21/79)

949.11 RESERVED CAPACITY AGREEMENTS

A. Reserved capacity agreement between the City and an industrial user may be established whereby the user shall pay the full ICR payments allocable to the capacity reserved, and, in the event that such an industrial user exceeds its reserved capacity, its full use shall be subject to this ICRS, unless otherwise excluded.

B. If the treatment works are expanded in the future with PL 92-500 grant assistance, an industrial user who has executed a reserved capacity agreement and has made ICR payments based upon reserved capacity, will not incur additional ICR charges associated with the cost of expansion until the industrial user's actual use of the treatment works exceeds its reserved capacity.

C. Nevertheless, such industrial users shall be required to pay any additional ICR charges associated with the cost of upgrading a treatment works.

D. An industrial user may terminate or modify, with the consent of the City, any agreement for reserved capacity; thereafter its ICR payments shall cease or be modified, to the extent of the reserved capacity so terminated or modified. (12347 §1 3/21/79)

949.12 DISPOSITION OF INDUSTRIAL COST RECOVERY REVENUE

A. All funds recovered during the annual accounting period, with the exception of the discretionary portion, shall be deposited in interest-bearing accounts which are fully collateralized by obligations of the United States Government or by obligations fully guaranteed as to principal and interest by the United States Government or any agency thereof.

B. Within one (1) year of the effective date of this ICRS, and thereafter at least annually and within four (4) months after the close of the City fiscal year, the City shall transfer to the United States Treasury fifty (50%) percent of all ICR revenues collected during such fiscal year and any interest earned thereon. The City shall retain fifty (50%) percent of the amount recovered from industrial users, and shall use these funds as follows:

1. A portion of the amounts which the City retains may be used to pay the incremental costs of administration of the industrial cost recovery system. The incremental costs of administration are those costs remaining after deducting all costs reasonably attributable to the administration of the user charge system. The incremental costs shall be segregated from all other administrative costs of the City.

2. A minimum of eighty (80%) percent of the amounts the City retains after paying the incremental costs of administration, together with any interest earned shall be placed in an industrial cost recovery account entitled "Expansion and Upgrading Account." Funds in this Expansion and Upgrading Account shall be expended only for replacement or expansion of grant-assisted treatment works and shall not be spent without prior written approval of the Environmental Protection Agency's Regional Administrator.

3. The remainder of the amounts retained by the City are discretionary and shall be used in the Sewer Fund for such uses as the City shall deem proper, except it shall not be used for the construction of industrial pretreatment facilities or rebates to industrial users for costs incurred by such users in complying with Federal user charge or industrial cost recovery requirements. (12347 §1 3/21/79)

949.13 PARTIAL INVALIDITY

If any one or more sections, sentences or parts of this ICRS shall be adjudged invalid, such judgment shall not affect, impair or invalidate the remaining provisions thereof, but shall be confined in its operation to the specific provisions held invalid, and the inapplicability or invalidity of any section, clause, sentence or part of this ICRS in one or more instances or

circumstances shall not be taken to affect or prejudice in any way its applicability or validity in any other instance. (12347 §1 3/21/79)

SECTION 4.0

SEWAGE FACILITIES PLANNING MODULE COMPONENT 4

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**

SECTION 4.1

4A – MUNICIPAL PLANNING AGENCY REVIEW

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF POINT AND NON-POINT SOURCE MANAGEMENT

**INSTRUCTIONS FOR COMPLETING COMPONENT 4A
MUNICIPAL PLANNING AGENCY REVIEW**

Remove and recycle these instructions prior to mailing component to the approving agency (DEP or delegated local agency).

Background

This component, Component 4, is used to obtain the comments of planning agencies and/or health departments having jurisdiction over the project area. It is used in conjunction with other planning module components appropriate to the characteristics of the project proposed.

Who Should Complete the Component?

The component should be completed by any existing municipal planning agency, county planning agency, planning agency with areawide jurisdiction, and/or health department having jurisdiction over the project site. It is divided into sections to allow for convenient use by the appropriate agencies.

The project sponsor must forward copies of this component, along with supporting components and data, to the appropriate planning agency or agencies and health department(s) (if any) having jurisdiction over the development site. These agencies are responsible for responding to the questions in their respective sections of Component 4, as well as providing whatever additional comments they may wish to provide on the project plan. After the agencies have completed their review, the component will be returned to the applicant. The agencies have 60 days in which to provide comments to the applicant. If the agencies fail to comment within this 60 day period, the applicant may proceed to the next stage of the review without the comments. The use of registered mail or certified mail (return receipt requested) by the applicant when forwarding the module package to the agencies will document a date of receipt.

After receipt of the completed Component 4 from the planning agencies, or following expiration of the 60 day period without comments, the applicant must submit the entire component package to the municipality having jurisdiction over the project area for review and action. If approved by the municipality, the proposed plan, along with the municipal action, will be forwarded to the approving agency (DEP or delegated local agency). The approving agency, in turn, will either approve the proposed plan, return it as incomplete, or disapprove the plan, based upon the information provided.

Instructions for Completing Planning Agency and/or Health Department Review Component

Section A. Project Name

Enter the project name as it appears on the accompanying sewage facilities planning module component (Component 2, 2m, 3, 3s or 3m).

Section B. Review Schedule

Enter the date the package was received by the reviewing agency, and the date that the review was completed.

Section C. Agency Review

1. Answer the yes/no questions and provide any descriptive information necessary on the lines provided. Attach additional sheets, if necessary.
2. Complete the name, title, and signature block.

Section D. Additional Comments

The Agency may provide whatever additional comment it deems necessary, as described in the form. Attach additional sheets, if necessary.

SECTION C. AGENCY REVIEW (continued)

Yes	No	
<input checked="" type="checkbox"/>	<input type="checkbox"/>	13. Is this proposal consistent with the ordinance? If no, describe the inconsistencies _____
<input checked="" type="checkbox"/>	<input type="checkbox"/>	14. Is this plan consistent with the municipal Act 537 Official Sewage Facilities Plan? If no, describe the inconsistencies _____
<input type="checkbox"/>	<input checked="" type="checkbox"/>	15. Are there any wastewater disposal needs in the area adjacent to this proposal that should be considered by the municipality? If yes, describe _____
<input type="checkbox"/>	<input checked="" type="checkbox"/>	16. Has a waiver of the sewage facilities planning requirements been requested for the residual tract of this subdivision?
<input type="checkbox"/>	<input type="checkbox"/>	If yes, is the proposed waiver consistent with applicable ordinances?
17. Name, title and signature of planning agency staff member completing this section:		
Name: <u>Steven R. Neretta</u>		
Title: <u>Interim Director of Planning</u>		
Signature: <u>[Signature]</u>		
Date: <u>9/12/16</u>		
Name of Municipal Planning Agency: <u>Planning and Zoning</u>		
Address: <u>435 Hamilton St, Allentown, PA 18101</u>		
Telephone Number: <u>(610) 437-7613</u>		

SECTION D. ADDITIONAL COMMENTS (See Section D of instructions)

This Component does not limit municipal planning agencies from making additional comments concerning the relevancy of the proposed plan to other plans or ordinances. If additional comments are desired, attach additional sheets.

The planning agency must complete this Component within 60 days.

This component and any additional comments are to be returned to the project sponsor.

SECTION 4.2

4B – COUNTY PLANNING AGENCY REVIEW

**CITY OF ALLENTOWN
LEHIGH COUNTY, PENNSYLVANIA**



**SEWAGE FACILITIES PLANNING MODULE
 COMPONENT 4B - COUNTY PLANNING AGENCY REVIEW
 (or Planning Agency with Areawide Jurisdiction)**

Note to Project Sponsor: To expedite the review of your proposal, one copy of your completed planning package and one copy of this *Planning Agency Review Component* should be sent to the existing county planning agency or planning agency with areawide jurisdiction for their comments.

SECTION A. PROJECT NAME (See Section A of instructions)

Project Name

Tower Six

SECTION B. REVIEW SCHEDULE (See Section B of instructions)

1. Date plan received by county planning agency. ----
2. Date plan received by planning agency with areawide jurisdiction July 28, 2016
 Agency name Lehigh Valley Planning Commission
3. Date review completed by agency August 3, 2016

SECTION C. AGENCY REVIEW (See Section C of instructions)

- | Yes | No | |
|-------------------------------------|-------------------------------------|---|
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | 1. Is there a county or areawide comprehensive plan adopted under the Municipalities Planning Code (53 P.S. 10101 <i>et seq.</i>)? |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | 2. Is this proposal consistent with the comprehensive plan for land use? See attached Act 247 Review letter dated 7/5/16 |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | 3. Does this proposal meet the goals and objectives of the plan?
If no, describe goals and objectives that are not met ---- |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | 4. Is this proposal consistent with the use, development, and protection of water resources?
If no, describe inconsistency ---- |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | 5. Is this proposal consistent with the county or areawide comprehensive land use planning relative to Prime Agricultural Land Preservation?
If no, describe inconsistencies: ---- |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | 6. Does this project propose encroachments, obstructions, or dams that will affect wetlands?
If yes, describe impact ---- |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | 7. Will any known historical or archeological resources be impacted by this project?
If yes, describe impacts ----. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | 8. Will any known endangered or threatened species of plant or animal be impacted by the development project? |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | 9. Is there a county or areawide zoning ordinance? |
| <input type="checkbox"/> | <input type="checkbox"/> | 10. Does this proposal meet the zoning requirements of the ordinance? N/A
If no, describe inconsistencies ---- |

Yes	No	SECTION C. AGENCY REVIEW (continued)
<input type="checkbox"/>	<input type="checkbox"/>	11. Have all applicable zoning approvals been obtained? N/A
<input checked="" type="checkbox"/>	<input type="checkbox"/>	12. Is there a county or areawide subdivision and land development ordinance? Not applicable to City of Allentown
<input type="checkbox"/>	<input type="checkbox"/>	13. Does this proposal meet the requirements of the ordinance? N/A If no, describe which requirements are not met ----
<input checked="" type="checkbox"/>	<input type="checkbox"/>	14. Is this proposal consistent with the municipal Act 537 Official Sewage Facilities Plan? If no, describe inconsistency ----
<input type="checkbox"/>	<input checked="" type="checkbox"/>	15. Are there any wastewater disposal needs in the area adjacent to this proposal that should be considered by the municipality? If yes, describe ----
<input type="checkbox"/>	<input type="checkbox"/>	16. Has a waiver of the sewage facilities planning requirements been requested for the residual tract of this subdivision? N/A
<input type="checkbox"/>	<input type="checkbox"/>	If yes, is the proposed waiver consistent with applicable ordinances. If no, describe the inconsistencies ----
<input checked="" type="checkbox"/>	<input type="checkbox"/>	17. Does the county have a stormwater management plan as required by the Stormwater Management Act?
<input type="checkbox"/>	<input checked="" type="checkbox"/>	If yes, will this project plan require the implementation of storm water management measures?
		18. Name, Title and signature of person completing this section:
		Name: <u>Susan L. Rockwell</u>
		Title: <u>Senior Environmental Planner</u> Signature: <u><i>S. L. Rockwell</i></u>
		Date: <u>August 3, 2016</u>
		Name of County or Areawide Planning Agency: <u>Lehigh Valley Planning Commission</u>
		Address: <u>961 Marcon Blvd, Suite 310, Allentown PA 18109</u>
		Telephone Number: <u>610-264-4544</u>

SECTION D. ADDITIONAL COMMENTS (See Section D of instructions)

This Component does not limit county planning agencies from making additional comments concerning the relevancy of the proposed plan to other plans or ordinances. If additional comments are needed, attach additional sheets.

The county planning agency must complete this Component within 60 days.

This Component and any additional comments are to be returned to the applicant.

RETTEWSM

We answer to you.

1-800-RETTEW-5 • www.rettew.com